PLANS AND DOCUMENTS
referred to in the PDA
DEVELOPMENT APPROVAL

Approval no: DEV2021/1250

Date: 25 March 2022

Undullah – Master Planned Community

Rice, Dairy and Wyatt Roads, Undullah, QLD

Tranche 3 Clearing Phase Erosion and Sediment Control Management Plan

Pioneer Fortune Pty Ltd

20 December 2021

Document Verification

Job Title **Undullah – Master Planned Community**

Job Number 23165

Document Title Tranche 3 Clearing Phase Erosion and Sediment Control Management Plan

Document Control

Date	Document	Revision No.	Author	Reviewer
20.12.21	Tranche 3 Clearing Phase Erosion and Sediment Control Management Plan	00	M Spiller	M Lepelaar

Approval for Issue

Name	Signature	Date
Michael Lepelaar		20.12.21

© Document copyright of ADG Engineers (Aust) Pty Ltd

This document is and shall remain in the property of ADG. The document may only be used for the purpose for which it was commissioned and in accordance with the Terms of Engagement for the commission. Unauthorised use of this document in any form whatsoever is prohibited.

To the extent permitted by law, ADG expressly disclaims and excludes liability for any loss, damage, cost or expenses suffered by any third party relating to or resulting from the use of, or reliance on, any information contained in this report. ADG does not admit that any action, liability or claim exist or be available to any third party.

CONTENTS

1	**INTRODUCTION**	**4**
2	**SITE LOCATION & CHARACTERISTICS**	**5**
2.1	Site Location	5
2.2	Local Authority	5
2.3	Rainfall	5
2.4	Soil Characteristics	6
2.5	Catchment Details	6
3	**EROSION AND SEDIMENT CONTROL OBJECTIVES - CLEARING PHASE**	**8**
3.1	Drainage Control	8
3.2	Erosion Control	8
3.3	Sediment Control	8
4	**EROSION RISK**	**9**
4.1	Hazard Assessment	9
4.2	RUSLE	10
5	**CLEARING PHASE EROSION AND SEDIMENT CONTROL STRATEGY**	**13**
5.1	Drainage Control	13
5.1.1	Catchment Hydrology	13
5.1.2	Clean Water Diversion Channel Capacity Design	19
5.2	Erosion Control	26
5.2.1	Cover	26
5.2.2	Limitations of Exposed Surface	28
5.3	Sediment Controls	28
5.3.1	Rock Check Dams	28
5.3.2	Sediment Fence	29
5.3.3	Rock Filter Dams	29
6	**OPERATION, MAINTENANCE & MONITORING**	**29**
6.1	Water Quality Objectives	29
6.2	Erosion and Sediment Control Devices	29
7	**CONCLUSION**	**31**

TABLE OF FIGURES

Figure 1 – Tranche 3 Site Location (As accessed from QLD Globe 18/11/2021) 5
Figure 2 - Undullah Mean Rainfall 6
Figure 3 – Tranche 3 Clearing Phase Catchment Plan (not to scale) 7
Figure 4 – Typical Clean Water Diversion Drain Detail 21
Figure 5 – Typical Drainage Channel Detail 25
Figure 6 – Visual Cover Estimation Template (adopted from IECA Revegetation Erosion Control Technique V1 (January 2010)) 27
Figure 7 – Clearing Progression Detail 28

TABLE OF TABLES

Table 1 - Property Details 4
Table 2 – IECA Hazard Assessment 9
Table 3 – Sediment Loss Risk Assessment for Tranche 3 Clearing (No Control Measures) 11
Table 4 – Sediment Control Standard (default) Based on Soil Loss Rate 11
Table 5 – Control Measure Defaults for IECA Control Types 12
Table 6 – Clean Water Diversion Drain Hydrology 14
Table 7 – Drainage Channel Hydrology 15
Table 8 – Clean Water Diversion Drain Capacity Design 19
Table 9 – Drainage Channel Capacity Design 22
Table 10 – Sediment Loss Risk Assessment for Tranche 3 Clearing (with 80% Mulch Cover) 26
Table 11 - ESC Maintenance Schedule 30

APPENDICES

Appendix A ADG Engineers Sediment and Erosion Control Plans
Appendix B IECA Standard Drawings
Appendix C Veris Australia Pty Ltd Site Context Plan
Appendix D Department of Natural Resources Soil and Land Information

1 INTRODUCTION

ADG Engineers (Aust.) Pty Ltd has been engaged by Pioneer Fortune Pty Ltd to prepare a Sediment and Erosion Control Management Plan to support the proposed Vegetation Clearing Phase for Tranche 3 as identified in the Saunders Havill Vegetation Management Plan of the proposed development at Undullah, QLD.

Tranche 3 of the development is located on the southern end of the site and comprises of a section of Trunk Road, Urban Residential Neighbourhoods, District Centre, Education sites for primary and secondary schools and District Sports sites. The purpose of this report is to provide advice on the proposed development with regards to erosion and sediment control throughout the clearing phase of the project. Further property details for the proposed clearing are summarised in **Table 1**. We advise that further sediment and erosion control documentation will be provided as part of the future civil works.

Table 1 - Property Details

Title	Undullah – Master Planned Community – Tranche 3
Street Address	Rice, Dairy and Wyatt Roads, Undullah, QLD 4285
Lot Details	Lot 3 on RP45236
Approximate Development Area	T3: 277.756ha

The report has been prepared based on the following information available at the time of writing the report:

- Veris Australia Pty Ltd.'s Overall Site Context Plan – Issue AB (dated 20/10/20);
- Economic Development Queensland PDA Guideline no. 13 – Engineering Standards (2017);
- Economic Development Queensland PDA Guideline no. 14 – Environmental (2015);
- Queensland Government – Department of Natural Resources Soil and Land Information Records;
- Saunders Havill Vegetation Management Plan (dated 19/11/2021);
- Catchments and Creeks – Sediment Control Techniques V1 (2010);
- Queensland Urban Drainage Manual (2017); and
- International Erosion Control Association (IECA) Standards and Guidelines.

2 SITE LOCATION & CHARACTERISTICS

2.1 Site Location

The proposed Undullah Master Planned Community is located within the Greater Flagstone Priority Development Area (PDA) currently under the control of Economic Development Queensland and Department of State Development, Local Government and Infrastructure Planning. Tranche 3 of the works are located at the southern end of the site and extends to the east to near west boundary. The boundary of Tranche 3 within the overall site can be seen below in **Figure 1** with Tranche 3 being highlighted in green.

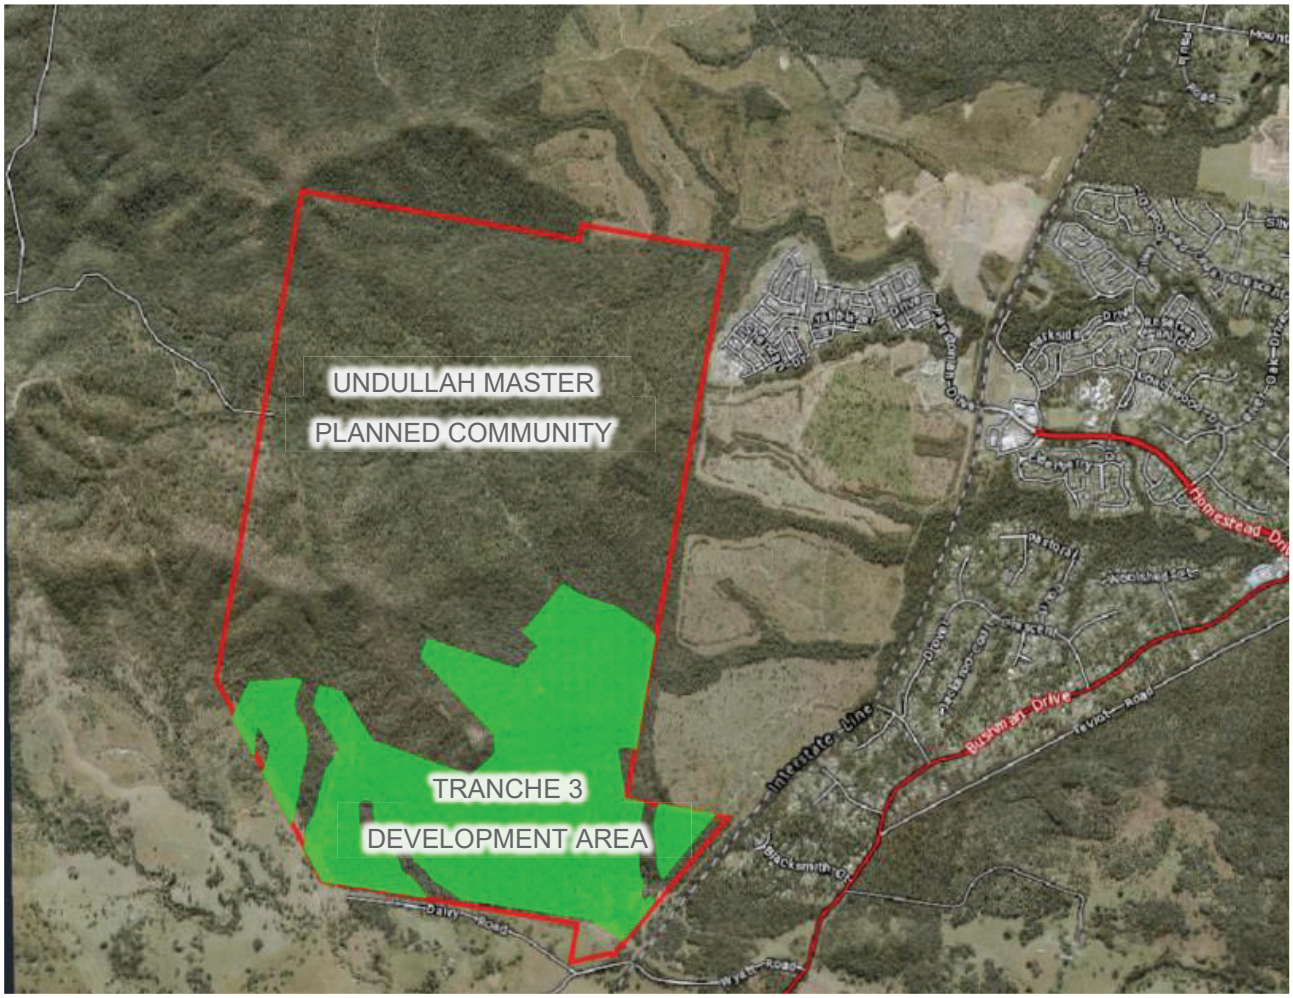

Figure 1 – Tranche 3 Site Location (As accessed from QLD Globe 18/11/2021)

2.2 Local Authority

As the site is located within the Flagstone PDA, assessment will be undertaken by Economic Development Queensland (EDQ) and hence, will need to comply with the relevant EDQ guidelines.

2.3 Rainfall

The climate of the Undullah area is described by the Bureau of Meteorology as Subtropical and is generally subject to more rainfall from October through to March. The average monthly rainfall for the area is presented in **Figure 2**. The mean annual rainfall for the Undullah area is 805.1mm. Rainfall data was gathered using the Bureau of Meteorology's Yarrahappini Weather Station, which is in close proximity to Undullah.

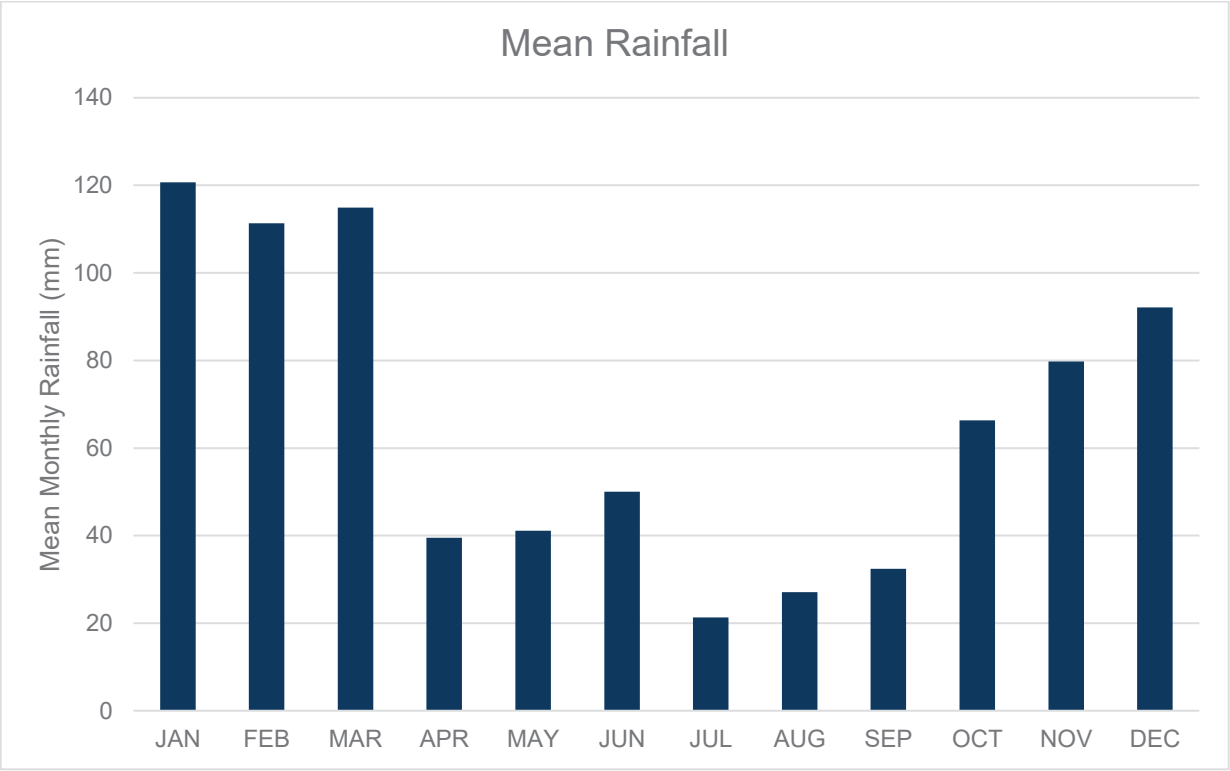

Figure 2 - Undullah Mean Rainfall

2.4 Soil Characteristics

A Queensland Government Soil and Land Information Site Listing Report was obtained for the subject area (**Appendix D**). In summary, the relevant findings of the report include:

- Tests of the soil stratum were taken to a depth of ~0.85 m;
- The natural soil stratum layers consist of:
  - Fine sandy loam; and
  - Light medium clay
- The surface soil layer is moderately permeable (50-500mm/day); and
- The substrate consists of a Sandstone lithology.

2.5 Catchment Details

Tranche 3 consists of thirty-two identified internal and sixteen external catchments. Internal catchments will be cleared for development as shown in **Figure 3** below. Further information regarding the catchments for Tranche 3 can be found in the Tranche 3 Clearing Phase Sediment and Erosion Control Catchment Plans in **Appendix A**.

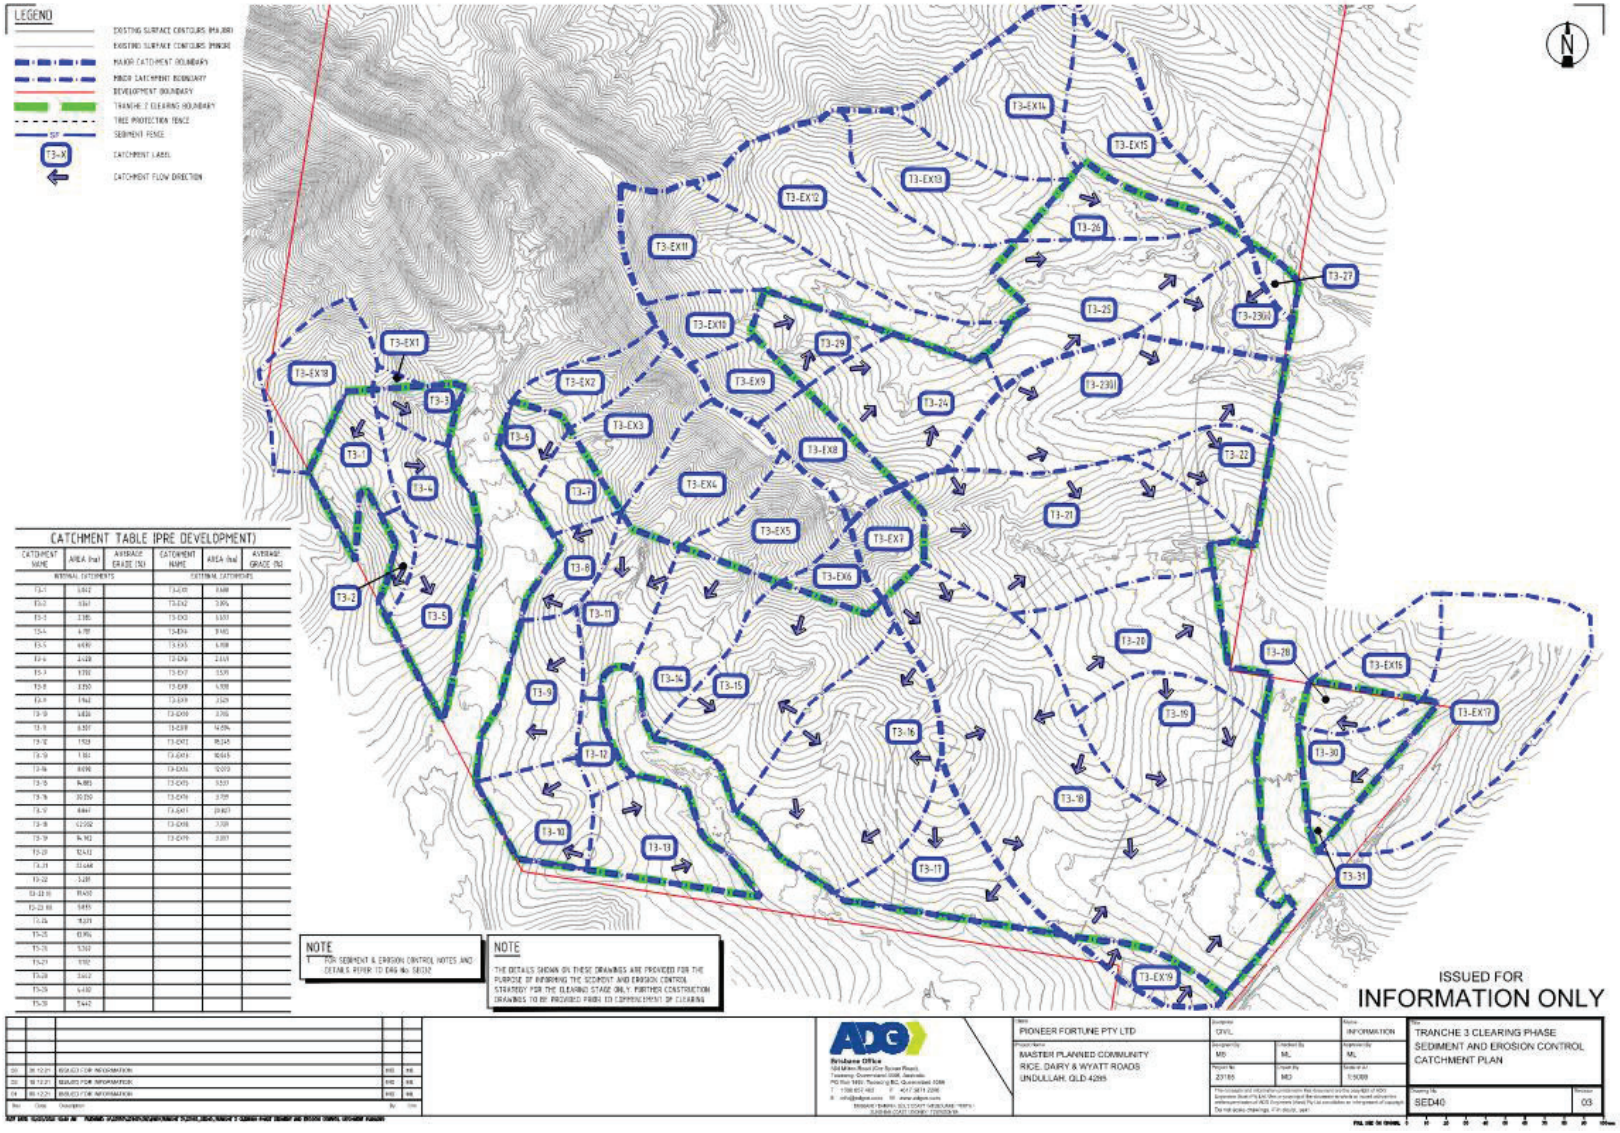

Figure 3 – Tranche 3 Clearing Phase Catchment Plan (not to scale)

3 EROSION AND SEDIMENT CONTROL OBJECTIVES - CLEARING PHASE

To mitigate the risk of erosion on site and sediment deposition downstream of the clearing works, the following objectives have been outlined for the clearing phase:

3.1 Drainage Control

- Direct the clean water flows from the upstream, undisturbed catchments through designated temporary erosion protected channels or uncleared areas of the site.

3.2 Erosion Control

- Limit the ability for sheet flow to generate runnels or gully erosion within the cleared areas of the site during the clearing process.
- Mitigate the risk of total sediment soil losses by staging the clearing works to reduce the area of cleared and partially disturbed land at any one time.
- Provide immediate erosion protection of the cleared, partially disturbed land as each clearing stage is finished.
- Ensure that all cleared, partially disturbed land is effectively covered or stabilised prior to any forecasted rain event.

3.3 Sediment Control

- Implement sediment controls that mitigate the risk of sediment laden water from the clearing phase stages flowing downstream.

4 EROSION RISK

In order to assess the potential risk and gain an understanding to the volume of potential sediment contained within stormwater runoff an erosion hazard assessment has been undertaken combined with a sediment loss predication based on RUSLE.

4.1 Hazard Assessment

Based on the below erosion hazard assessments (Table 3.1 - IECA), disturbance within the site catchments associated within the proposed development has the potential to be “high risk”.

Table 2 – IECA Hazard Assessment

Condition		Points	Score	Trigger Value
AVERAGE SLOPE OF DISTURBANCE AREA [1]			4	**4**
• not more than 3%	[3% . 33H:1V]	0		
• more than 3% but not more than 5%	[5% = 20H:1V]	1		
• more than 5% but not more than 10%	[10% = 10H:1V]	2		
• more than 10% but not more than 15%	[15% . 6.7H:1V]	4		
• more than 15%		6		
SOIL CLASSIFICATION GROUP (AS1726) [2]			2	
• GW, GP, GM, GC		0		
• SW, SP, OL, OH		1		
• SM, SC, MH, CH		2		
• ML, CL, or if *imported fill* is used, or if soils are untested		3		
EMERSON (DISPERSION) CLASS NUMBER [3]			4	**6**
• Class 4, 6, 7, or 8		0		
• Class 5		2		
• Class 3, (default value if soils are untested)		4		
• Class 1 or 2		6		
DURATION OF SOIL DISTURBANCE [4]			2	**6**
• not more than 1 month		0		
• more than 1 month but not more than 4 months		2		
• more than 4 months but not more than 6 months		4		
• more than 6 months		6		
AREA OF DISTURBANCE [5]			6	**4**
• not more than 1000 m^2		0		
• more than 1000 m^2 but not more than 5000 m^2		1		
• more than 5000 m^2 but not more than 1 ha		2		
• more than 1 ha but not more than 4 ha		4		
• more than 4 ha		6		
WATERWAY DISTURBANCE [6]			2	**2**
• No disturbance to a watercourse, open drain or channel		0		
• Involves disturbance to a constructed open drain or channel		1		
• Involves disturbance to a natural watercourse		2		
REHABILITATION METHOD [7] Percentage of area (relative to total disturbance) revegetated by seeding without light mulching (i.e. worst-case revegetation method).			2	
• not more than 1%		0		
• more than 1% but not more than 5%		1		
• more than 5% but not more than 10%		2		
• more than 10%		4		
RECEIVING WATERS [8]			2	
• Saline waters only		0		
• Freshwater body (e.g. creek or freshwater lake or river)		2		
SUBSOIL EXPOSURE [9]			0 Clearing phase only	
• No subsoil exposure except of service trenches		0		
• Subsoils are likely to be exposed		2		
EXTERNAL CATCHMENTS [10]			2	
• No external catchment		0		

• External catchment diverted around the soil disturbance	1		
• External catchment not diverted around the soil disturbance	2		
ROAD CONSTRUCTION [11]		0	
• No road construction	0		
• Involves road construction works	2		
pH OF SOILS TO BE REVEGETATED [12]		1	
• more than pH 5.5 but less than pH 8	0		
• other pH values, or if soils are untested	1		
Total Score [13]		**27**	

4.2 RUSLE

In order to gain an estimate of the potential volume of soil loss from each exposed catchment the Revised Universal Soil Loss Equation (RUSLE) (**Equation 1**) has been relied upon.

$$A = R \cdot K \cdot LS \cdot P \cdot C$$ **Equation 1**

Where:

$A =$ Annual Soil Loss due to erosion (t / ha / yr)

$R = Rainfall\ Erosivity\ Factor = 164.74 \cdot 1.1177^{S} \cdot S^{0.6444}$

$S = 2\ year\ ARI, 6\ hour\ storm\ event = 10.40\ as\ per\ BOM\ IFD\ for\ Undullah$

$K = Soil\ Erodibility\ Factor\ (Table\ E5\ \ IECA\ Best\ Practice\ Erosion\ \&\ Sediment\ Control\ Guidelines)$

$LS =\ Topographic\ Factor\ (Table\ E3\ \ IECA\ Best\ Practice\ Erosion\ \&\ Sediment\ Control\ Guidelines)$

$C = Cover\ Management\ Factor$

$P = Erosion\ Control\ Practice\ Factor\ (default\ of\ 1.3)$

The average annual soil loss for each catchment of Tranche 3 has been estimated in the first instance based on the assumption that clearing operations will result in the exposure of soil surfaces and hence, a cover management factor (C value) of 1 and an erosion control practice factor (P value) of 1.3 have been used. Calculations were made in accordance with Section E3 of IECA 2012, Best Practice Erosions and Sediment Control with results presented in **Table 3** below.

Table 3 – Sediment Loss Risk Assessment for Tranche 3 Clearing (No Control Measures)

Catchment ID	Area (ha)	R	K	LS	P	C	A (t/ha/yr)	A (t/yr)	Control
T3-1	5.042	2370.1	0.03	4.33	1.3	1	400.2	2018.0	TYPE 1
T3-2	1.36	2370.1	0.03	4.16	1.3	1	384.1	522.3	TYPE 1
T3-3	2.385	2370.1	0.03	4.61	1.3	1	426.1	1016.3	TYPE 1
T3-4	4.781	2370.1	0.03	5.42	1.3	1	501.0	2395.2	TYPE 1
T3-5	6.039	2370.1	0.03	2.82	1.3	1	260.7	1574.1	TYPE 1
T3-6	2.428	2370.1	0.03	3.26	1.3	1	300.9	730.5	TYPE 1
T3-7	3.292	2370.1	0.03	4.02	1.3	1	371.6	1223.3	TYPE 1
T3-8	3.35	2370.1	0.03	5.02	1.3	1	464.0	1554.5	TYPE 1
T3-9	7.962	2370.1	0.03	4.33	1.3	1	400.2	3186.7	TYPE 1
T3-10	5.83	2370.1	0.03	1.68	1.3	1	155.3	905.3	TYPE 1
T3-11	6.307	2370.1	0.03	5.77	1.3	1	533.3	3363.8	TYPE 1
T3-12	1.923	2370.1	0.03	2.05	1.3	1	189.5	364.4	TYPE 1
T3-13	7.704	2370.1	0.03	2.82	1.3	1	260.7	2008.2	TYPE 1
T3-14	8.098	2370.1	0.03	5.42	1.3	1	501.0	4057.0	TYPE 1
T3-15	14.885	2370.1	0.03	5.77	1.3	1	533.3	7938.8	TYPE 1
T3-16	20.25	2370.1	0.03	4.06	1.3	1	375.3	7599.5	TYPE 1
T3-17	8.867	2370.1	0.03	2.37	1.3	1	219.1	1942.5	TYPE 1
T3-18	42.923	2370.1	0.03	3.12	1.3	1	288.4	12378.7	TYPE 1
T3-19	14.762	2370.1	0.03	2.61	1.3	1	240.8	3554.5	TYPE 1
T3-20	12.432	2370.1	0.03	1.70	1.3	1	157.1	1953.5	TYPE 1
T3-21	22.468	2370.1	0.03	4.92	1.3	1	454.3	10207.5	TYPE 1
T3-22	5.281	2370.1	0.03	1.03	1.3	1	95.2	502.8	TYPE 1
T3-23(i)	19.45	2370.1	0.03	2.61	1.3	1	240.8	4683.4	TYPE 1
T3-23(ii)	5.833	2370.1	0.03	1.35	1.3	1	124.8	727.9	TYPE 1
T3-24	11.221	2370.1	0.03	3.57	1.3	1	329.5	3697.6	TYPE 1
T3-25	13.994	2370.1	0.03	1.70	1.3	1	157.1	2199.0	TYPE 1
T3-26	5.262	2370.1	0.03	1.68	1.3	1	155.3	817.1	TYPE 1
T3-27	1.102	2370.1	0.03	1.19	1.3	1	110.0	121.2	TYPE 1
T3-28	2.642	2370.1	0.03	1.19	1.3	1	110.0	290.6	TYPE 1
T3-29	4.402	2370.1	0.03	5.42	1.3	1	501.0	2205.4	TYPE 1
T3-30	7.603	2370.1	0.03	1.19	1.3	1	110.0	836.3	TYPE 1
T3-31	0.402	2370.1	0.03	5.42	1.3	1	501.0	201.4	TYPE 1

Risk assessment as per IECA Best Practice Erosion and Sediment Control 2008, Appendix E

Based on the results in **Table 3** soil loss estimates of between 95.2 t/ha/yr to 811.6 t/ha/yr would be expected for the cleared catchment areas. Based on these average soil loss estimates and in accordance with **Table 4** below (IECA Appendix B, Table B1 - 2018), Type 1 sediment controls would be necessary to mitigate impacts to downstream receiving environments. As demonstrated in **Section 5.2.1**, ADG propose to implement a strategy to reduce the C value by applying a cover to the exposed surface.

Table 4 – Sediment Control Standard (default) Based on Soil Loss Rate

Catchment Area (m^2)	Soil Loss (t/ha/yr)		
	Type 1	Type 2	Type 3
250	N/A	N/A	N/A
1000	N/A	N/A	All Cases
2500	N/A	>75	75
>2500	>150	150	75
>10,000	>75	N/A	75

In accordance with Catchments and Creeks (2010), the following controls are considered suitable for use within each of the exposed catchments to minimise the possibility of sediment discharge into the downstream environments (**Table 5**).

Table 5 – Control Measure Defaults for IECA Control Types

Type 1	Type 2	Type 3
Sheet Flow Treatment Techniques		
• Sediment basins capable of capturing 100% of the nominated design rainfall event	• Buffer Zones capable of infiltrating the nominated design rainfall event • Mulch cover	• Buffer Zones • Sediment Fence • Mulch cover
Concentrated and Instream Flow Treatment Techniques		
• Sediment basins capable of capturing 100% of the nominated design rainfall event	• Rock Filter Dams • Geotextile Lining	• Rock Check Dams • Geotextile Lining • Rock Filter Dams

5 CLEARING PHASE EROSION AND SEDIMENT CONTROL STRATEGY

In order to ensure that the discharge of sediment laden stormwater is avoided (for events up to and including the nominated design storm), where practicable, and minimised when the nominated design storm is exceeded, best practice site management procedures have been developed for the clearing phase of each catchment.

Controls have been developed based on the following key areas of control:

- Drainage Control;
- Erosion Control; and
- Sediment Control.

5.1 Drainage Control

In order to ensure that external catchment "clean water flows" are conveyed through the disturbed catchments without coming into contact with exposed surfaces, clean water flows are to be collected and conveyed via clean water diversion drains and drainage channels.

5.1.1 Catchment Hydrology

To determine the design requirements for the necessary diversion structures, a hydrological analysis has been undertaken. Equation 4.2 (QUDM, 2016) was utilised and is shown below.

$$Q_y = \frac{C_y \cdot I_y^t \cdot A}{360}$$ **Equation 2**

Where:

$Q_y = peak\ flow\ rate\ \left(\frac{m^3}{s}\right) for\ annual exceedance\ probability\ (AEP) of\ 1\ in\ 'y'\ years$

$C_y = coefficient\ of\ discharge\ for\ AEP\ of\ 1\ in\ 'y'\ years$

$A = catchment\ area\ (ha)$

$I_y^t = average\ rainfall\ intensity\ \left(\frac{mm}{hr}\right) for\ a\ design\ duration\ of\ 't'\ (hrs) and\ 'y'\ years$

$t = the\ nominal\ design\ storm\ duration\ as\ defined\ by\ the\ time\ of\ concentration$

The design peak discharge for each clean water diversion drain and drainage channel is presented in **Table 6** and **Table 7**. A design rainfall event Average Recurrence Interval (ARI) of 5 years has been adopted in accordance with IECA Appendix A – Table A1. Initial design was prepared with an unlined base for all diversion structures, where velocities exceeded bare earth scour criteria and hence, specific linings have been proposed for the channel of the structures. Typical drainage structure details are shown in **Figure 4** and **Figure 5**. Further information regarding the diversion structures is shown in the ADG drawings (**Appendix A**).

Table 6 – Clean Water Diversion Drain Hydrology

ID	Catchment Area (ha)	Catchment Slope (%)	Channel Slope (%)	n (Hortons Roughness)	TOC (mins)	ARI (years)	Intensity (mm/hr)	C factor	Flow (m3/s)
TRANCHE 3									
EX2-D1	0.4591	11.83	9.91	0.045	13.1	5	116.00	0.627	0.09
EX2-D2	0.8131	8.90	4.04	0.045	13.5	5	109.00	0.627	0.15
EX3-D1	0.3272	10.83	12.90	0.045	13.6	5	120.00	0.627	0.07
EX3-D2	0.5792	19.24	22.22	0.045	12.0	5	113.00	0.627	0.11
EX4-D1	0.3703	17.50	20.00	0.045	12.2	5	113.00	0.627	0.07
EX4-D2	0.1671	16.74	22.22	0.045	12.9	5	114.00	0.627	0.03
EX5-D1	0.3044	12.14	14.29	0.045	13.3	5	115.00	0.627	0.06
EX5-D2	0.2561	12.14	14.29	0.045	13.3	5	116.00	0.627	0.05
EX5-D3	0.2561	12.14	14.29	0.045	13.3	5	117.00	0.627	0.05
EX5-D4	0.2561	12.14	14.29	0.045	13.3	5	118.00	0.627	0.05
EX6-D1	1.053	20.91	21.82	0.045	12.0	5	119.00	0.627	0.22
EX6-D2	1.415	20.91	21.82	0.045	12.0	5	120.00	0.627	0.30
EX7-D1	0.5003	23.39	21.78	0.045	11.4	5	121.00	0.627	0.11
EX7-D2	0.9424	20.92	21.85	0.045	12.0	5	122.00	0.627	0.20
EX7-D3	0.3664	12.81	9.38	0.045	12.4	5	123.00	0.627	0.08

EX7-D4	0.4991	15.83	16.67	0.045	12.6	5	124.00	0.627	0.11
EX7-D5	0.7764	14.38	12.50	0.045	12.7	5	125.00	0.627	0.17
EX7-D6	0.4314	15.00	12.50	0.045	12.0	5	126.00	0.627	0.09
EX8-D1	3.6997	14.09	15.69	0.045	12.8	5	127.00	0.627	0.82
EX8-D2	1.2197	15.41	12.07	0.045	12.4	5	128.00	0.627	0.27
EX10-D1	3.705	20.19	15.38	0.045	12.1	5	129.00	0.627	0.83
EX13-D1	10.045	11.99	6.48	0.045	15.9	5	130.00	0.627	2.27
EX16-D1	3.739	8.69	7.38	0.045	15.6	5	131.00	0.627	0.85

Table 7 – Drainage Channel Hydrology

ID	Catchment Area (ha)	Catchment Slope (%)	Channel Slope (%)	n (Hortons Roughness)	TOC (mins)	ARI (years)	Intensity (mm/hr)	C factor	Flow (m3/s)
TRANCHE 3									
T3-1-C1	12.773	16.06	4.62	0.045	16.7	5	106.00	0.627	2.36
T3-3-C1	3.073	18.00	13.75	0.045	12.8	5	120.00	0.627	0.64
T3-4-C1	3.187	13.74	13.73	0.045	13.0	5	120.00	0.627	0.67
T3-4-C2	1.594	11.90	13.79	0.045	14.0	5	113.00	0.627	0.31
T3-5-C1	1.510	16.00	8.42	0.045	14.7	5	113.00	0.627	0.30
T3-5-C2	3.020	16.00	8.42	0.045	14.7	5	113.00	0.627	0.59
T3-6-C1	6.402	16.00	9.77	0.045	13.8	5	116.00	0.627	1.29

T3-7-C1	9.989	17.60	10.20	0.045	14.4	5	113.00	0.627	1.97
T3-8-C1	0.8375	12.21	9.42	0.045	13.2	5	116.00	0.627	0.17
T3-8-C2	1.675	14.45	17.65	0.045	13.0	5	120.00	0.627	0.35
T3-9-C1	3.981	8.18	8.86	0.045	22.0	5	90.00	0.627	0.62
T3-9-C2	3.981	8.18	8.86	0.045	22.0	5	90.00	0.627	0.62
T3-10-C1	5.826	6.60	4.44	0.045	34.0	5	69.30	0.627	0.70
T3-11-C1	11.6185	15.54	11.09	0.045	14.0	5	113.00	0.627	2.29
T3-11-C2	14.772	14.51	9.02	0.045	14.0	5	113.00	0.627	2.91
T3-13-C1	7.704	5.88	5.51	0.045	14.0	5	113.00	0.627	1.52
T3-14-C1	4.5612	9.48	7.71	0.045	14.0	5	113.00	0.627	0.90
T3-14-C2	10.4448	13.72	7.43	0.045	14.0	5	113.00	0.627	2.06
T3-15-C1	3.248	14.78	7.05	0.045	14.0	5	113.00	0.627	0.64
T3-15-C2	5.738	14.78	7.05	0.045	14.9	5	113.00	0.627	1.13
T3-15-C3	17.326	14.07	5.64	0.045	18.2	5	100.00	0.627	3.02
T3-16-C1	5.3107	10.65	8.79	0.045	14.0	5	113.00	0.627	1.05
T3-16-C2	4.193	8.92	7.83	0.045	16.5	5	106.00	0.627	0.77
T3-16-C3	20.25	9.08	5.65	0.045	18.5	5	100.00	0.627	3.53
T3-17-C1	2.071	3.90	4.05	0.045	17.7	5	103.00	0.627	0.37
T3-17-C2	8.862	5.35	6.94	0.045	18.9	5	100.00	0.627	1.54

T3-18-C1	8.854	13.93	5.36	0.045	16.7	5	106.00	0.627	1.63
T3-18-C2	22.988	13.27	4.04	0.045	22.2	5	90.00	0.627	3.60
T3-18-C3	30.103	12.89	3.28	0.045	26.7	5	81.80	0.627	4.29
T3-18-C4	44.347	12.74	2.97	0.045	33.0	5	72.00	0.627	5.56
T3-18-C5	1.773	8.42	8.08	0.045	14.3	5	113.00	0.627	0.35
T3-18-C6	2.46	6.38	5.26	0.045	14.9	5	113.00	0.627	0.48
T3-18-C7	5.031	7.49	7.49	0.045	15.6	5	109.00	0.627	0.96
T3-19-C1	6.779	6.40	6.56	0.045	17.3	5	103.00	0.627	1.22
T3-19-C2	14.762	5.76	5.27	0.045	19.5	5	97.30	0.627	2.50
T3-20-C1	5.125	6.61	6.98	0.045	16.4	5	106.00	0.627	0.95
T3-20-C2	12.432	4.08	1.91	0.045	21.9	5	92.30	0.627	2.00
T3-21-C1	3.362	11.46	7.92	0.045	15.4	5	109.00	0.627	0.64
T3-21-C2	15.355	10.78	6.55	0.045	18.3	5	100.00	0.627	2.67
T3-21-C3	22.468	10.59	6.19	0.045	20.2	5	94.70	0.627	3.71
T3-21-C4	4.819	11.34	8.94	0.045	15.3	5	109.00	0.627	0.91
T3-21-C5	3.197	9.00	8.00	0.045	15.1	5	109.00	0.627	0.61
T3-22-C1	5.281	6.92	6.35	0.045	16.3	5	106.00	0.627	0.97
T3-23i-C1	7.199	5.30	4.36	0.045	19.9	5	97.30	0.627	1.22
T3-23i-C2	13.86	5.09	3.92	0.045	23.4	5	87.80	0.627	2.12

T3-23i-C3	19.45	5.21	4.18	0.045	26.1	5	81.80	0.627	2.77
T3-23ii-C1	1.671	6.37	7.74	0.045	16.4	5	106.00	0.627	0.31
T3-23ii-C2	79.28	13.80	5.10	0.045	23.7	5	87.80	0.627	12.12
T3-24-C1	5.277	8.94	10.39	0.045	16.2	5	106.00	0.627	0.97
T3-24-C2	16.159	8.11	8.72	0.045	17.1	5	103.00	0.627	2.90
T3-24-C3	6.47	14.61	11.73	0.045	14.1	5	113.00	0.627	1.27
T3-25-C1	21.484	8.18	3.86	0.045	25.0	5	83.70	0.627	3.13
T3-25-C2	35.428	7.89	3.28	0.045	28.5	5	78.20	0.627	4.83
T3-25-C3	5.213	4.46	3.92	0.045	19.5	5	97.30	0.627	0.88
T3-25-C4	72.345	14.17	5.84	0.045	19.3	5	97.30	0.627	12.26
T3-26-C1	36.917	9.49	3.98	0.045	20.9	5	94.70	0.627	6.09
T3-26-C2	12.547	14.28	6.06	0.045	17.8	5	103.00	0.627	2.25
T3-28-C1	2.642	5.43	4.61	0.045	16.9	5	106.00	0.627	0.49
T3-29-C1	7.931	15.09	10.18	0.045	13.5	5	116.00	0.627	1.60
T3-30-C1	5.442	4.16	3.31	0.045	19.2	5	97.30	0.627	0.92

5.1.2 Clean Water Diversion Channel Capacity Design

Table 8 – Clean Water Diversion Drain Capacity Design

ID	Slope (%)	Flow (m^3/s)	Manning's n	Side Slope (1 in X)	Freeboard (m) (min 0.15m)	Flow Depth (m)	Total Depth 'A' Inc. Freeboard (m)	Flow Area (m^2)	Wetted Perimeter (m)	Hyd. Radius	Velocity (m/s)	Capacity inc Freeboard (m^3/s)
TRANCHE 3												
EX2-D1	6	0.09	0.022	2	0.15	0.25	0.40	0.13	1.12	0.11	2.58	1.13
EX2-D2	13	0.15	0.022	2	0.15	0.17	0.32	0.06	0.76	0.08	2.94	0.92
EX3-D1	13	0.07	0.022	2	0.15	0.13	0.28	0.03	0.58	0.06	2.46	0.64
EX3-D2	8	0.11	0.022	2	0.15	0.16	0.31	0.05	0.72	0.07	2.21	0.66
EX4-D1	17	0.07	0.022	2	0.15	0.13	0.28	0.03	0.58	0.06	2.81	0.74
EX4-D2	16	0.03	0.022	2	0.15	0.10	0.25	0.02	0.45	0.05	2.29	0.53
EX5-D1	5	0.06	0.022	2	0.15	0.15	0.30	0.05	0.67	0.07	1.68	0.48
EX5-D2	5	0.05	0.022	2	0.15	0.15	0.30	0.05	0.67	0.07	1.68	0.48
EX5-D3	22	0.05	0.022	2	0.15	0.10	0.25	0.02	0.45	0.05	2.68	0.62
EX5-D4	20	0.05	0.022	2	0.15	0.10	0.25	0.02	0.45	0.05	2.56	0.59
EX6-D1	4	0.22	0.022	2	0.15	0.25	0.40	0.13	1.12	0.11	2.11	0.92
EX6-D2	15	0.30	0.022	2	0.15	0.21	0.36	0.09	0.94	0.09	3.63	1.35
EX7-D1	15	0.11	0.022	2	0.15	0.15	0.30	0.05	0.67	0.07	2.90	0.83

EX7-D2	13	0.20	0.022	2	0.15	0.19	0.34	0.07	0.85	0.09	3.17	1.08
EX7-D3	7	0.08	0.022	2	0.15	0.15	0.30	0.05	0.67	0.07	1.98	0.57
EX7-D4	18	0.11	0.022	2	0.15	0.15	0.30	0.05	0.67	0.07	3.18	0.91
EX7-D5	10	0.17	0.022	2	0.15	0.18	0.33	0.07	0.81	0.08	2.68	0.87
EX7-D6	18	0.09	0.022	2	0.15	0.14	0.29	0.04	0.63	0.06	3.04	0.83
EX8-D1*	3	0.82	0.022	2	0.15	0.25	0.40	0.48	2.12	0.18	2.48	2.30
EX8-D2	9	0.27	0.022	2	0.15	0.22	0.37	0.10	0.98	0.10	2.90	1.13
EX10-D1*	10	0.83	0.022	2	0.15	0.17	0.32	0.23	1.76	0.13	3.68	2.71
EX13-D1**	4	2.27	0.022	2	0.15	0.25	0.40	0.75	3.62	0.21	3.18	5.47
EX16-D1*	4	0.85	0.022	2	0.15	0.25	0.40	0.38	2.12	0.18	2.87	2.65

*NOTE: Channels EX8-D1, EX10-D1 and EX16-D1 require a channel base dimension ‘B’ of 1m width. Refer to Figure 7.

**NOTE: Channel EX13-D1 requires a channel base dimension ‘B’ of 2.5m width. Refer to Figure 7.

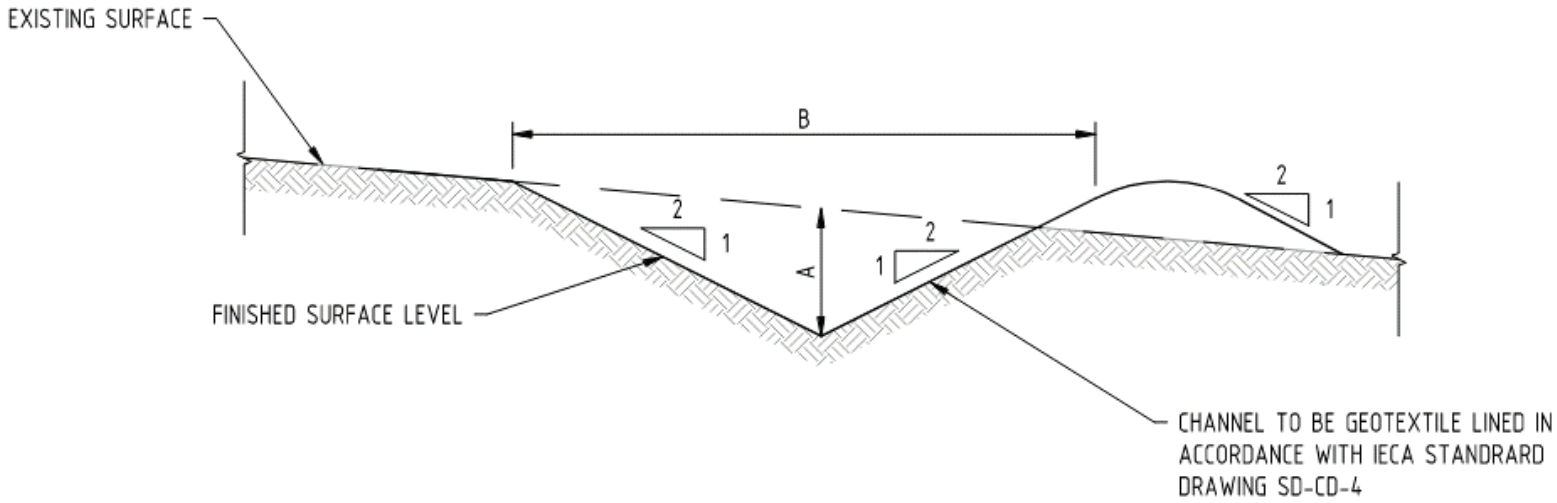

Figure 4 – Typical Clean Water Diversion Drain Detail

Table 9 – Drainage Channel Capacity Design

ID	Slope (%)	Flow (m^3/s)	Manning's n	Base Width 'B' (m)	Side Slope (1 in X)	Freeboard (m) (min 0.15m)	Flow Depth (m)	Total Depth 'A' Inc. Freeboard (m)	Flow Area (m^2)	Wetted Perimeter	Hydraulic Radius	Velocity (m/s)	Capacity inc Freeboard (m^3/s)
TRANCHE 3													
T3-1-C1	4.62	2.36	0.022	2.5	2	0.15	0.23	0.38	0.68	3.53	0.19	3.39	5.58
T3-3-C1	13.75	0.64	0.022	0.5	2	0.15	0.20	0.35	0.18	1.39	0.13	4.34	2.47
T3-4-C1	13.73	0.67	0.022	0.5	2	0.15	0.20	0.35	0.18	1.39	0.13	4.34	2.47
T3-4-C2	13.79	0.31	0.022	0	2	0.15	0.25	0.40	0.13	1.12	0.11	3.94	1.73
T3-5-C1	8.42	0.30	0.022	0	2	0.15	0.25	0.40	0.13	1.12	0.11	2.98	1.31
T3-5-C2	8.42	0.59	0.022	0.5	2	0.15	0.20	0.35	0.18	1.39	0.13	3.28	1.87
T3-6-C1	9.77	1.29	0.022	1	2	0.15	0.22	0.37	0.32	1.98	0.16	4.23	3.60
T3-7-C1	10.20	1.97	0.022	1.5	2	0.15	0.23	0.38	0.45	2.53	0.18	4.55	5.13
T3-8-C1	9.42	0.17	0.022	0	2	0.15	0.20	0.35	0.08	0.89	0.09	2.73	0.97
T3-8-C2	17.65	0.35	0.022	0	2	0.15	0.21	0.36	0.09	0.94	0.09	3.98	1.05
T3-9-C1	8.86	0.62	0.022	0.5	2	0.15	0.21	0.36	0.19	1.44	0.13	3.57	2.10
T3-9-C2	8.90	0.62	0.022	0.5	2	0.15	0.21	0.36	0.19	1.44	0.13	3.57	2.10
T3-10-C1	4.44	0.70	0.022	1	2	0.15	0.20	0.35	0.28	1.89	0.15	2.54	2.04
T3-11-C1	11.09	2.29	0.022	2	2	0.15	0.21	0.36	0.51	2.94	0.17	4.68	6.18
T3-11-C2	9.02	2.91	0.022	2	2	0.15	0.25	0.40	0.63	3.12	0.20	4.67	6.78

T3-13-C1	5.51	1.52	0.022	1.5	2	0.15	0.23	0.38	0.45	2.53	0.18	3.53	3.98
T3-14-C1	7.71	0.90	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	3.70	2.49
T3-14-C2	7.43	2.06	0.022	1.6	2	0.15	0.25	0.40	0.53	2.72	0.19	4.01	4.98
T3-15-C1	7.05	0.64	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	3.46	2.33
T3-15-C2	7.05	1.13	0.022	1	2	0.15	0.23	0.38	0.34	2.03	0.17	3.62	3.17
T3-15-C3	5.64	3.02	0.022	2.6	2	0.15	0.25	0.40	0.78	3.72	0.21	3.91	6.93
T3-16-C1	8.79	1.05	0.022	0.6	2	0.15	0.25	0.40	0.28	1.72	0.16	4.02	2.90
T3-16-C2	7.83	0.77	0.022	0.5	2	0.15	0.23	0.38	0.22	1.53	0.14	3.54	2.23
T3-16-C3	5.65	3.53	0.022	3.1	2	0.15	0.25	0.40	0.90	4.22	0.21	3.97	8.12
T3-17-C1	4.05	0.37	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	2.62	1.76
T3-17-C2	6.94	1.54	0.022	1.1	2	0.15	0.25	0.40	0.40	2.22	0.18	3.84	3.75
T3-18-C1	5.36	1.63	0.022	1.5	2	0.15	0.25	0.40	0.50	2.62	0.19	3.37	4.00
T3-18-C2	4.04	3.60	0.022	4	2	0.15	0.25	0.40	1.13	5.12	0.22	3.31	8.36
T3-18-C3	3.28	4.29	0.022	5.5	2	0.15	0.25	0.40	1.50	6.62	0.23	2.93	9.77
T3-18-C4	2.97	5.56	0.022	7	2	0.15	0.25	0.40	1.88	8.12	0.23	2.96	12.3
T3-18-C5	8.08	0.35	0.022	0	2	0.15	0.25	0.40	0.13	1.12	0.11	2.98	1.31
T3-18-C6	5.26	0.48	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	2.91	1.97
T3-18-C7	7.49	0.96	0.022	0.6	2	0.15	0.25	0.40	0.28	1.72	0.16	3.54	2.56
T3-19-C1	6.56	1.22	0.022	1	2	0.15	0.25	0.40	0.38	2.12	0.18	3.79	3.51

T3-19-C2	5.27	2.50	0.022	2.5	2	0.15	0.25	0.40	0.75	3.72	0.21	3.56	6.11
T3-20-C1	6.98	0.95	0.022	0.6	2	0.15	0.25	0.40	0.28	1.72	0.16	3.54	2.56
T3-20-C2	1.91	2.00	0.022	3	2	0.15	0.25	0.40	0.88	4.12	0.21	2.29	4.55
T3-21-C1	7.92	0.64	0.022	0.5	2	0.15	0.25	0.40	1.62	1.62	0.16	3.70	2.49
T3-21-C2	6.55	2.67	0.022	2.1	2	0.15	0.25	0.40	0.65	3.22	0.20	4.14	6.23
T3-21-C3	6.19	3.71	0.022	3.3	2	0.15	0.25	0.40	0.95	4.42	0.22	3.99	8.58
T3-21-C4	8.94	0.91	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	3.92	2.64
T3-21-C5	8.00	0.61	0.022	0.5	2	0.15	0.25	0.40	0.25	1.62	0.16	3.70	2.49
T3-22-C1	6.35	0.97	0.022	0.7	2	0.15	0.25	0.40	0.30	1.82	0.17	3.35	2.59
T3-23i-C1	4.36	1.22	0.022	1.2	2	0.15	0.25	0.40	0.43	2.32	0.18	2.93	3.02
T3-23i-C2	3.92	2.12	0.022	2.2	2	0.15	0.25	0.40	0.68	3.32	0.20	3.14	4.90
T3-23i-C3	4.18	2.77	0.022	3	2	0.15	0.25	0.40	0.89	4.23	0.21	3.22	6.55
T3-23ii-C1	7.74	0.31	0.022	0	2	0.15	0.25	0.40	0.14	1.23	0.11	3.02	1.49
T3-23ii-C2	5.10	12.12	0.022	12	2	0.15	0.25	0.40	3.14	13.23	0.24	3.89	26.99
T3-24-C1	10.39	0.97	0.022	1	2	0.15	0.20	0.35	0.29	1.99	0.15	3.98	3.37
T3-24-C2	8.72	2.90	0.022	3	2	0.15	0.20	0.35	0.69	3.99	0.17	4.23	7.74
T3-24-C3	11.73	1.27	0.022	1.5	2	0.15	0.16	0.31	0.30	2.29	0.13	4.04	3.97
T3-25-C1	3.86	3.13	0.022	3.5	2	0.15	0.25	0.40	1.02	4.73	0.22	3.26	7.51
T3-25-C2	3.28	4.83	0.022	6	2	0.15	0.25	0.40	1.64	7.23	0.23	2.93	10.71

T3-25-C3	3.92	0.88	0.022	1	2	0.15	0.25	0.40	0.39	2.23	0.18	2.84	2.78
T3-25-C4	5.84	12.26	0.022	14	2	0.15	0.25	0.40	3.64	15.25	0.24	3.50	28.09
T3-26-C1	3.98	6.09	0.022	6.6	2	0.15	0.25	0.40	1.79	7.85	0.23	3.40	13.55
T3-26-C2	6.06	2.25	0.022	2	2	0.15	0.25	0.40	0.64	3.25	0.20	3.78	5.70
T3-28-C1	4.61	0.49	0.022	0.5	2	0.15	0.25	0.40	0.27	1.75	0.15	2.91	2.13
T3-29-C1	10.18	1.60	0.022	1	2	0.15	0.20	0.35	0.29	2.00	0.15	3.98	3.39
T3-30-C1	3.31	0.92	0.022	1.5	2	0.15	0.25	0.40	0.52	2.75	0.19	2.59	3.22

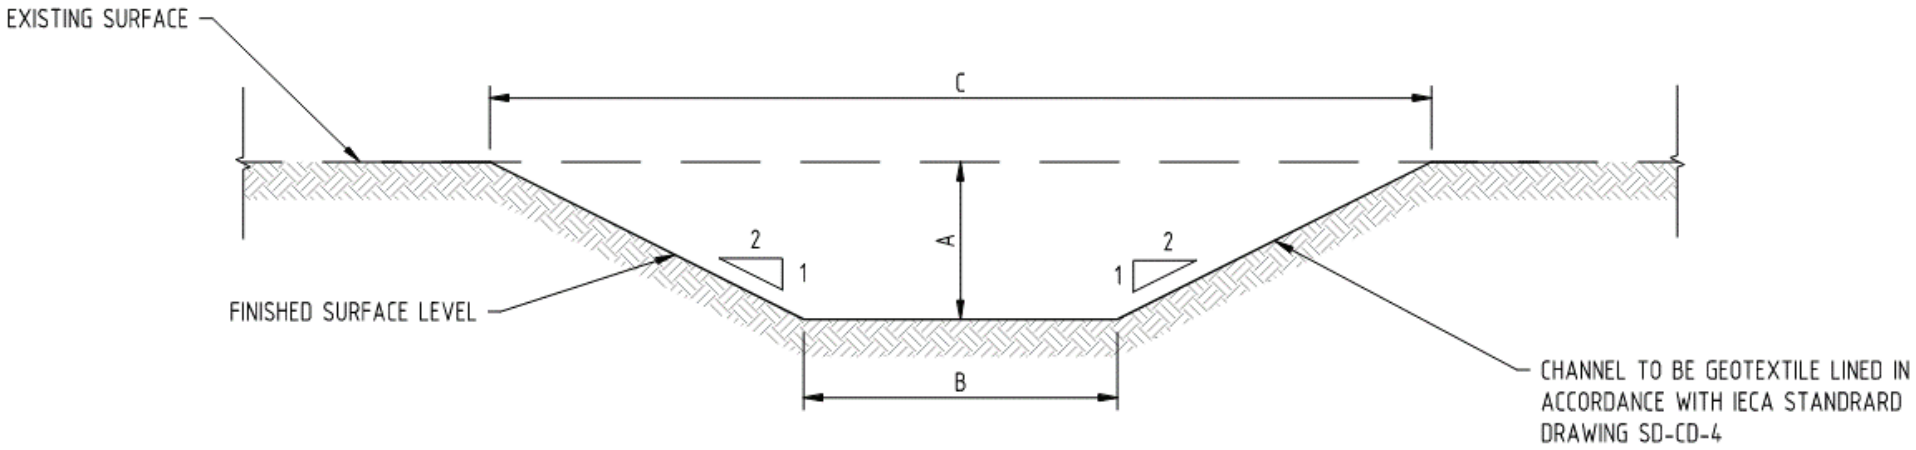

Figure 5 – Typical Drainage Channel Detail

5.2 Erosion Control

The following controls have been specified to mitigate the potential for erosion to occur during the clearing phase of Tranche 3.

5.2.1 Cover

Given that disturbance in each catchment will be limited to vegetation clearing and no earthworks are proposed, the introduction of cover by spreading site won mulch over the cleared surface as a primary erosion control is considered advantageous. The application of cover as part of clearing works will significantly reduce the potential for soil loss within each catchment. A revised RUSLE calculation has been undertaken to take into effect the application of site won mulch cover. Achieving a minimum mulch-cover of 80% of the disturbed surface will lower the C value from 1 to 0.2 (IECA Table E8) and the P value from 1.3 to 0.9 (IECA Section E3.6 Table 11). A reduction in the P value from 1.3 to 0.9 requires track rolling of the catchment area up and down the slope after clearing works are complete. **Figure 6** gives guidance as to the visualisation of 80% mulch cover. The revised RUSLE calculation was made based on the assumption of track rolling up and down slope, and 80% mulch cover achieved immediately after clearing and is presented below in **Table 10**.

Table 10 – Sediment Loss Risk Assessment for Tranche 3 Clearing (with 80% Mulch Cover)

Catchment ID	Area (ha)	R	K	LS	P	C	A (t/ha/yr)	A (t/yr)	Control
T3-1	5.042	2370.1	0.03	4.33	0.9	0.2	55.4	279.4	TYPE 3
T3-2	1.36	2370.1	0.03	4.16	0.9	0.2	53.2	72.3	TYPE 3
T3-3	2.385	2370.1	0.03	4.61	0.9	0.2	59.0	140.7	TYPE 3
T3-4	4.781	2370.1	0.03	5.42	0.9	0.2	69.4	331.6	TYPE 3
T3-5	6.039	2370.1	0.03	2.82	0.9	0.2	36.1	218.0	TYPE 3
T3-6	2.428	2370.1	0.03	3.26	0.9	0.2	41.7	101.1	TYPE 3
T3-7	3.292	2370.1	0.03	4.02	0.9	0.2	51.5	169.4	TYPE 3
T3-8	3.35	2370.1	0.03	5.02	0.9	0.2	64.2	215.2	TYPE 3
T3-9	7.962	2370.1	0.03	4.33	0.9	0.2	55.4	441.2	TYPE 3
T3-10	5.83	2370.1	0.03	1.68	0.9	0.2	21.5	125.4	TYPE 3
T3-11	6.307	2370.1	0.03	5.77	0.9	0.2	73.8	465.8	TYPE 3
T3-12	1.923	2370.1	0.03	2.05	0.9	0.2	26.2	50.5	TYPE 3
T3-13	7.704	2370.1	0.03	2.82	0.9	0.2	36.1	278.1	TYPE 3
T3-14	8.098	2370.1	0.03	5.42	0.9	0.2	69.4	561.7	TYPE 3
T3-15	14.885	2370.1	0.03	5.77	0.9	0.2	73.8	1099.2	TYPE 3
T3-16	20.25	2370.1	0.03	4.06	0.9	0.2	52.0	1052.2	TYPE 3
T3-17	8.867	2370.1	0.03	2.37	0.9	0.2	30.3	269.0	TYPE 3
T3-18	42.923	2370.1	0.03	3.12	0.9	0.2	39.9	1714.0	TYPE 3
T3-19	14.762	2370.1	0.03	2.61	0.9	0.2	33.3	492.2	TYPE 3
T3-20	12.432	2370.1	0.03	1.70	0.9	0.2	21.8	270.5	TYPE 3
T3-21	22.468	2370.1	0.03	4.92	0.9	0.2	62.9	1413.3	TYPE 3
T3-22	5.281	2370.1	0.03	1.03	0.9	0.2	13.2	69.6	TYPE 3
T3-23(i)	19.45	2370.1	0.03	2.61	0.9	0.2	33.3	648.5	TYPE 3
T3-23(ii)	5.833	2370.1	0.03	1.35	0.9	0.2	17.3	100.8	TYPE 3
T3-24	11.221	2370.1	0.03	3.57	0.9	0.2	45.6	512.0	TYPE 3
T3-25	13.994	2370.1	0.03	1.70	0.9	0.2	21.8	304.5	TYPE 3
T3-26	5.262	2370.1	0.03	1.68	0.9	0.2	21.5	113.1	TYPE 3
T3-27	1.102	2370.1	0.03	1.19	0.9	0.2	15.2	16.8	TYPE 3
T3-28	2.642	2370.1	0.03	1.19	0.9	0.2	15.2	40.2	TYPE 3
T3-29	4.402	2370.1	0.03	5.42	0.9	0.2	69.4	305.4	TYPE 3
T3-30	7.603	2370.1	0.03	1.19	0.9	0.2	15.2	115.8	TYPE 3
T3-31	0.402	2370.1	0.03	5.42	0.9	0.2	69.4	27.9	TYPE 3

Risk assessment as per IECA Best Practice Erosion and Sediment Control 2008, Appendix E

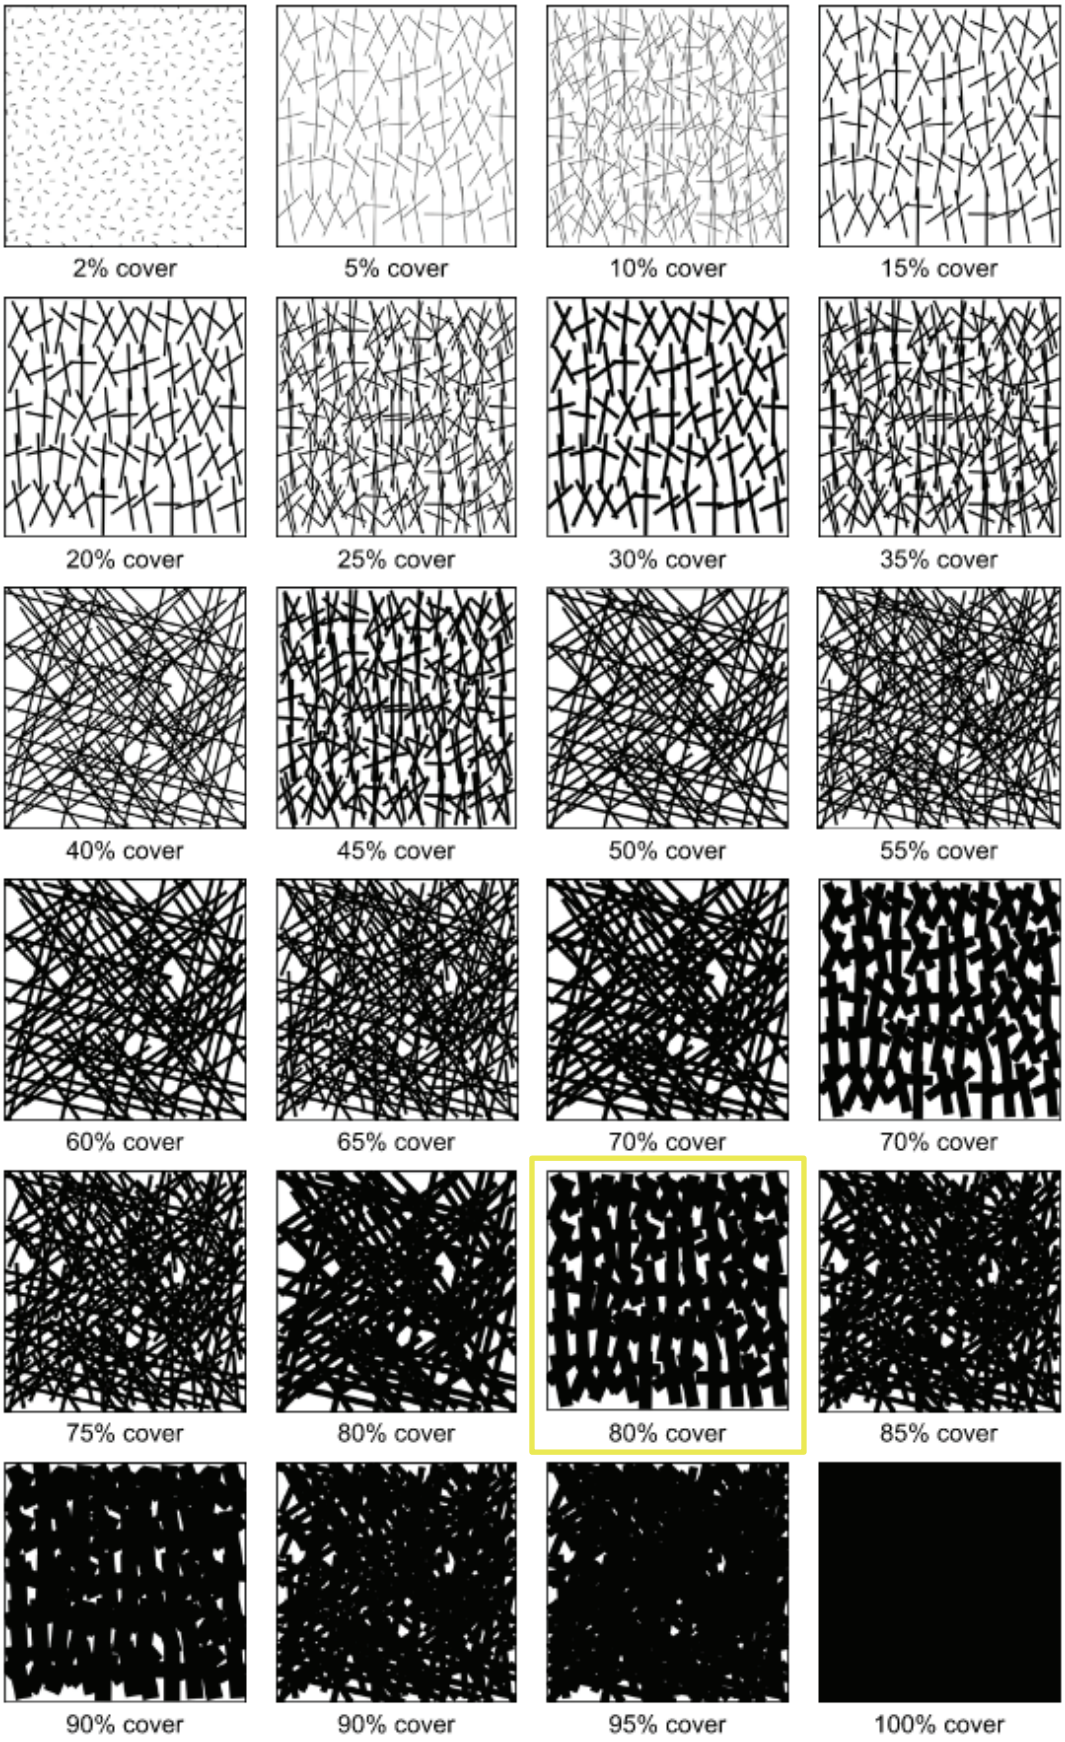

Figure 6 – Visual Cover Estimation Template (adopted from IECA Revegetation Erosion Control Technique V1 (January 2010))

5.2.2 Limitations of Exposed Surface

To further minimise the possibility of erosion occurring during the clearing process, the length of exposed slope shall be limited via the use of a staged clearing method (**Figure 7**). Table 4.5.4 of the Queensland Urban Drainage Manual (2017) suggests that sheet flow over steep (>10%) grassland will channelise in an assumed maximum flow length of 20m, hence the specification of 20m clearing strips parallel with the contour of the land.

The 20m strips must be cleared along the contour and immediately covered with the mulch product of the vegetation to 80% cover (**Figure 6**) prior to clearing the next 20m strip and before any forecasted rain event.

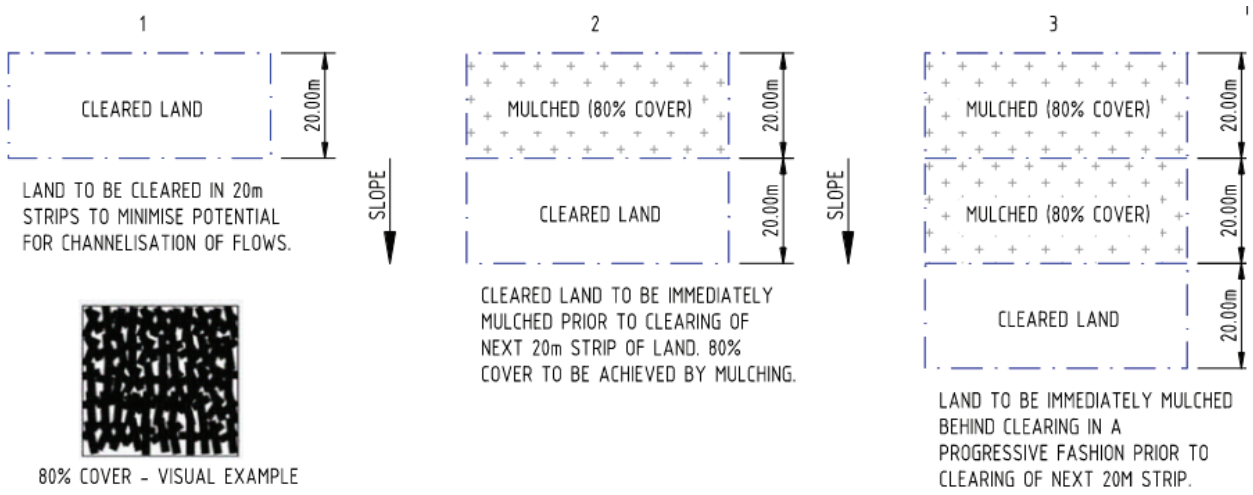

Figure 7 – Clearing Progression Detail

5.3 Sediment Controls

A number of sediment controls have been specified for inclusion within the cleared catchment areas. The subsequent sections of the report provide details on the following sediment controls which are specified for the clearing phase of Tranche 3:

- Rock Check Dams;
- Sediment Fence;
- Rock Filter Dams;
- Sediment Basins;
- Sediment Basin Flocculation; and
- Sediment Basin Diversion Drains.

5.3.1 Rock Check Dams

Rock check dams shall be placed within channels in accordance with the ADG drawings shown in **Appendix A** of this report to provide velocity control and pond water within the drains to allow coarse sediment to drop out through gravity induced settlement. The check dams should be shaped to provide a flat crest within the centre of the drain and the crest shall be lower than the rock on the sides of the drain as per IECA standard drawing RCD-01.

5.3.2 Sediment Fence

Sediment fence should be used to trap and pond sediment laden water to allow sediment to drop out through gravity induced settlement. Returns should be placed along the fence to aid in ponding water. The toe of the fence shall be dug into the existing soil. Further information regarding sediment fences and their specific locations are shown in the ADG Erosion and Sediment Control Plans (**Appendix A**) and IECA Standard Drawing FF-01 (**Appendix B**).

5.3.3 Rock Filter Dams

As shown on ADG drawings in **Appendix A**, Rock Filter Dams are to be constructed to capture the potential sediment laden, channelized water flowing from the catchment. The Rock Filter Dams are to be constructed in accordance with the ADG drawings in **Appendix A** and IECA Standard Drawings SD-RFD-03 and SD-RFD-04 found in **Appendix B**.

Due to the potential for the Rock Filter Dams to become blocked with sediment, causing a lack of functionality, it is imperative that the Rock Filter Dams be maintained in accordance with **Section 6** of this report.

6 OPERATION, MAINTENANCE & MONITORING

6.1 Water Quality Objectives

Table B40 of IECA 2018, Best Practice Erosion and Sediment Control Appendix B recommends all releases of stormwater captured onsite must not exceed the following limits:

- 50mg/L as a maximum concentration.
- PH value must be in the range 6.5 to 8.5.

IECA 2018, Best Practice Erosion and Sediment Control Appendix B also states that a site-specific calibration of the relationship between the suspended solids concentrations (mg/L) and Nephelometric Turbidity Units (NTU) readings can be established once sufficient laboratory testing has been completed (minimum of 5 water samples between 20 mg/L and 150mg/L). This allows the use of Turbidity Meters to determine when the water quality is likely to have reached the equivalent of 50mg/L.

6.2 Erosion and Sediment Control Devices

The maintenance of sediment and erosion control devices other than a sediment basin shall be carried out in accordance with **Table 11**.

Table 11 - ESC Maintenance Schedule

ESC Measure	Maintenance	Maintenance Trigger	Timeframe for Completion of Maintenance
Sediment Fence	Replace or Reinstate	Sediment fence has collapsed / broken / not toed in	Prior to the next storm
	Desilting	The capacity of the sediment fence falls below 70%	Prior to the next storm
	Remove	Once the area upstream has been stabilised	Prior to handover
Rock Check Dams and Filter Dams	Replace or Reinstate	Dam has collapsed /been washed out	Prior to the next storm
	Desilting	The capacity of the dam falls below 70%	Prior to the next storm
	Remove	Once the area upstream has been stabilised, when catch drain is removed / no longer required or when drain is made a permanent drain	Prior to handover
Diversion / Catch Drains	Replace or Reinstate Lining	If lining has been punctured / torn or damaged	Prior to the next storm
	Desilting	When sediment control devices in drain are at 70% capacity	Prior to the next storm
	Remove	Once area upstream has been stabilised and/or a permanent drainage solution has been implemented making the drain redundant	Prior to handover

All ESC measures shall be regularly monitored throughout the construction phase by the site manager/responsible ESC officer. Inspections of ESC devices shall be completed at the following times:

- At least daily when rain is occurring (wet season)
- At least weekly throughout the construction phase (even when works are not progressing on site)
- Within 24 hours prior to expected rainfall
- Within 18 hours of a rainfall event of sufficient intensity and duration to cause on-site runoff.

A monthly inspection and report should be completed by the site manager/responsible ESC officer.

7 CONCLUSION

ADG Engineers (Aust.) Pty Ltd was engaged by Pioneer Fortune Pty Ltd to carry out a Clearing Phase Stormwater Management Plan for a development at Undullah, QLD. The report provides a sediment and erosion control strategy to be implemented throughout the clearing phase of Tranche 3. Erosion and sediment control devices should be implemented and maintained in accordance with the proposed strategy until such time as the cleared surfaces have sufficient ground cover for stabilisation.

Appendix A
ADG Engineers Sediment and Erosion Control Plans

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 2 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION

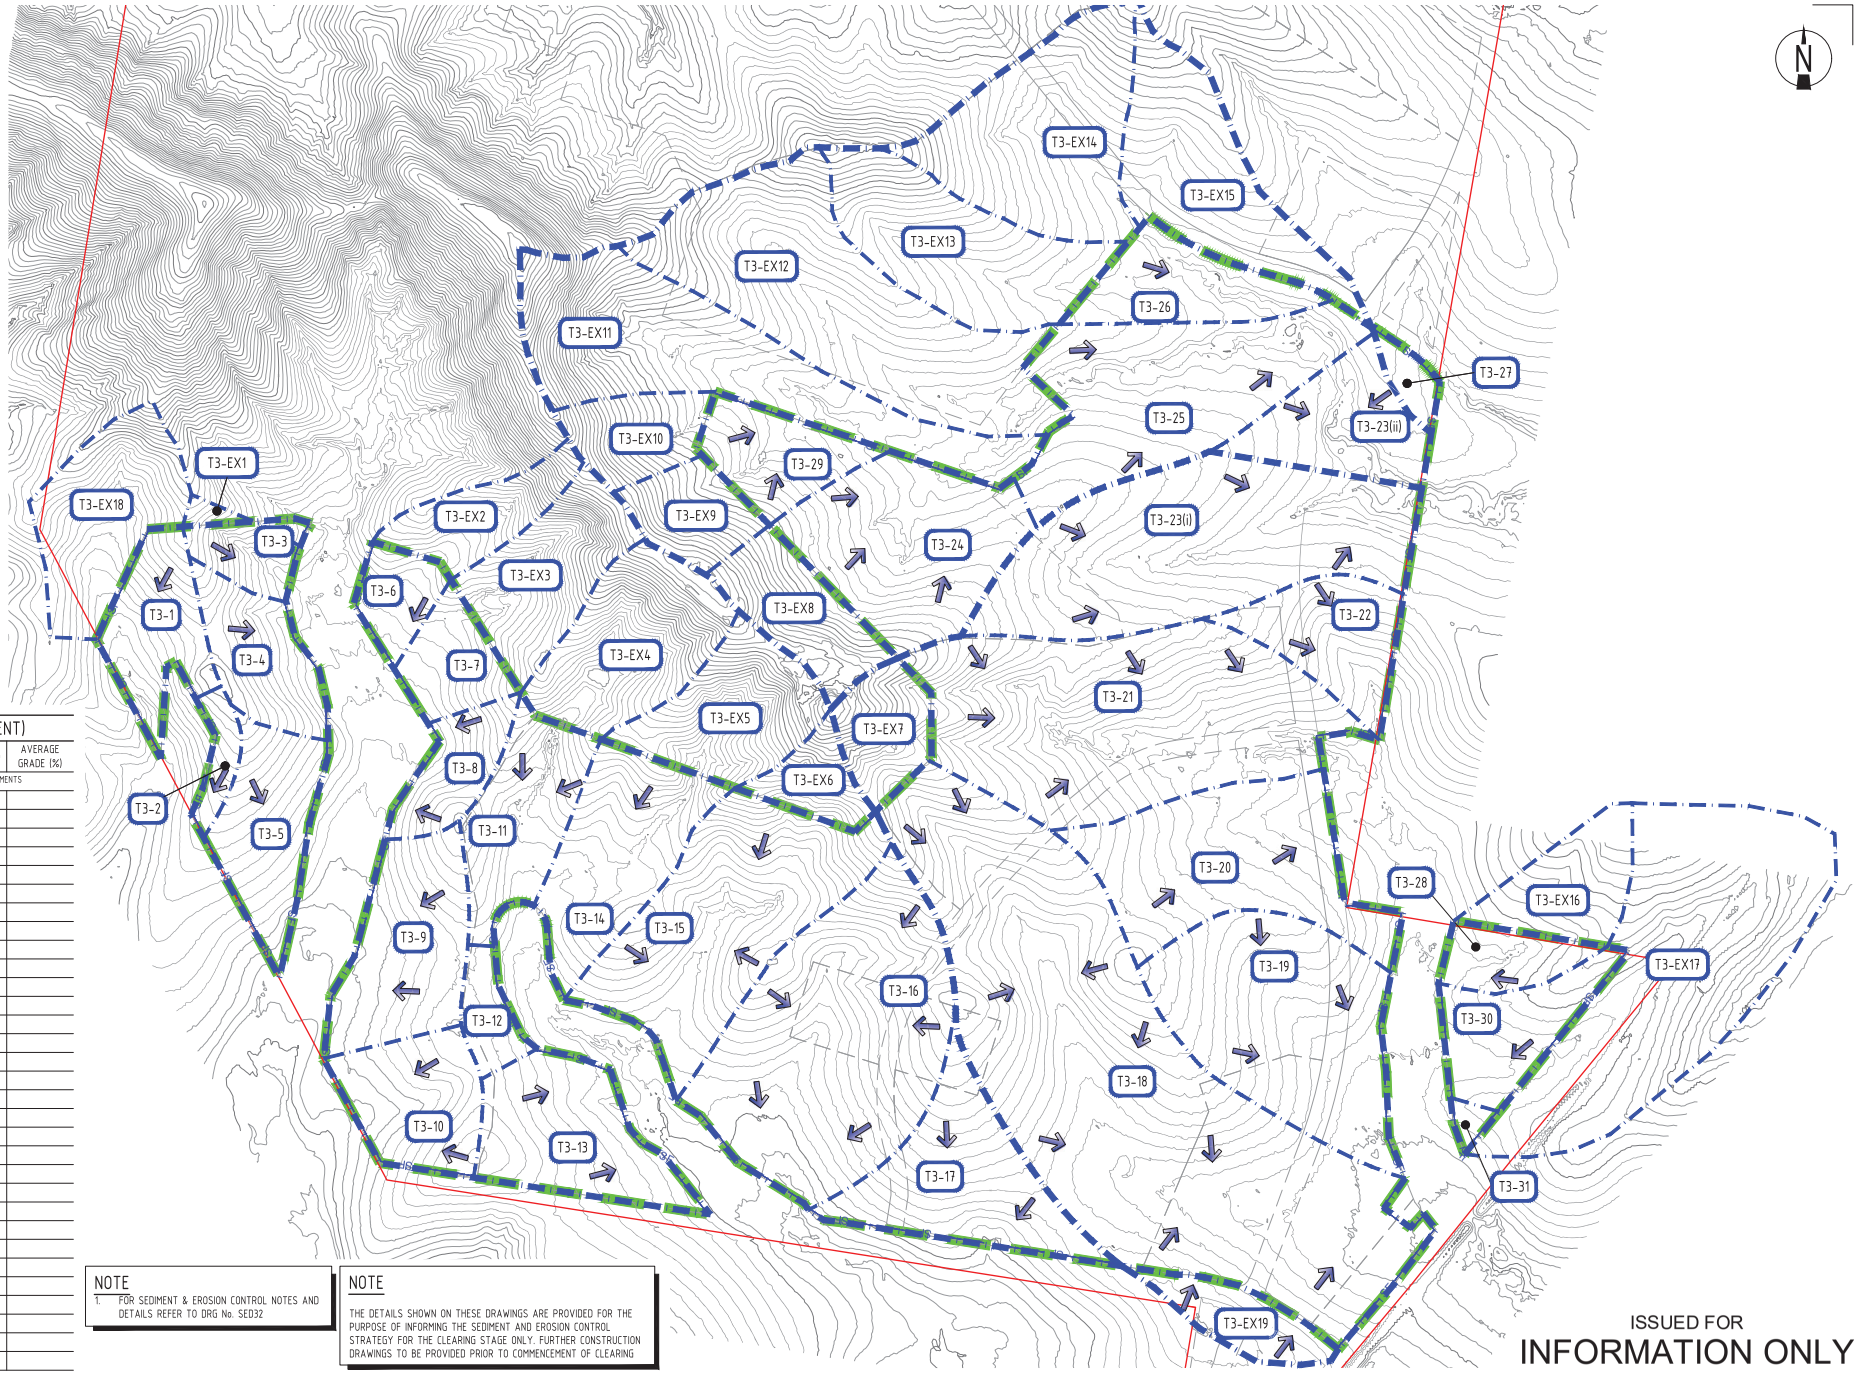

CATCHMENT TABLE (PRE DEVELOPMENT)

CATCHMENT NAME	AREA (ha)	AVERAGE GRADE (%)	CATCHMENT NAME	AREA (ha)	AVERAGE GRADE (%)
INTERNAL CATCHMENTS			EXTERNAL CATCHMENTS		
T3-1	5.042		T3-EX1	0.688	
T3-2	1.361		T3-EX2	3.974	
T3-3	2.385		T3-EX3	6.697	
T3-4	4.781		T3-EX4	8.465	
T3-5	6.039		T3-EX5	6.908	
T3-6	2.428		T3-EX6	2.449	
T3-7	3.292		T3-EX7	3.539	
T3-8	3.350		T3-EX8	4.938	
T3-9	7.962		T3-EX9	3.529	
T3-10	5.826		T3-EX10	3.705	
T3-11	6.307		T3-EX11	14.894	
T3-12	1.923		T3-EX12	18.245	
T3-13	7.704		T3-EX13	10.045	
T3-14	8.098		T3-EX14	12.073	
T3-15	14.885		T3-EX15	9.537	
T3-16	20.250		T3-EX16	3.339	
T3-17	8.867		T3-EX17	20.827	
T3-18	42.932		T3-EX18	7.739	
T3-19	14.762		T3-EX19	3.097	
T3-20	12.432				
T3-21	22.468				
T3-22	5.281				
T3-23 (i)	19.450				
T3-23 (ii)	5.833				
T3-24	11.221				
T3-25	13.994				
T3-26	5.262				
T3-27	1.102				
T3-28	2.642				
T3-29	4.402				
T3-30	5.442				

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED32

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
03	20.12.21	ISSUED FOR INFORMATION	MD	ML
02	15.12.21	ISSUED FOR INFORMATION	MD	ML
01	09.12.21	ISSUED FOR INFORMATION	MD	ML

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:5000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL CATCHMENT PLAN
Drawing No.	SED40
Revision	03

PLOT DATE: 12/21/2021 12:19 AM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED40_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL CATCHMENT PLANLING

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

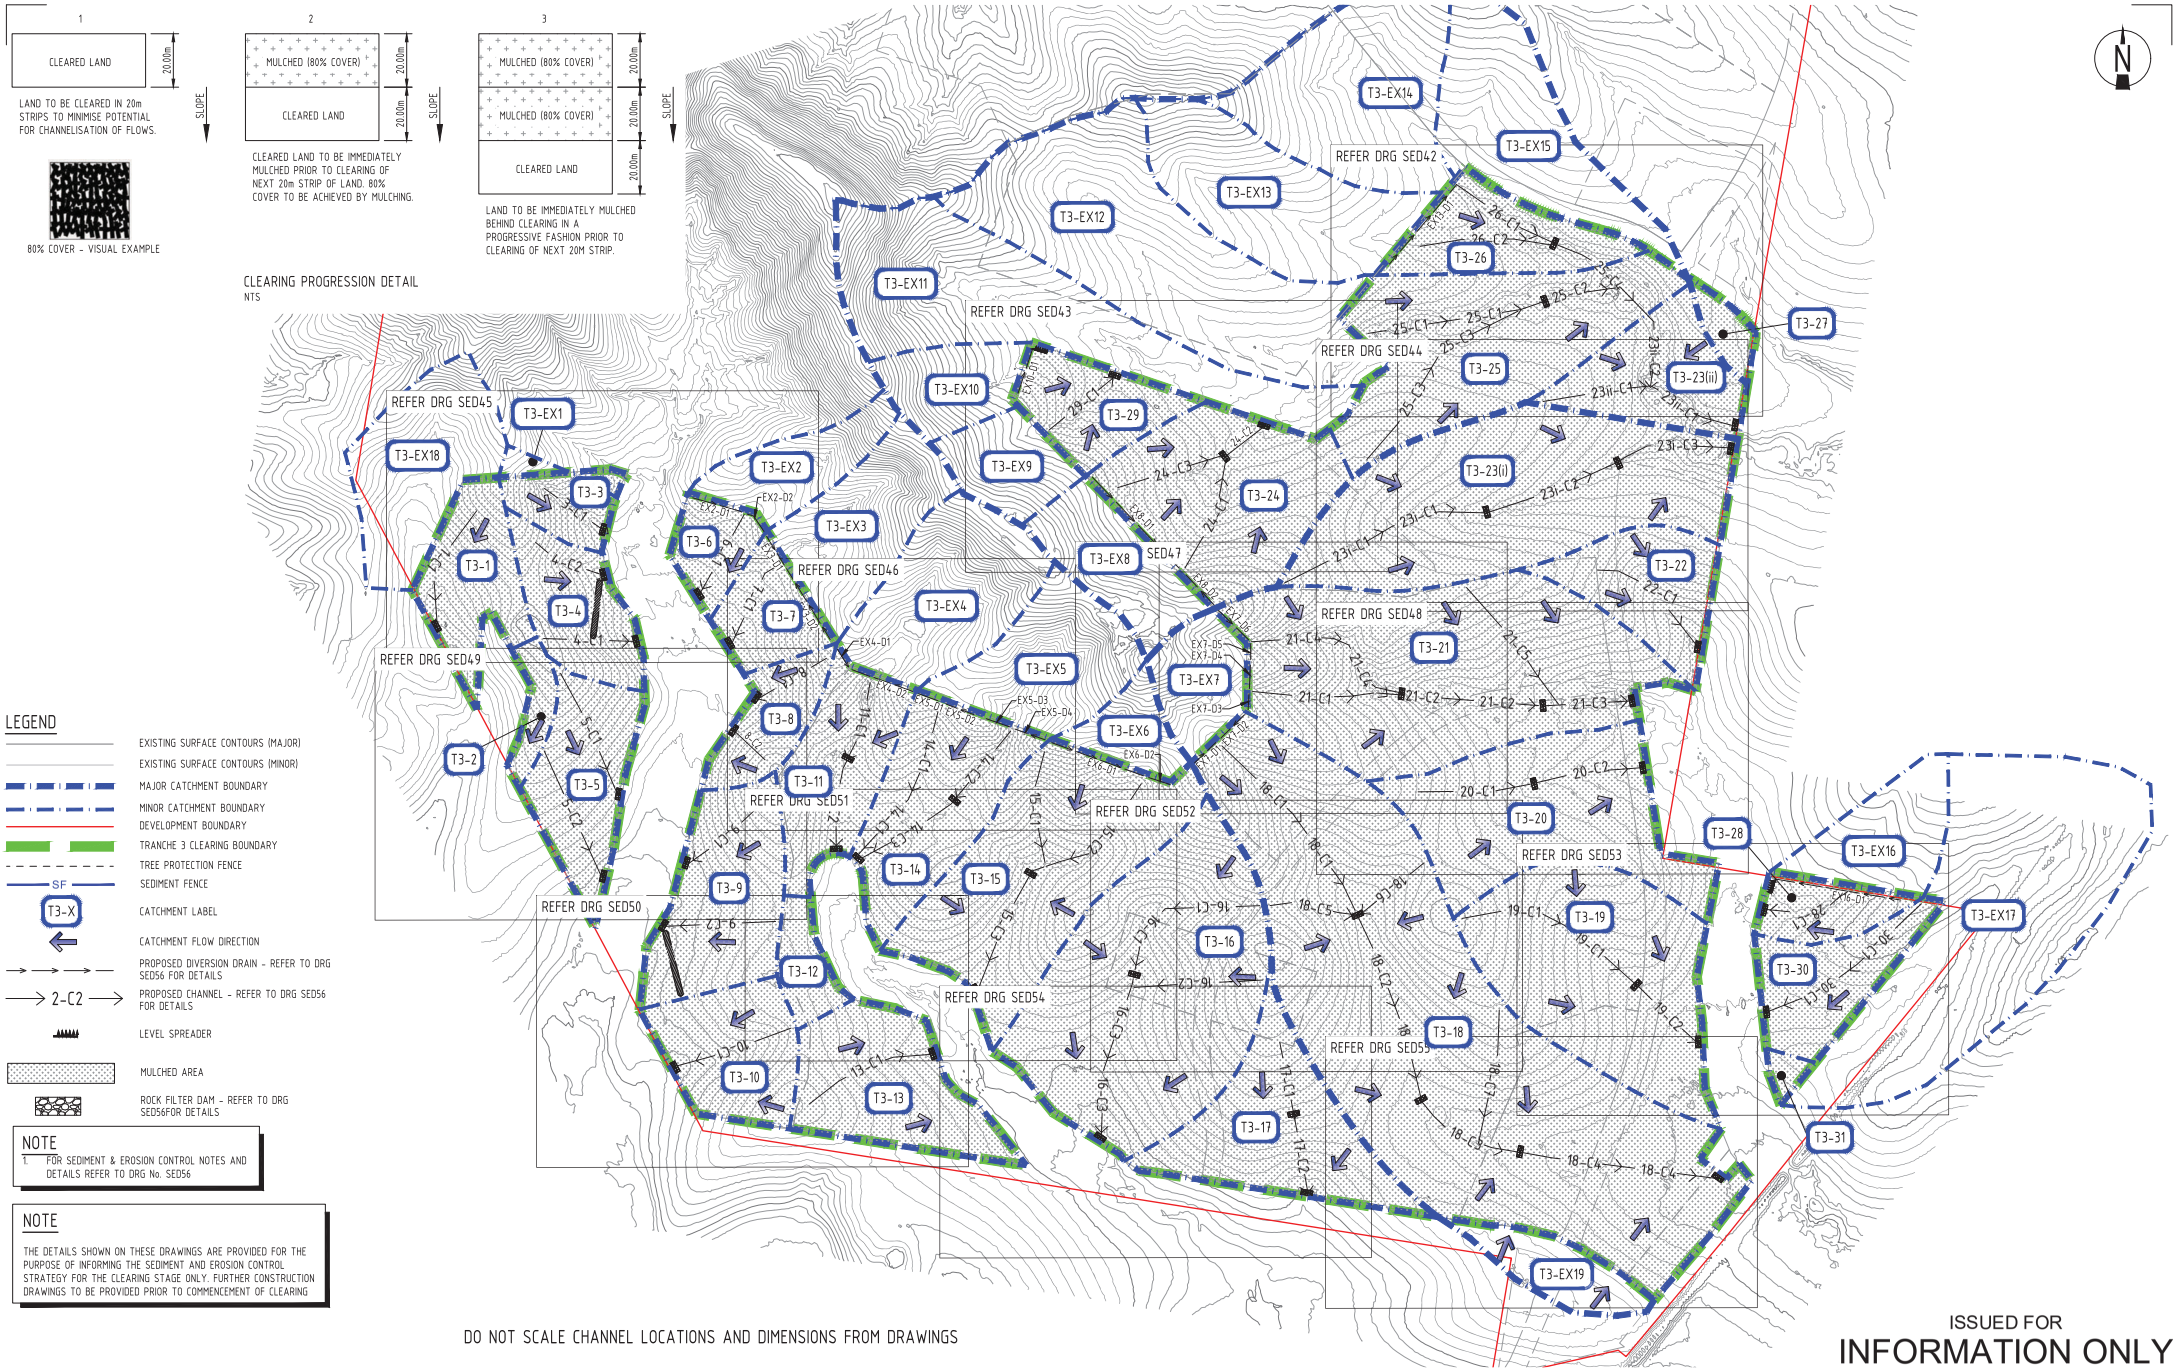

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 2-C2 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

DO NOT SCALE CHANNEL LOCATIONS AND DIMENSIONS FROM DRAWINGS

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:5000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title: TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL CLEARING OVERLAY PLAN

Drawing No. SED41 | Revision 02

PLOT DATE: 12/20/2021 4:52 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED41_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL CLEARING OVERLAY PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

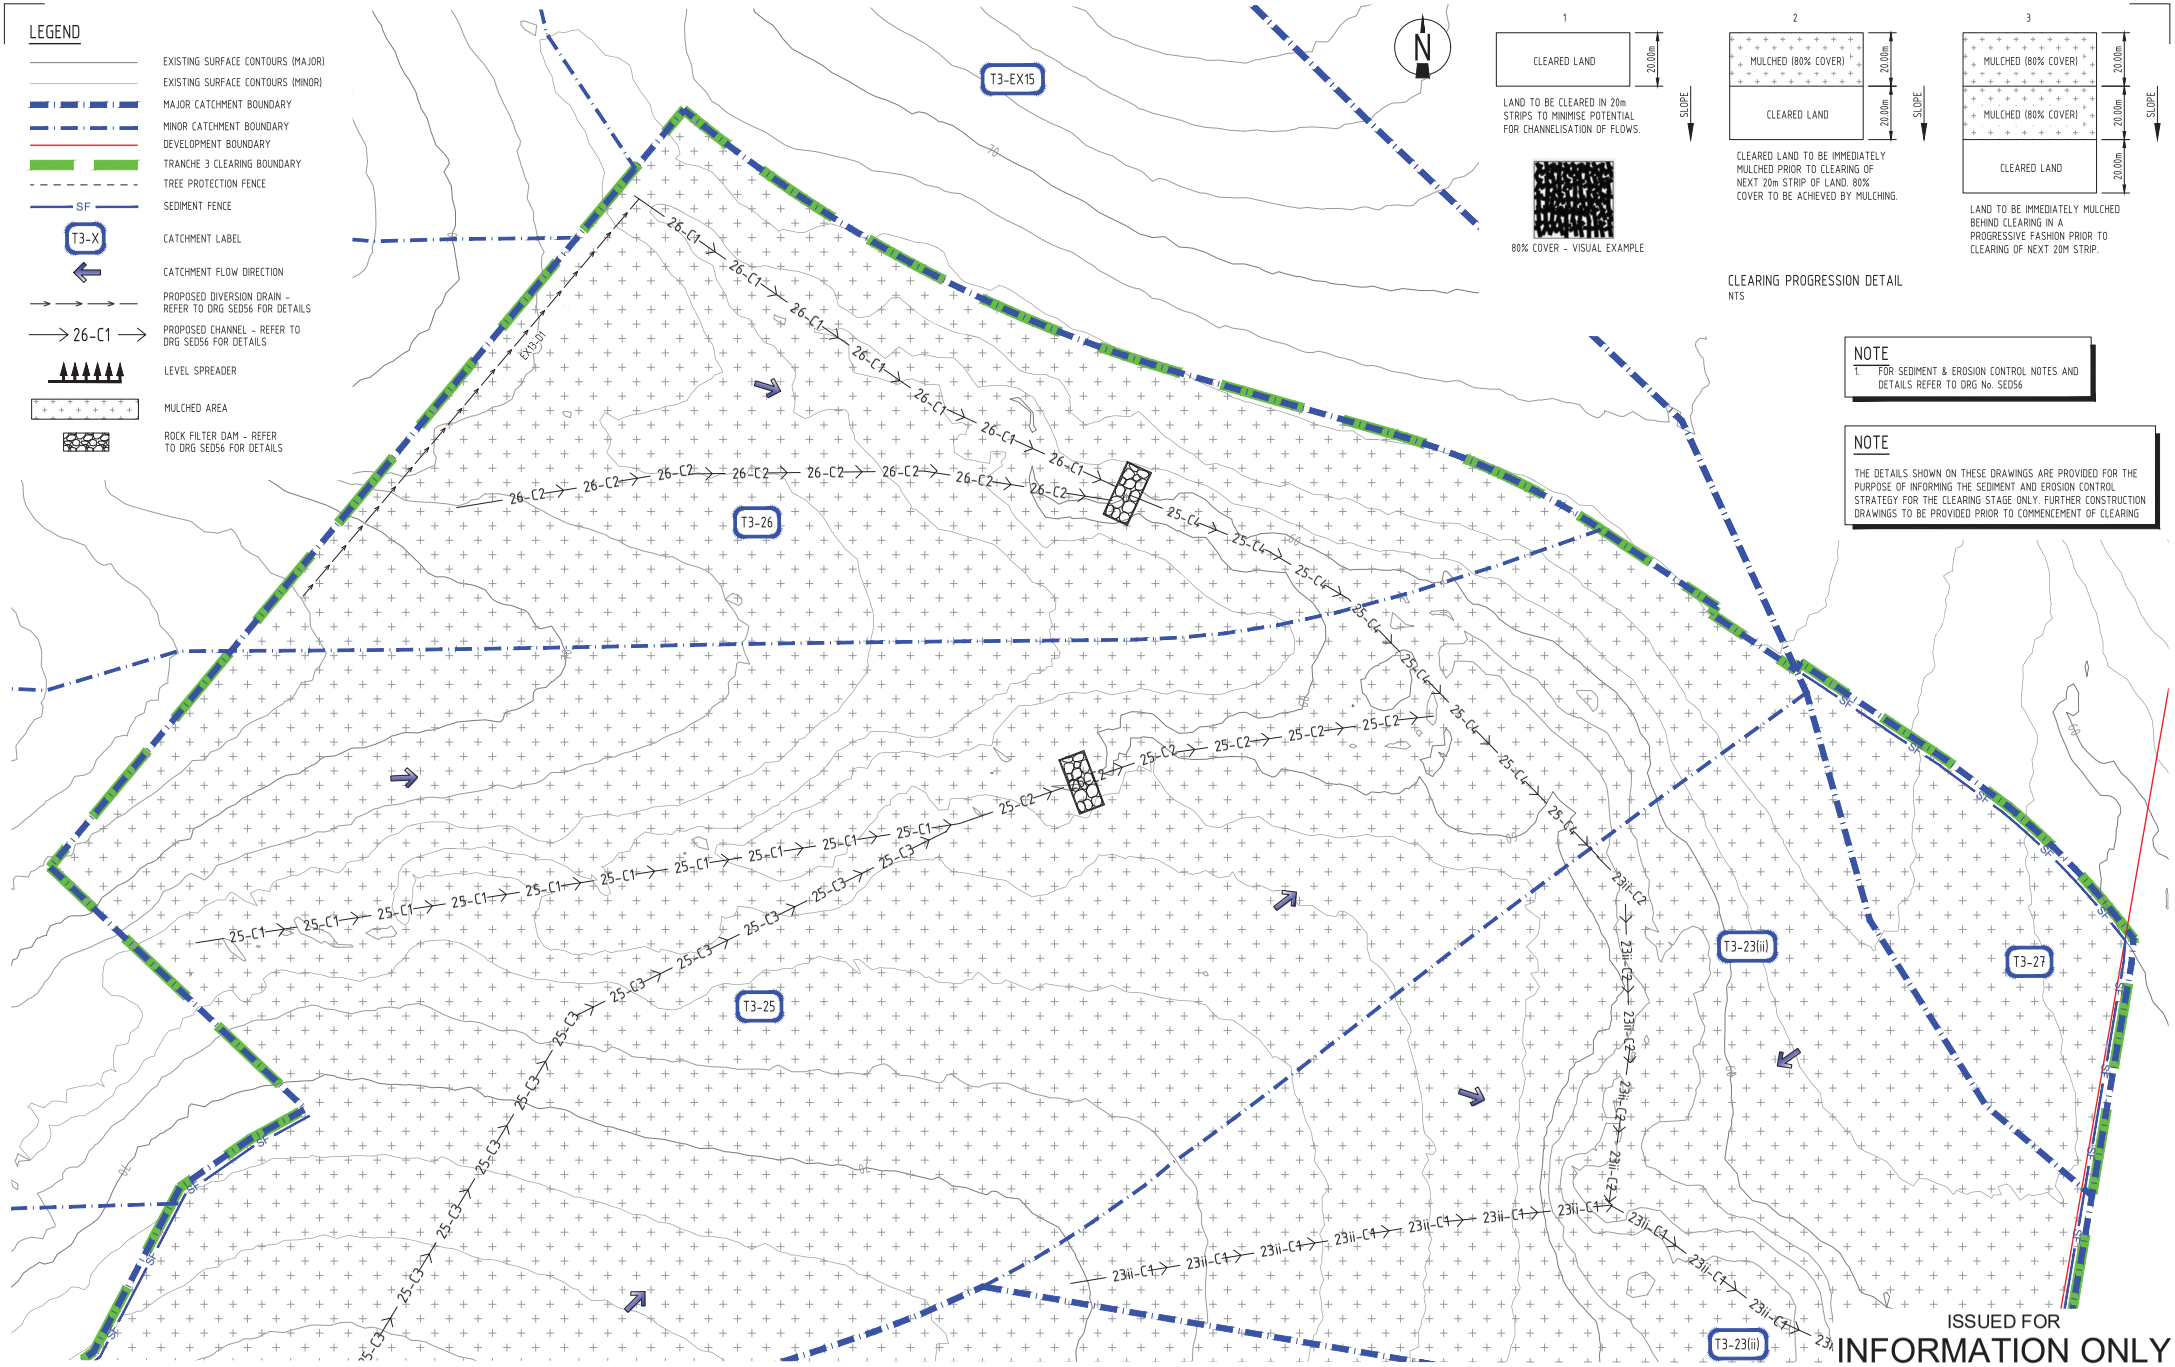

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-23ii T3-25 T3-26 T3-27 CATCHMENT CLEARING PLAN
Drawing No.	SED42
Revision	02

PLOT DATE: 12/20/2021 4:52 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED42_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-23ii T3-25 T3-26 T3-27 CATCHMENT CLEARING PLANDWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

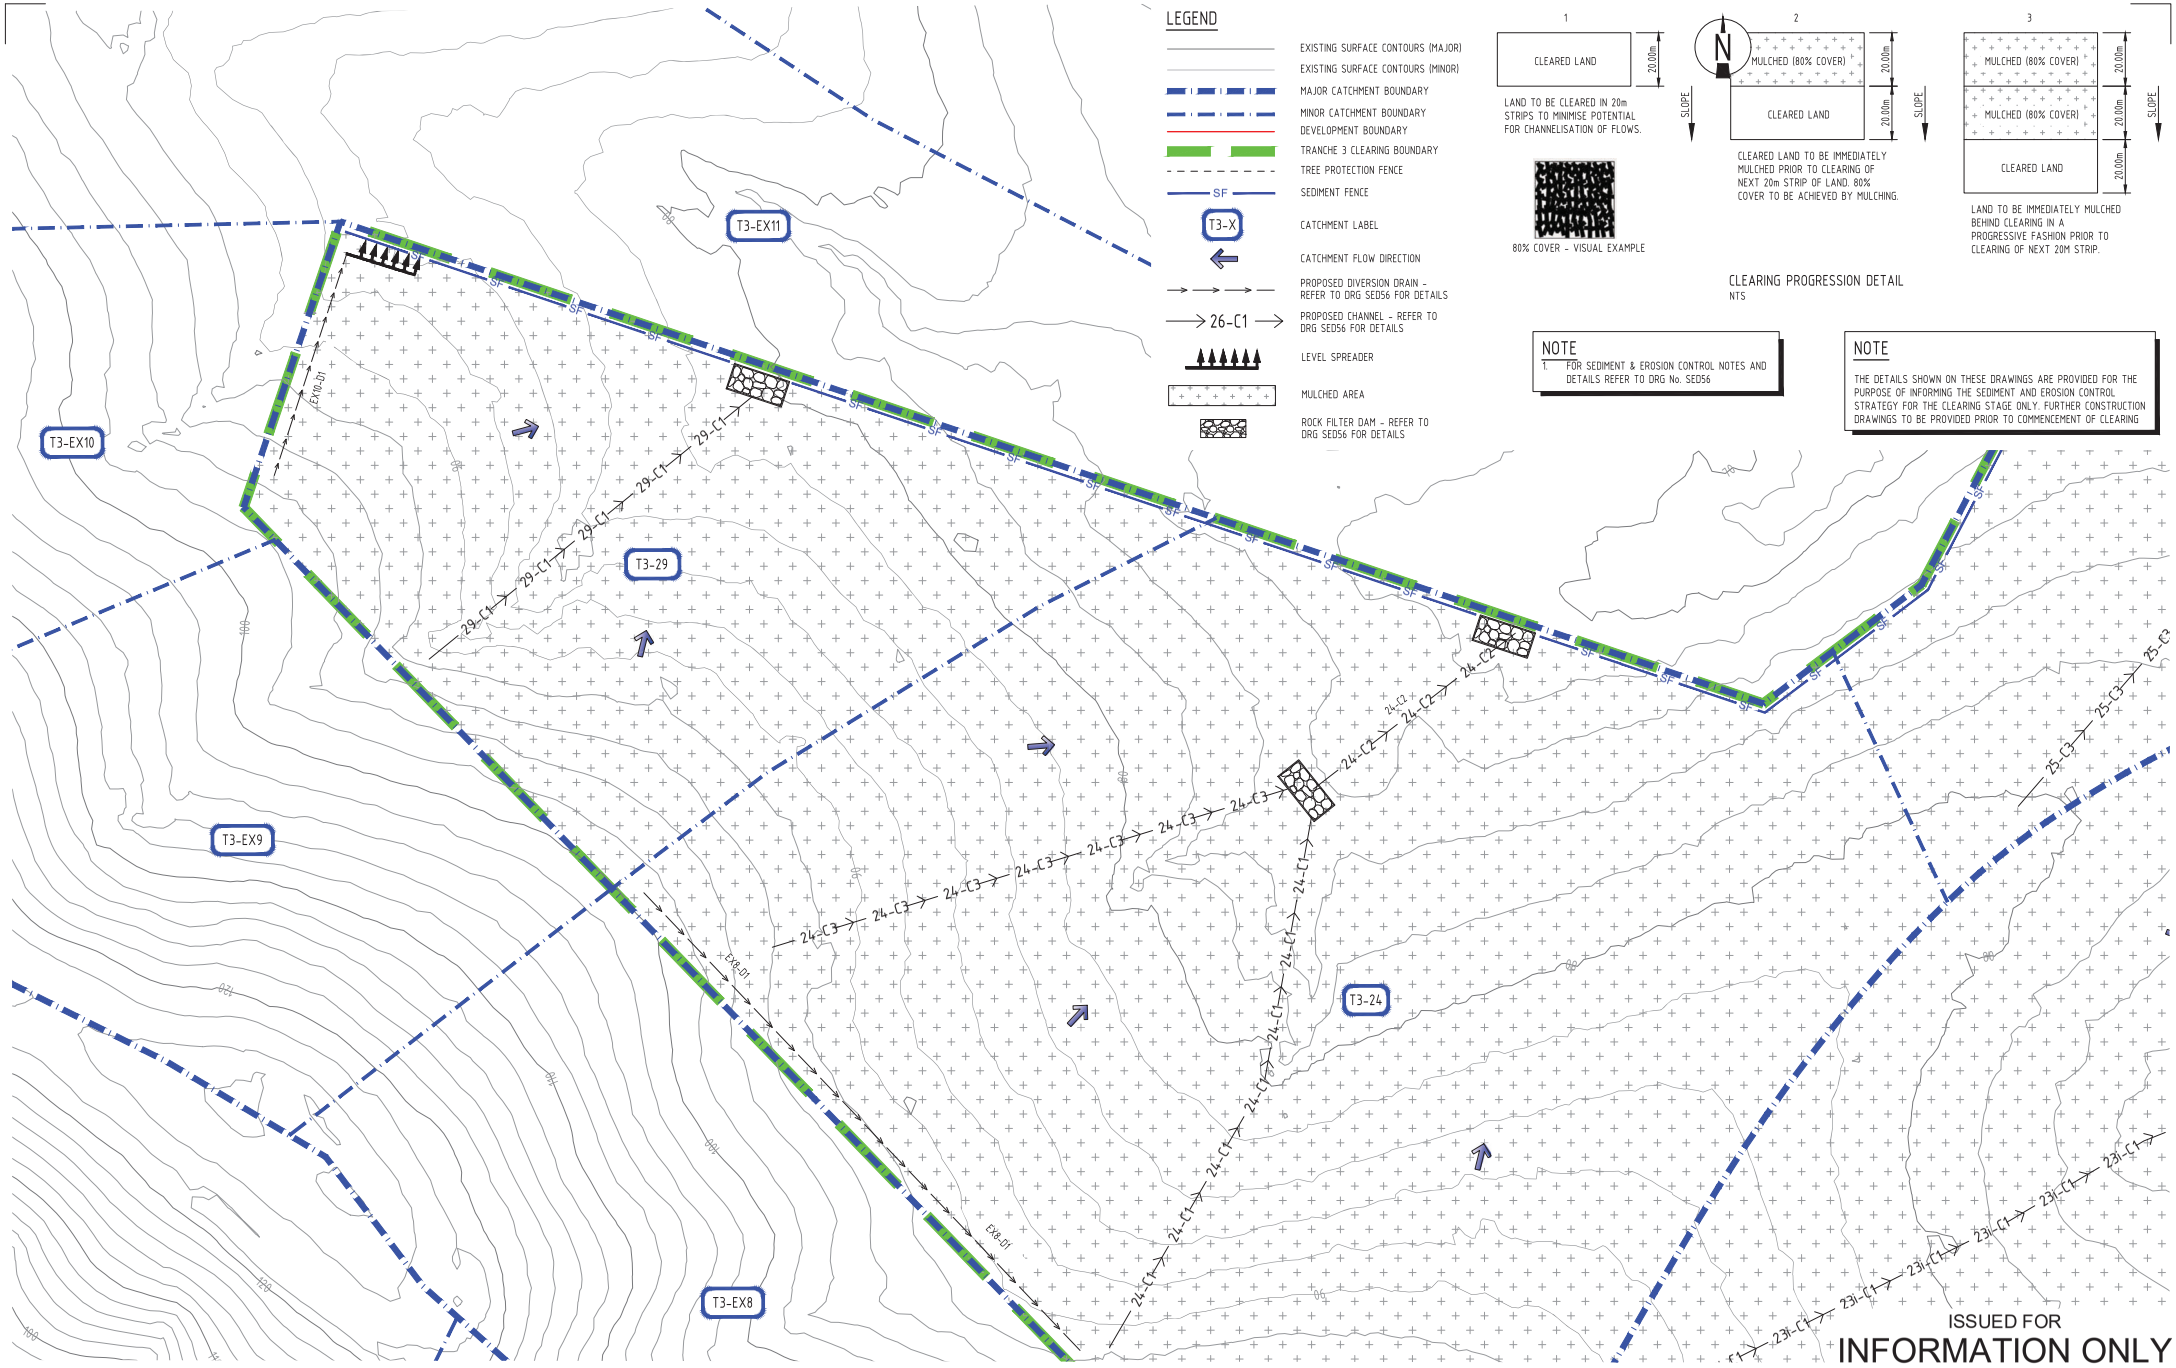

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-24 T3-29 CATCHMENT CLEARING PLAN
Drawing No.	SED43
Revision	02

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

PLOT DATE: 12/20/2021 4:52 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED43_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-24 T3-29 CATCHMENT CLEARING PLAN.DWG

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED32 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

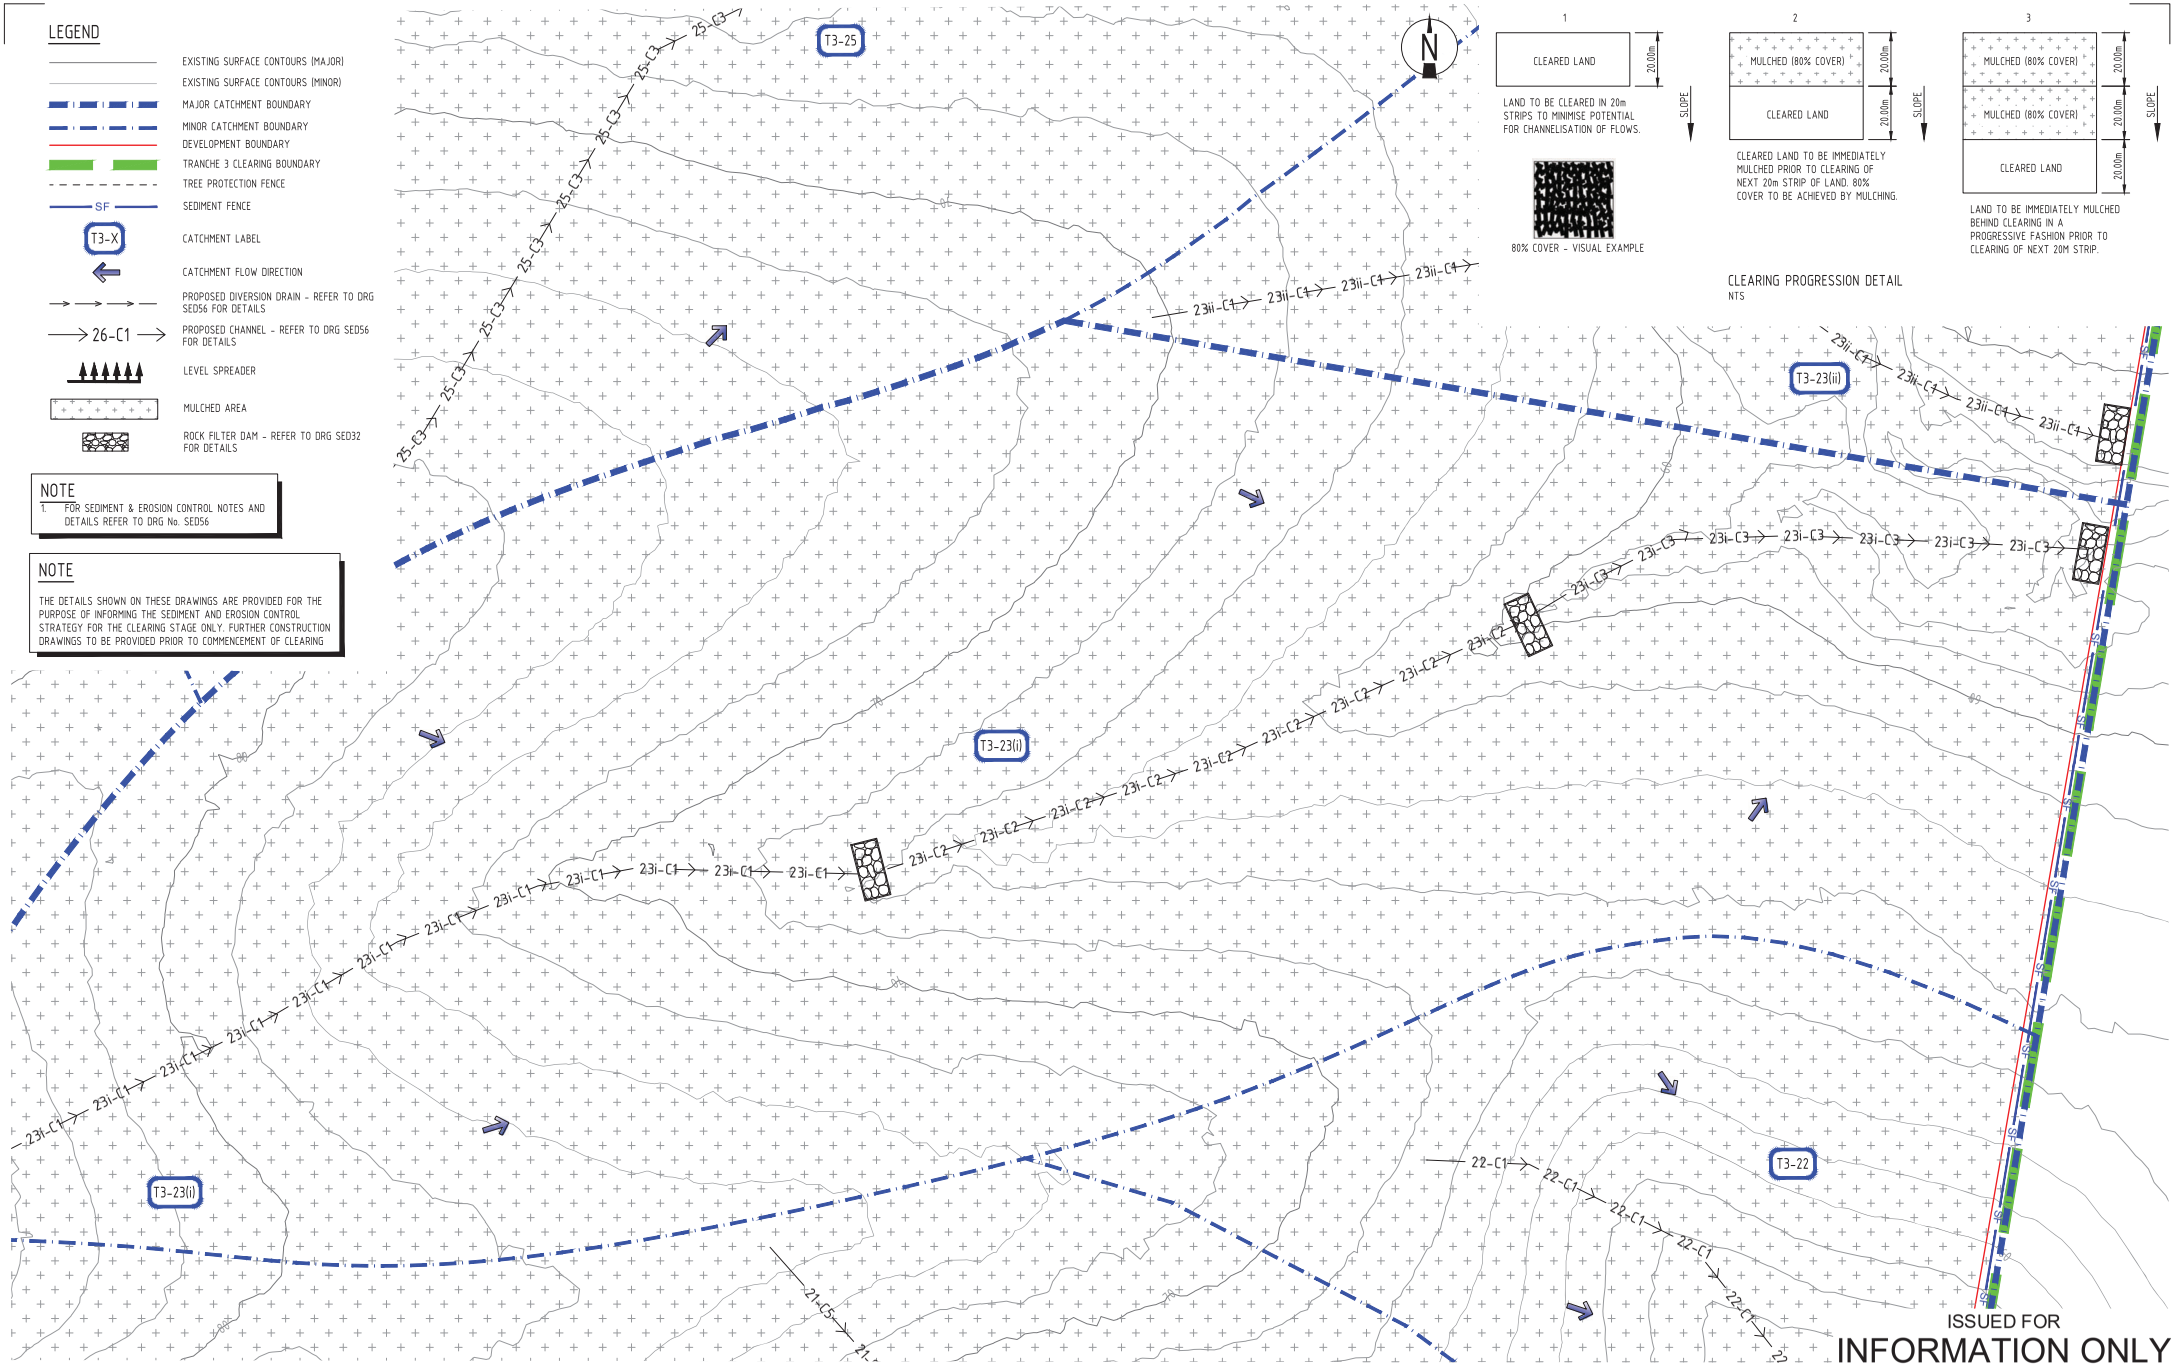

1
CLEARED LAND
20.00m
SLOPE
LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

80% COVER - VISUAL EXAMPLE

2
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3
MULCHED (80% COVER)
20.00m
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

CLEARING PROGRESSION DETAIL
NTS

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-22 T3-23ii T3-25 CATCHMENT CLEARING PLAN
Drawing No.	SED44
Revision	02

PLOT DATE: 12/20/2021 4:52 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED44_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-22 T3-23ii T3-25 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

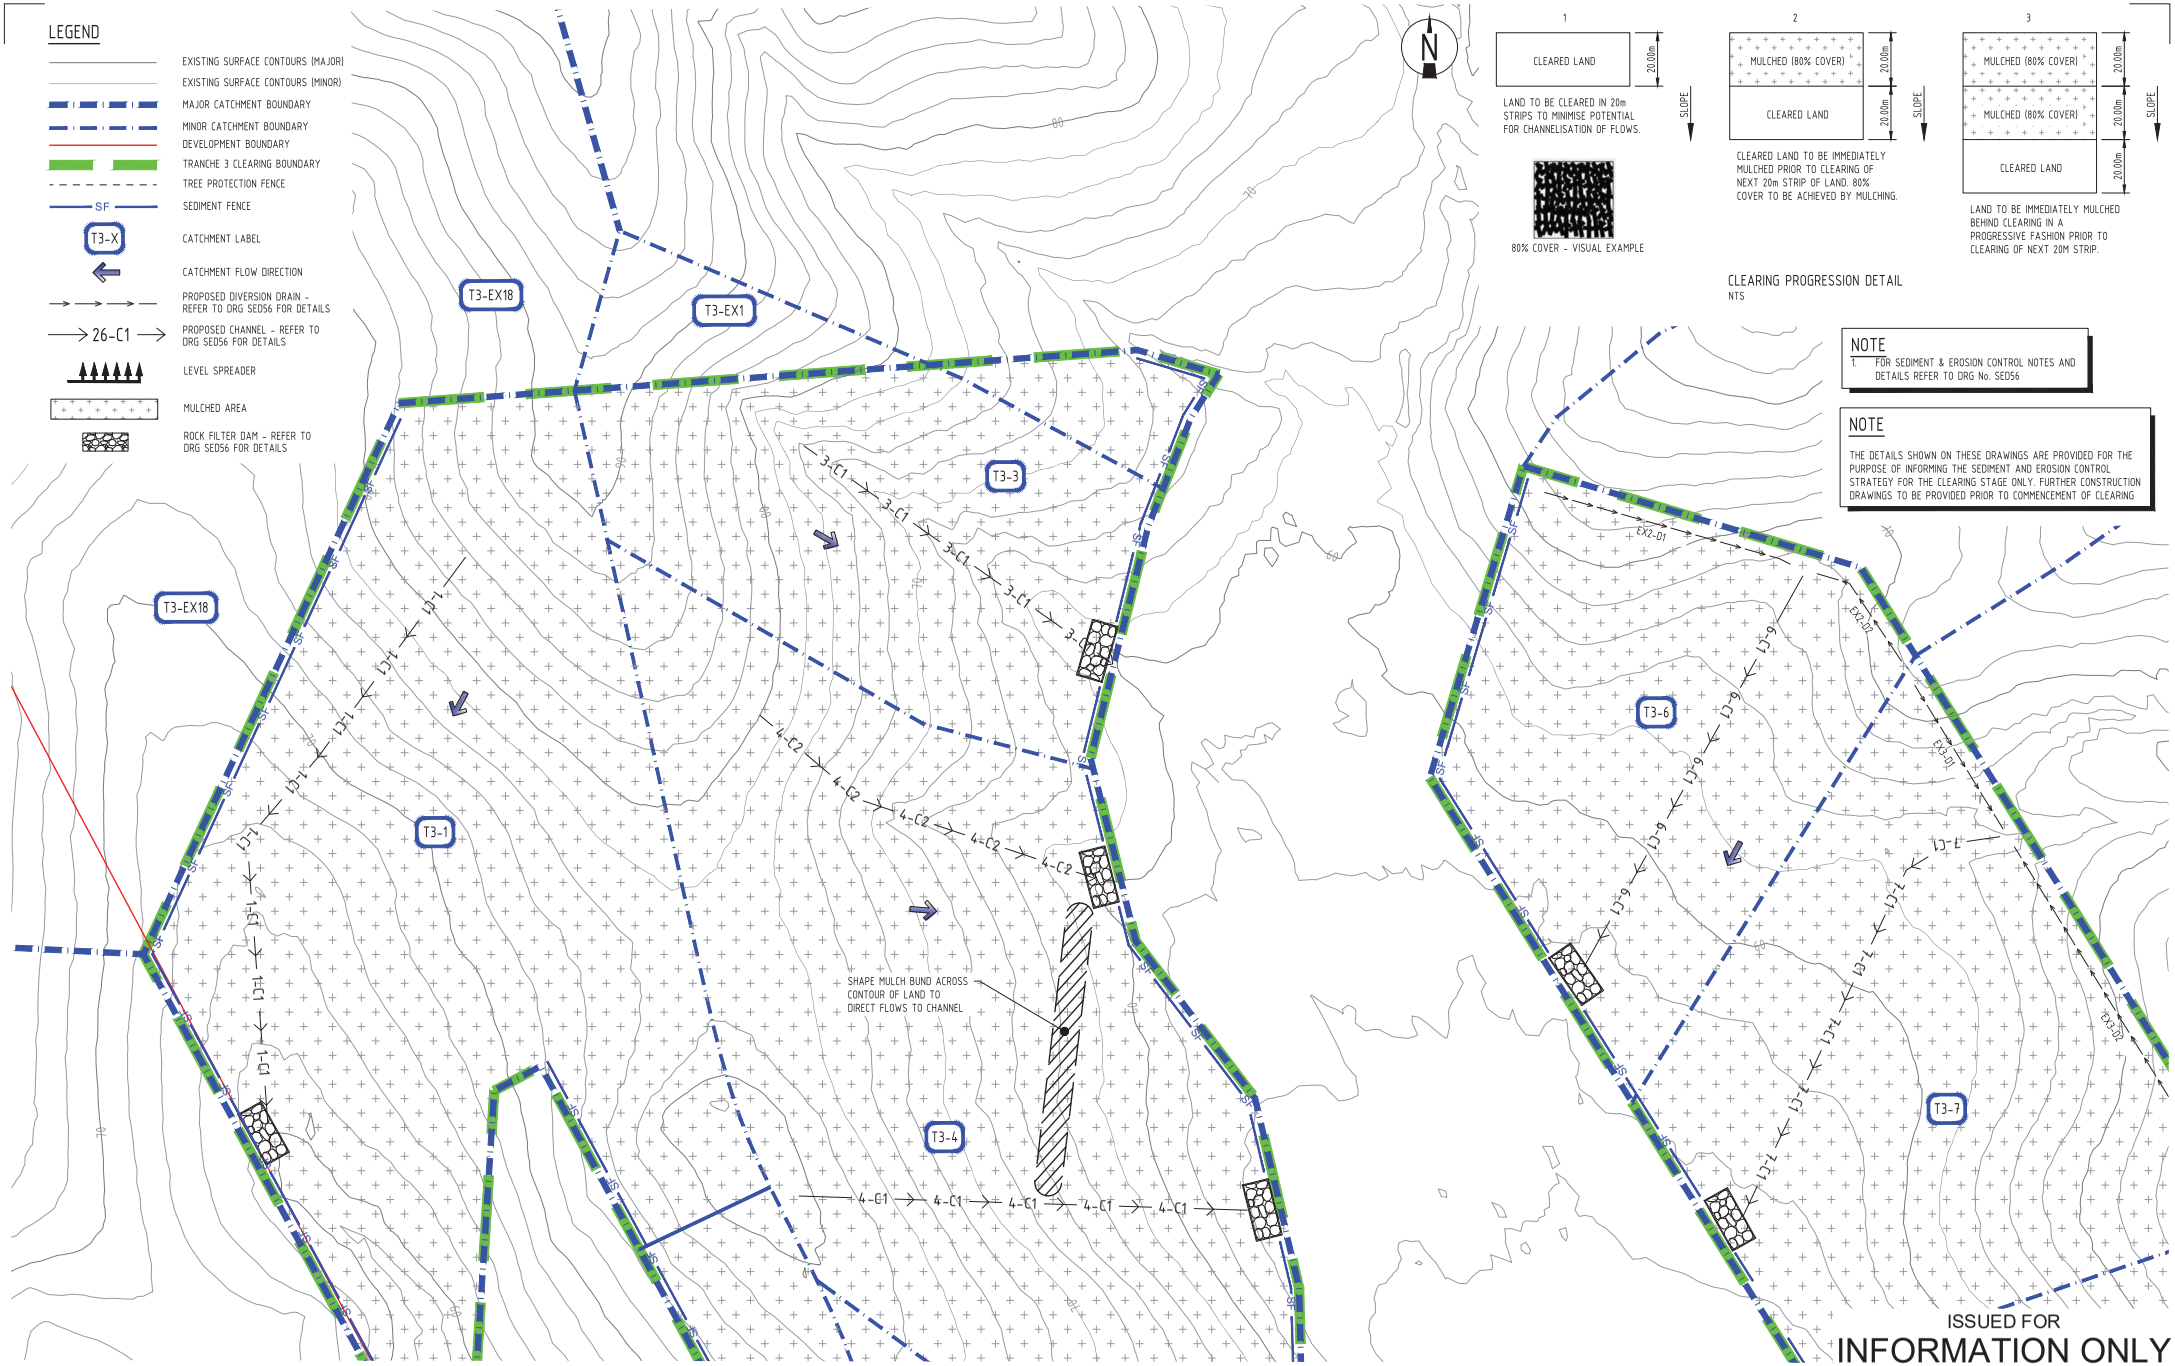

1
CLEARED LAND
20.00m
SLOPE
LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

80% COVER - VISUAL EXAMPLE

2
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3
MULCHED (80% COVER)
20.00m
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

CLEARING PROGRESSION DETAIL
NTS

NOTE
1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE
THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-1 T3-3 T3-4 T3-6 T3-7 CATCHMENT CLEARING PLAN
Drawing No.	SED45
Revision	02

PLOT DATE: 12/20/2021 4:52 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED45_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-1 T3-3 T3-4 T3-6 T3-7 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

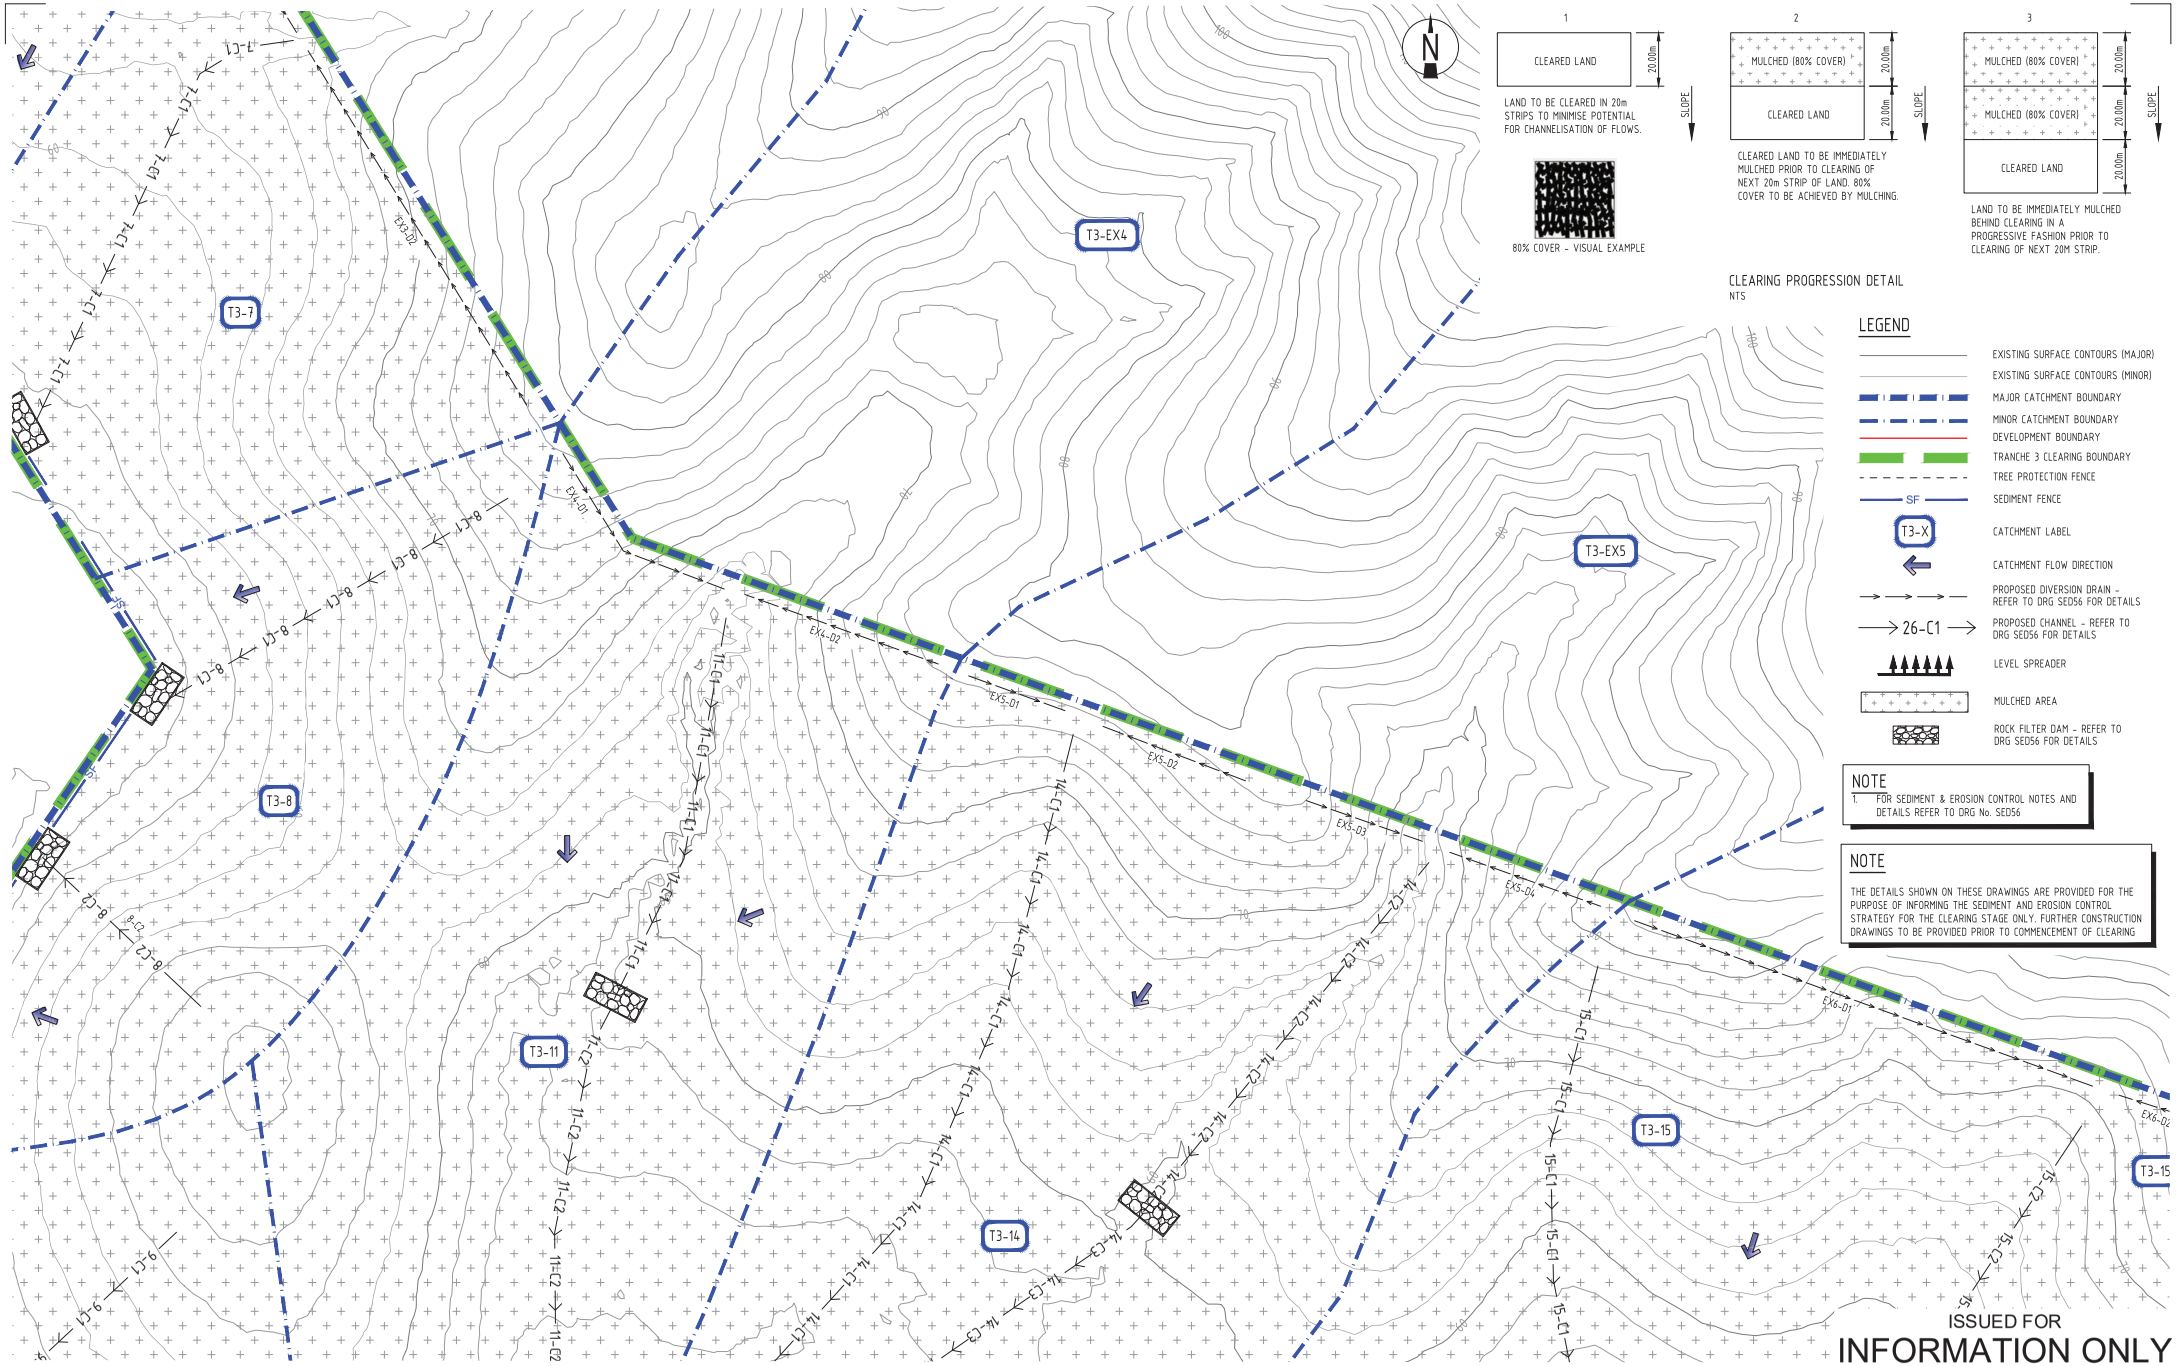

1

LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

80% COVER - VISUAL EXAMPLE

2

CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3

LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

CLEARING PROGRESSION DETAIL

NTS

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-8 T3-11 T3-14 T3-15 CATCHMENT CLEARING PLAN
Drawing No.	SED46
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED46_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-8 T3-11 T3-14 T3-15 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

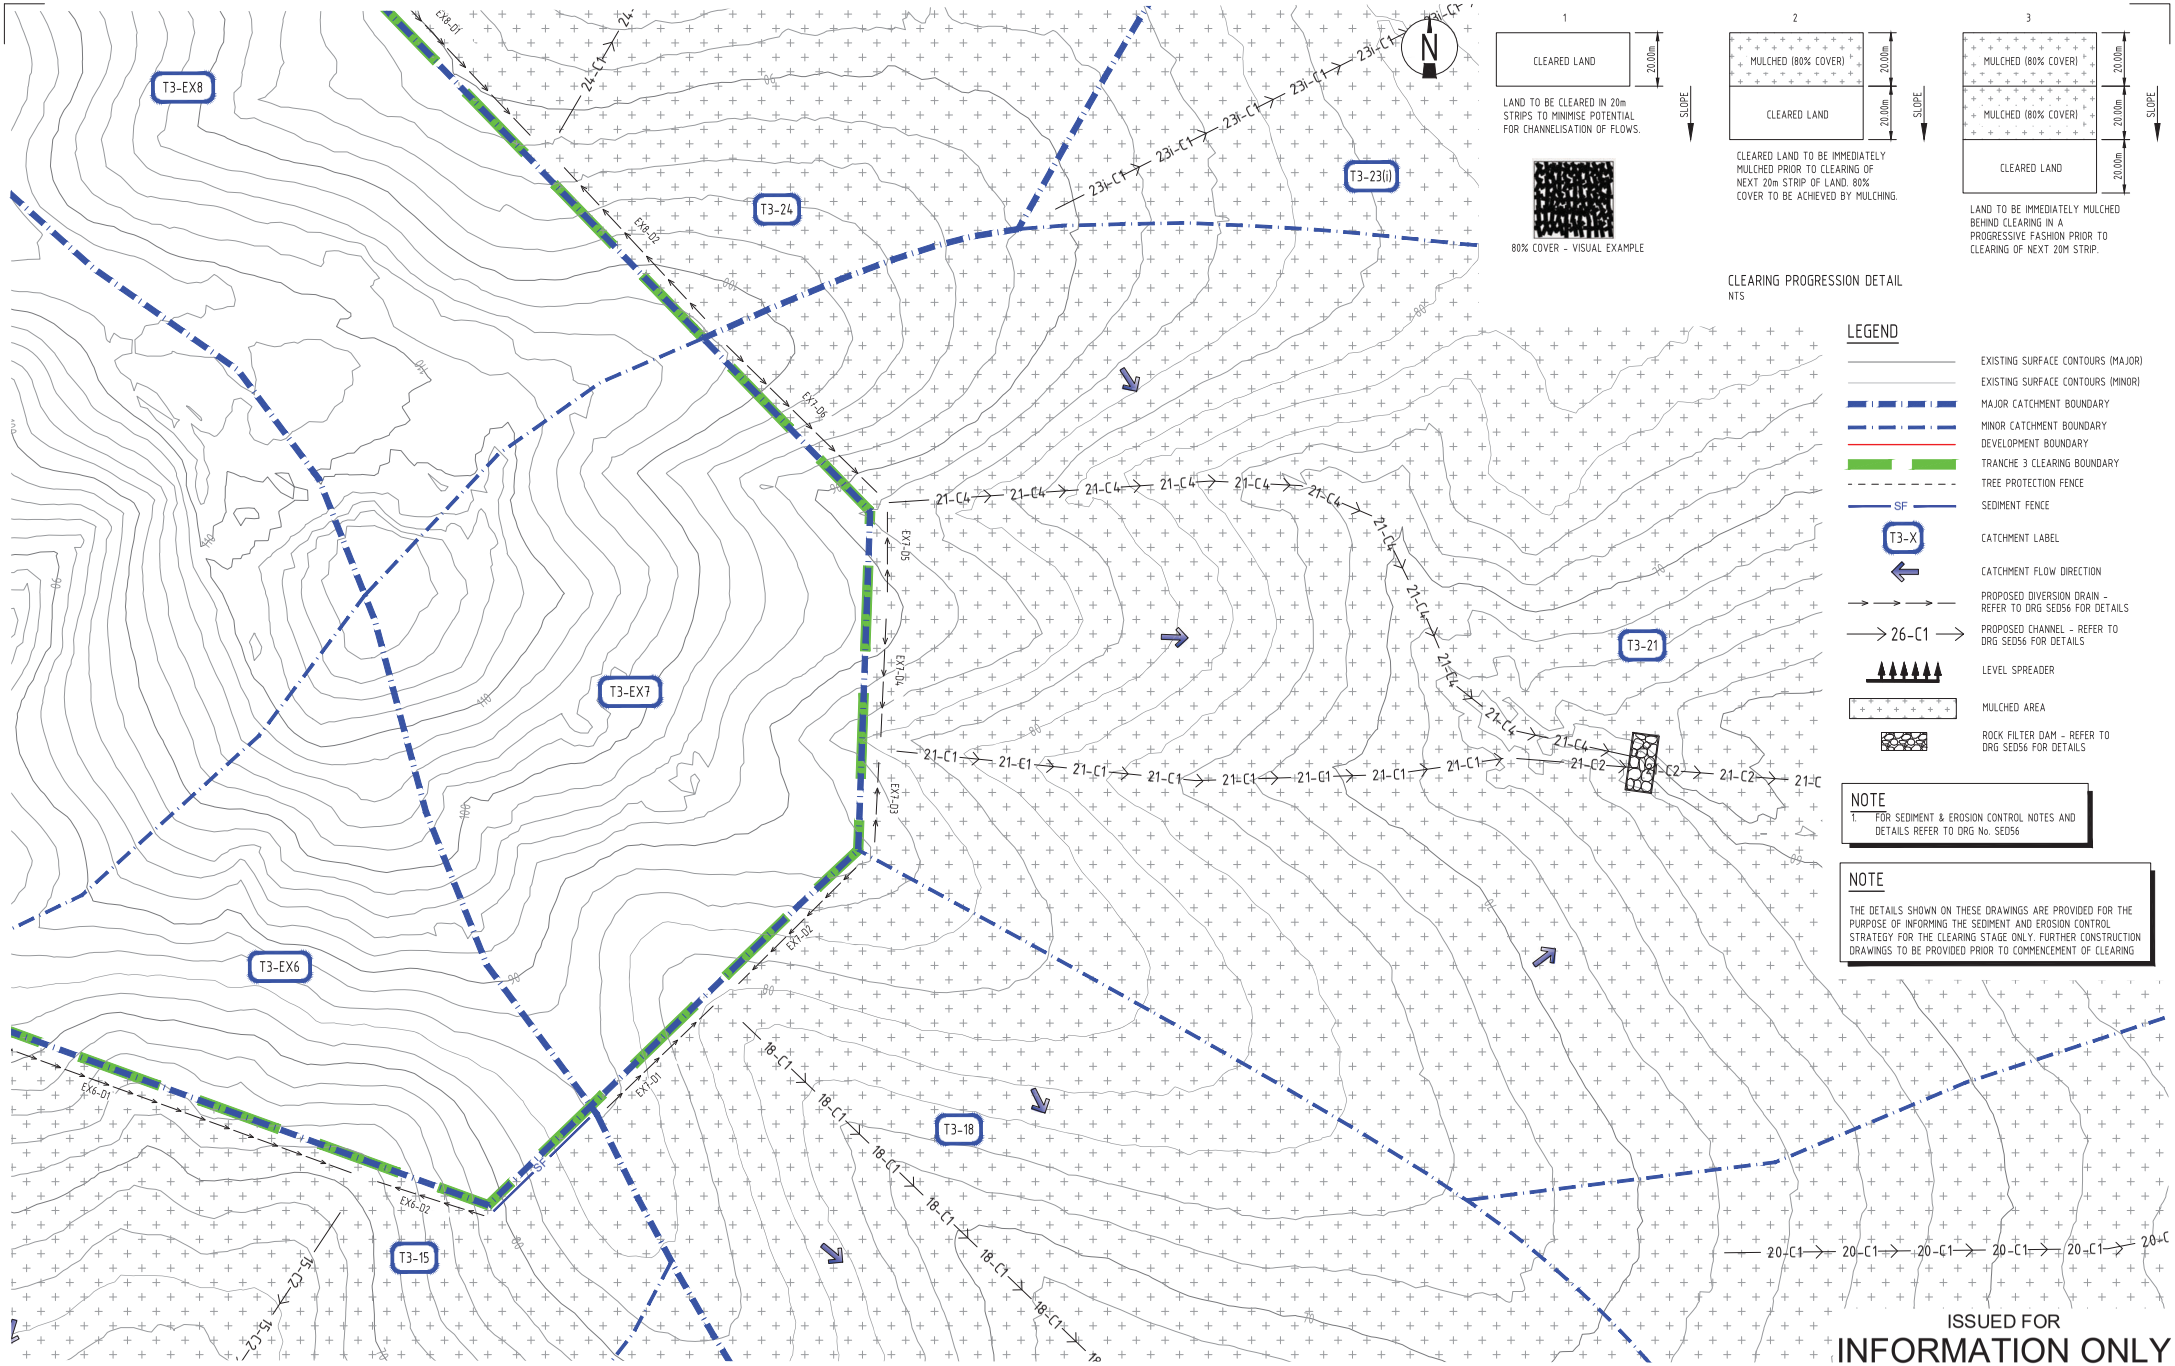

1

CLEARED LAND

20.00m

SLOPE

LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

80% COVER - VISUAL EXAMPLE

2

MULCHED (80% COVER)

20.00m

CLEARED LAND

20.00m

SLOPE

CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3

MULCHED (80% COVER)

20.00m

MULCHED (80% COVER)

20.00m

CLEARED LAND

20.00m

SLOPE

LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

CLEARING PROGRESSION DETAIL

NTS

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR

INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

0 10 20 30 40 50m

SCALE 1:1000

AT ORIGINAL SIZE (A1)

ADG

Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-15 T3-18 T3-21 T3-23ii T3-24 CATCHMENT CLEARING PLAN
Drawing No.	SED47
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED47_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-15 T3-18 T3-21 T3-23i T3-24 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

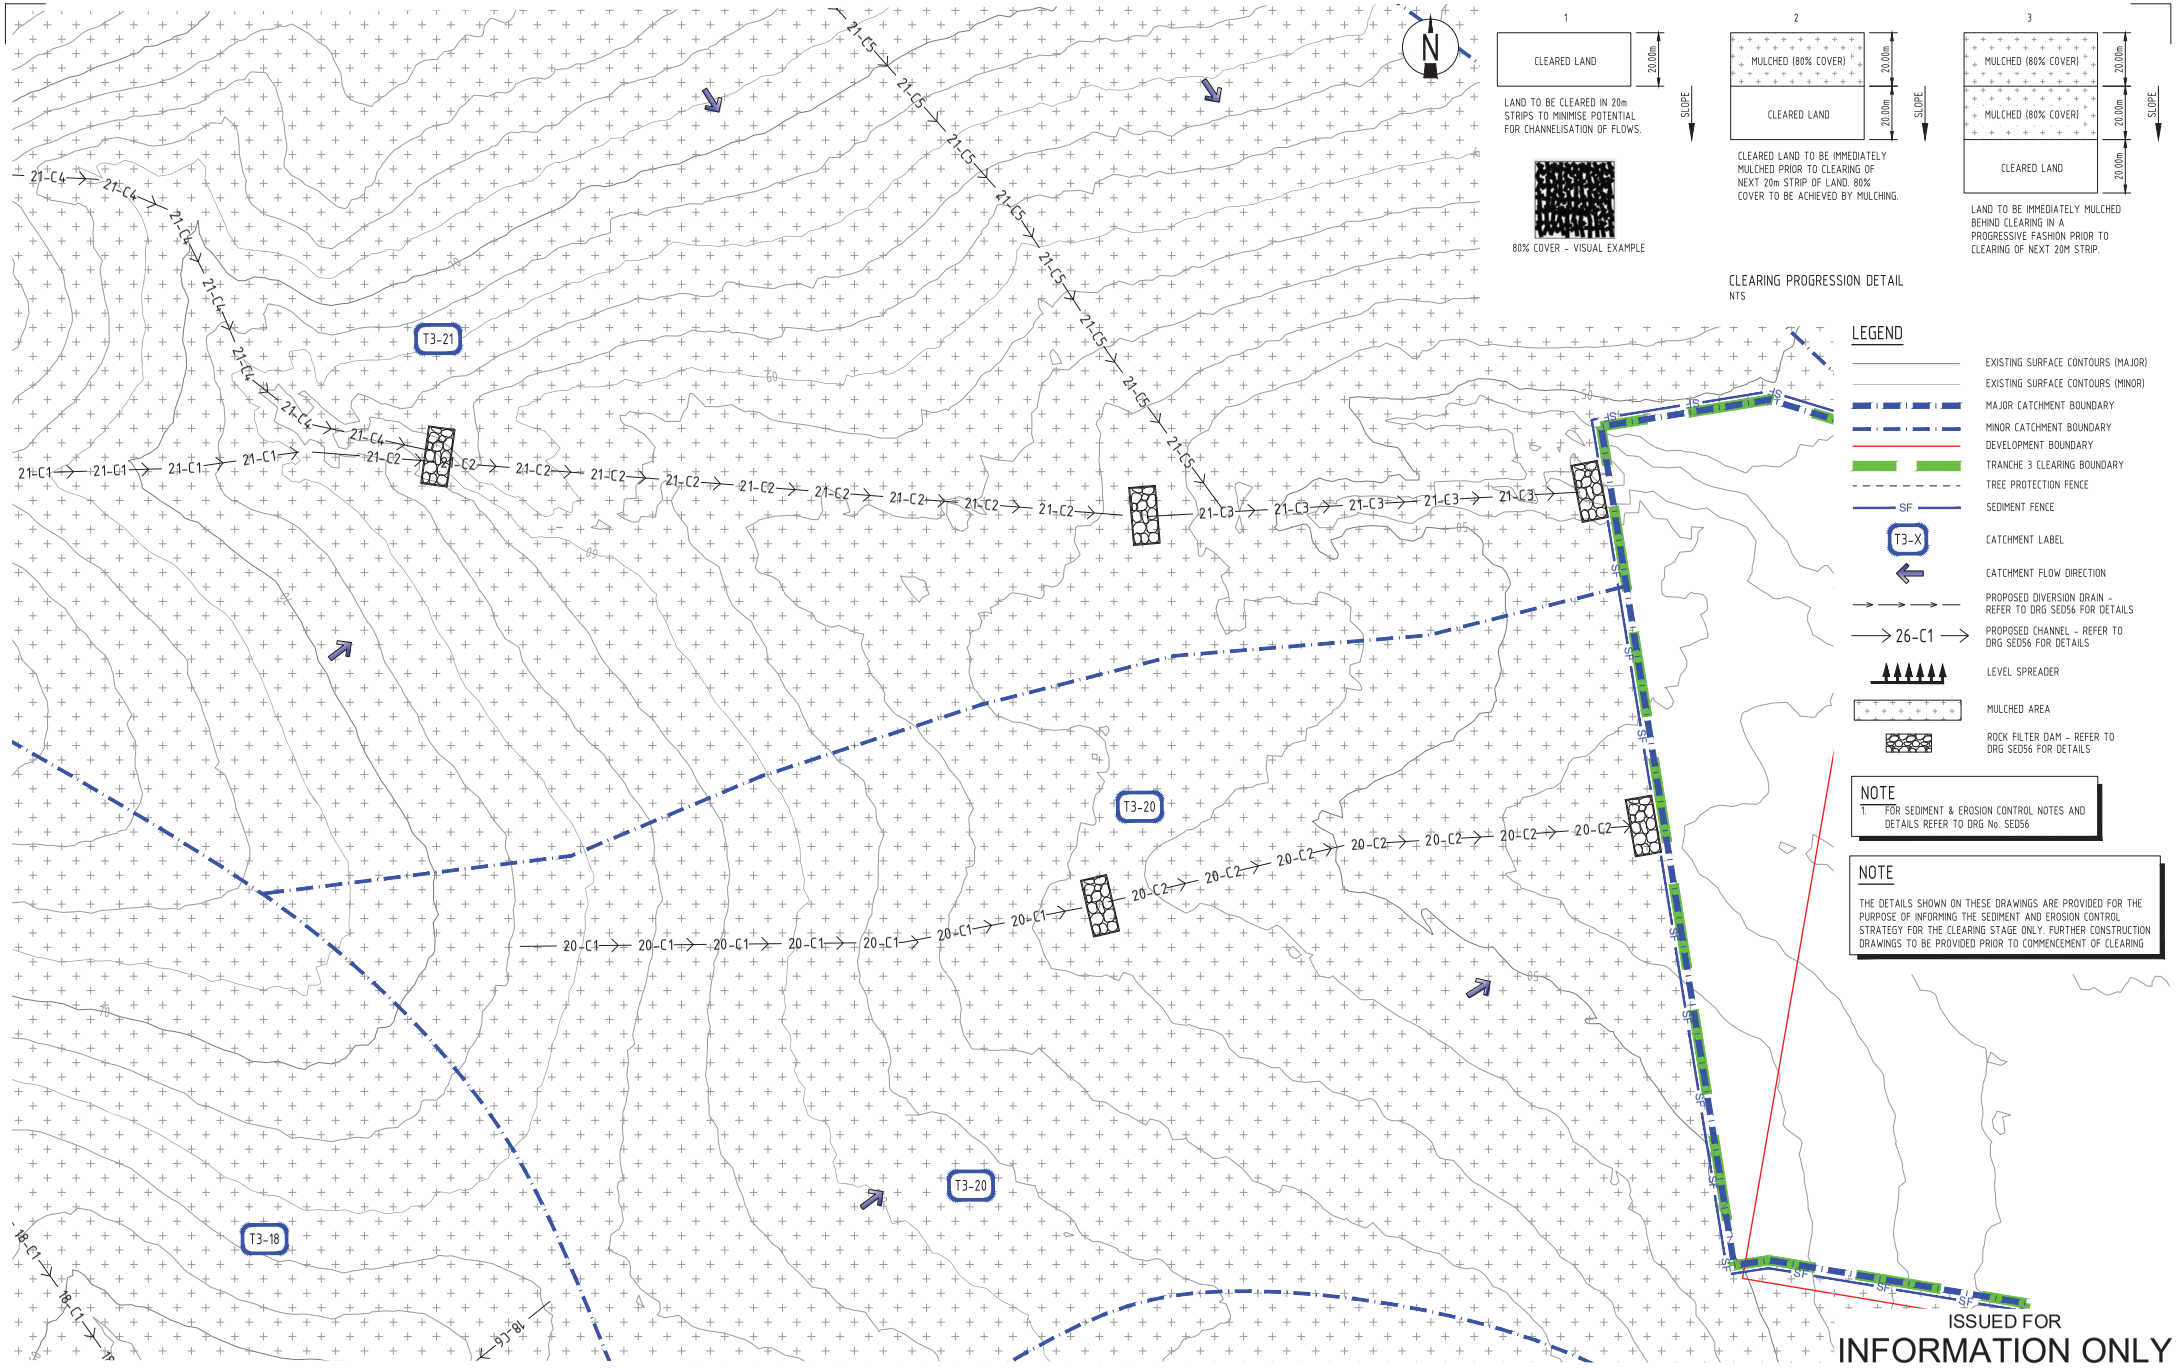

1

CLEARED LAND

20.00m

SLOPE

LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

80% COVER - VISUAL EXAMPLE

2

MULCHED (80% COVER)

20.00m

CLEARED LAND

20.00m

SLOPE

CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3

MULCHED (80% COVER)

20.00m

MULCHED (80% COVER)

20.00m

CLEARED LAND

20.00m

SLOPE

LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

CLEARING PROGRESSION DETAIL

NTS

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR

INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

0 10 20 30 40 50m

SCALE 1:1000

AT ORIGINAL SIZE (A1)

ADG

Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgpc.com W www.adgpc.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285

Discipline: CIVIL		Status: INFORMATION
Designed By: MS	Checked By: ML	Approved By: ML
Project No.: 23165	Drawn By: MD	Scale at A1: 1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title: TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-18 T3-20 T3-21 CATCHMENT CLEARING PLAN

Drawing No.: SED48

Revision: 02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED48_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-18 T3-20 T3-21 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

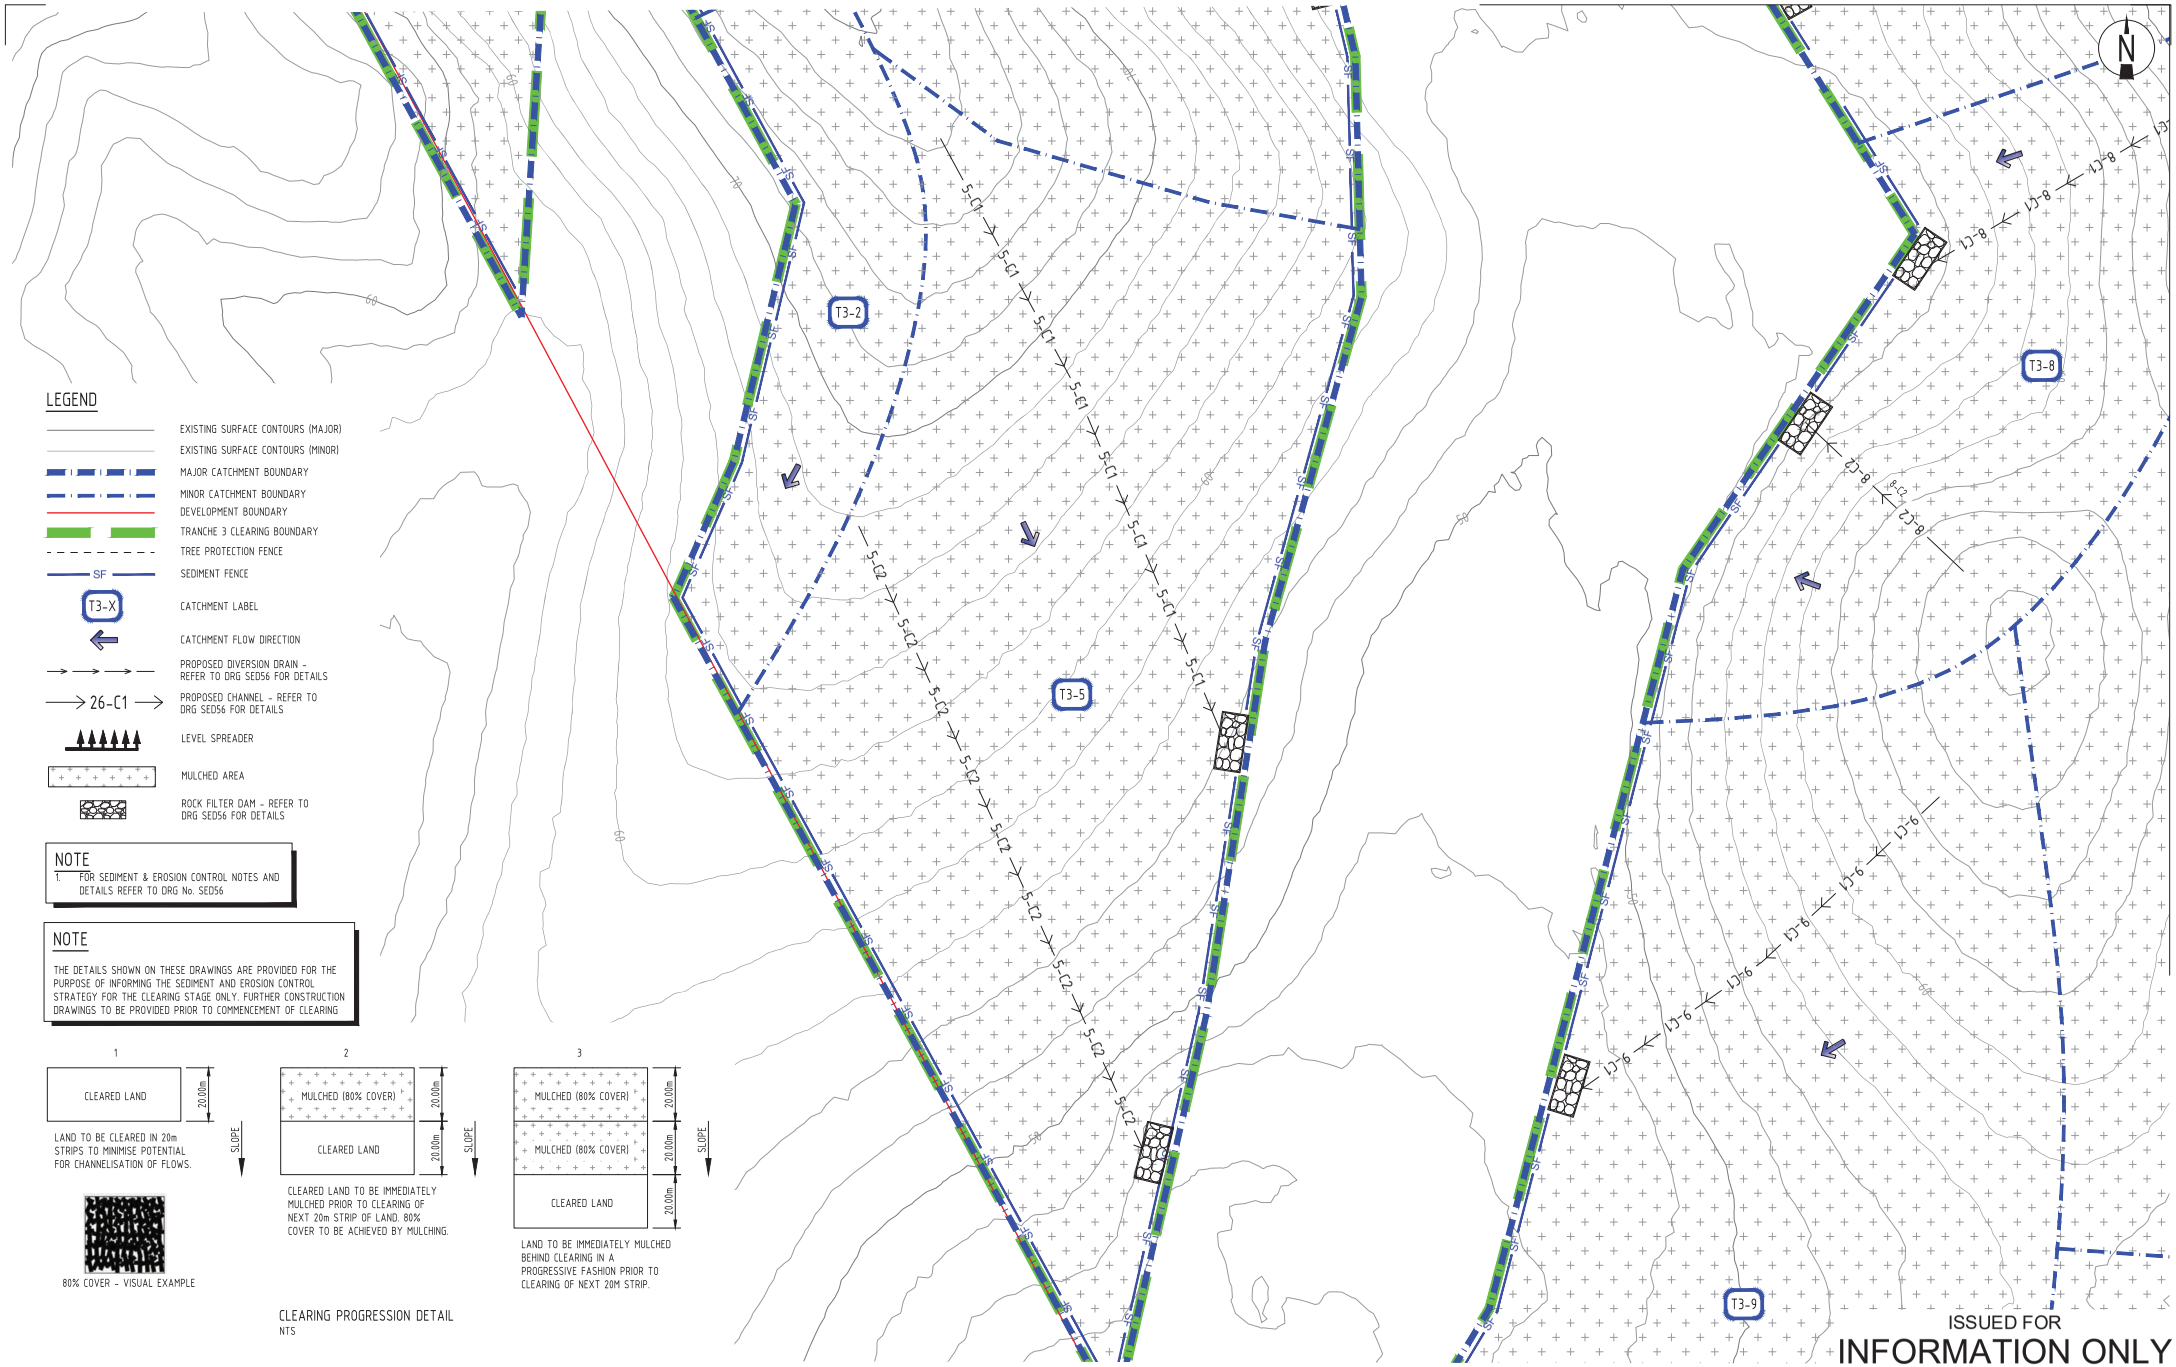

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

80% COVER - VISUAL EXAMPLE

CLEARING PROGRESSION DETAIL
NTS

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000
Drawing No.	SED49
Revision	02

Title: TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-2 T3-5 T3-8 T3-9 CATCHMENT CLEARING PLAN

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED49_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-2 T3-5 T3-8 T3-9 CATCHMENT CLEARING PLAN.DWG

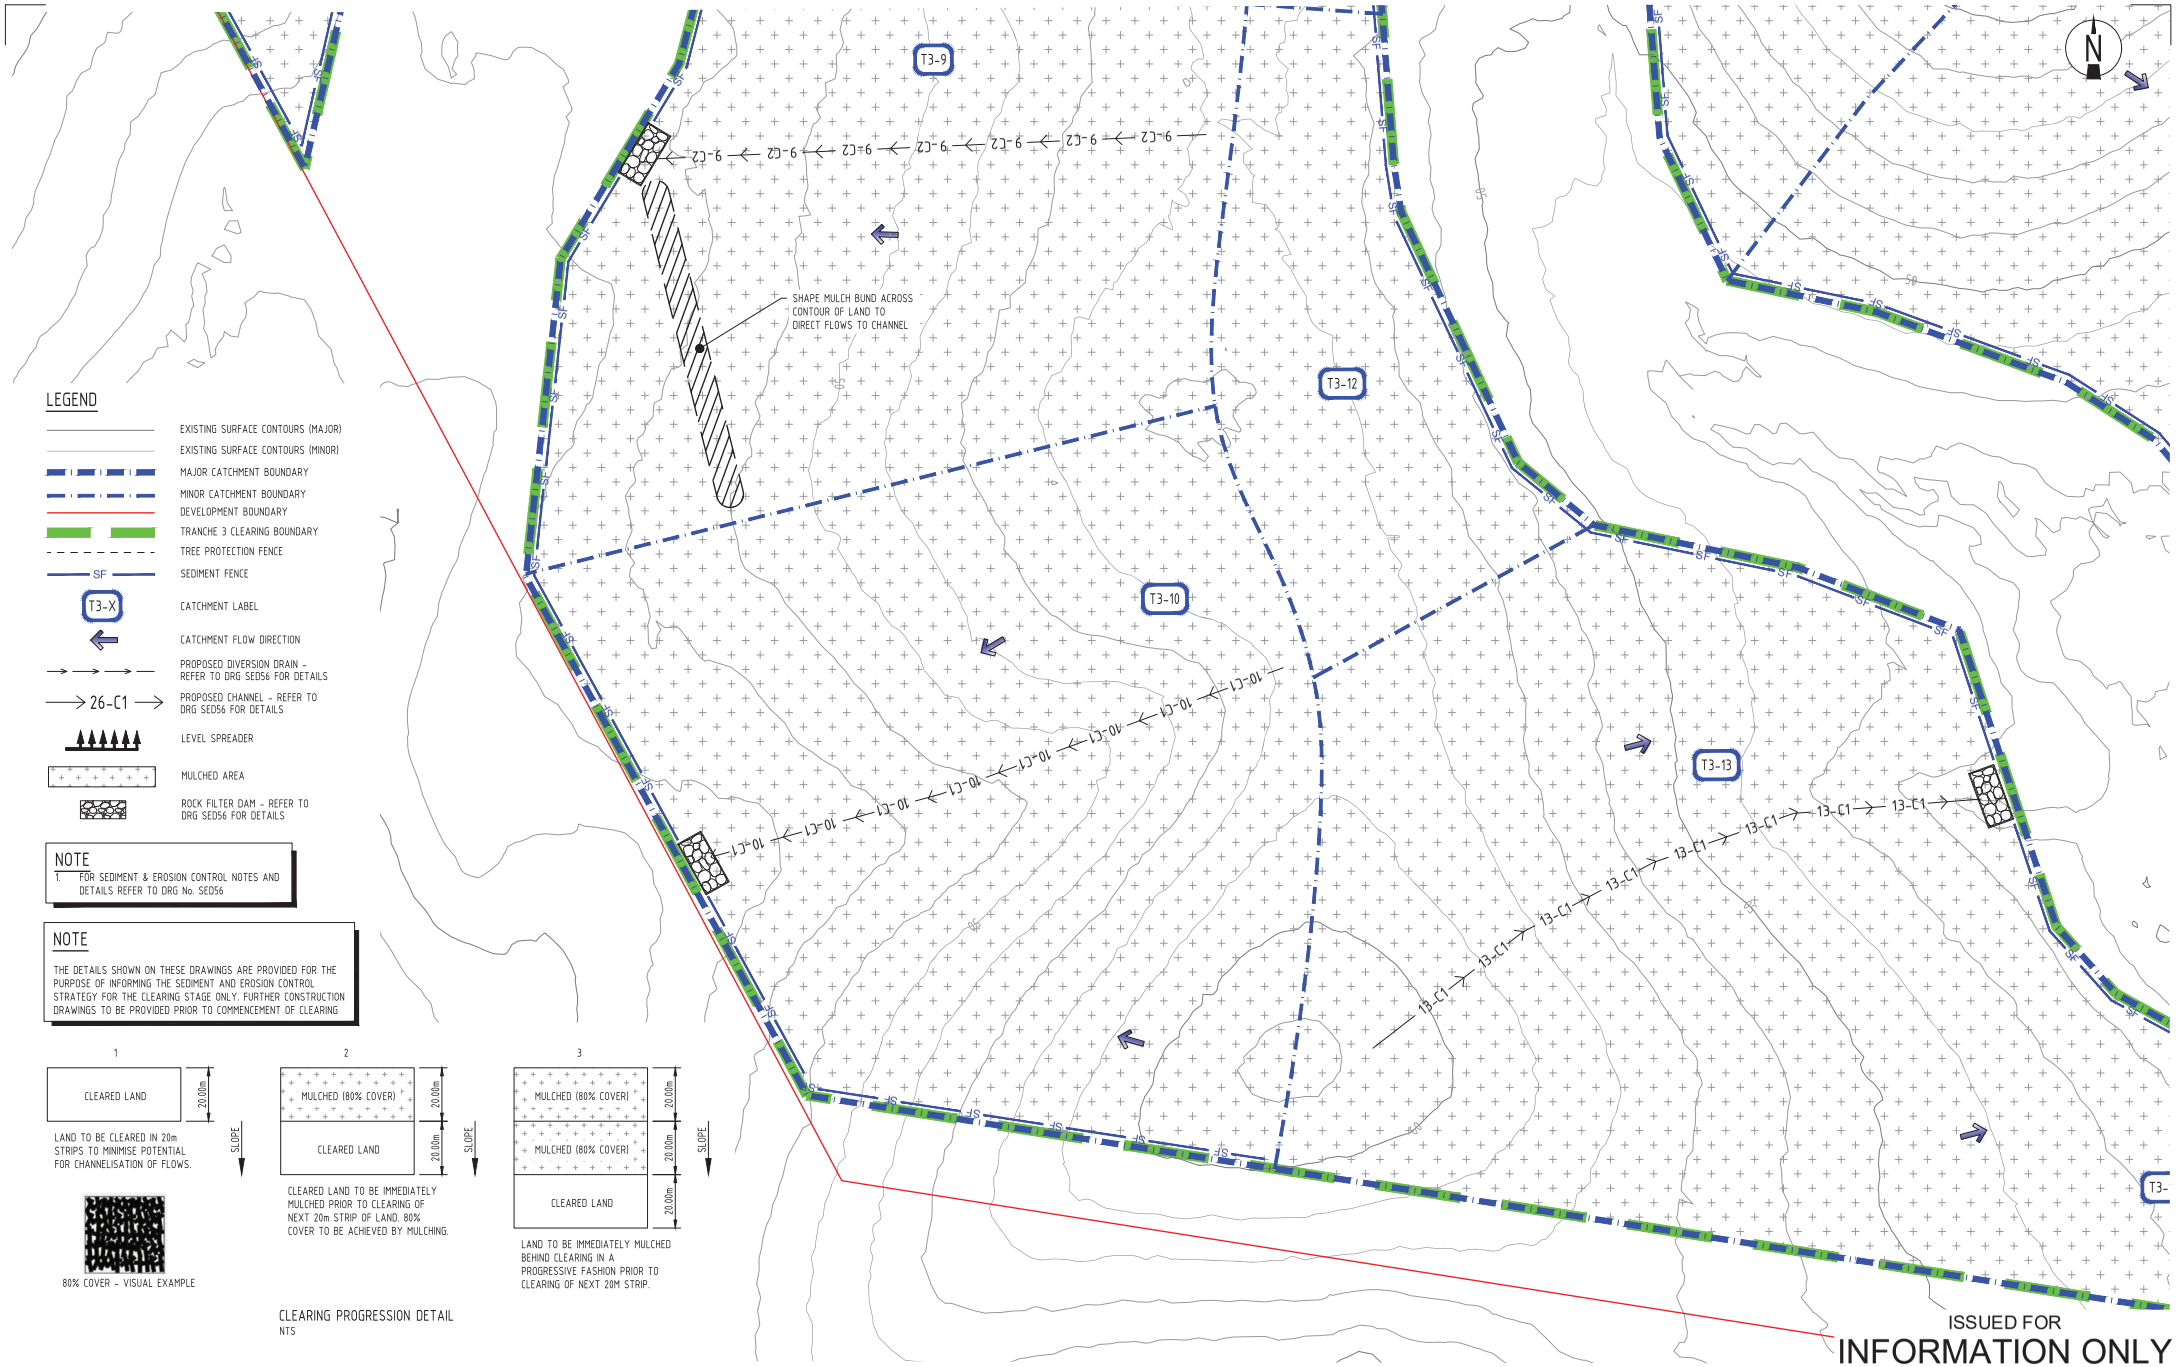

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-9 T3-10 T3-12 T3-13 CATCHMENT CLEARING PLAN
Drawing No.	SED50
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIV\DWG\TRANCHE 3\23165_SED50_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-9 T3-10 T3-12 T3-13 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

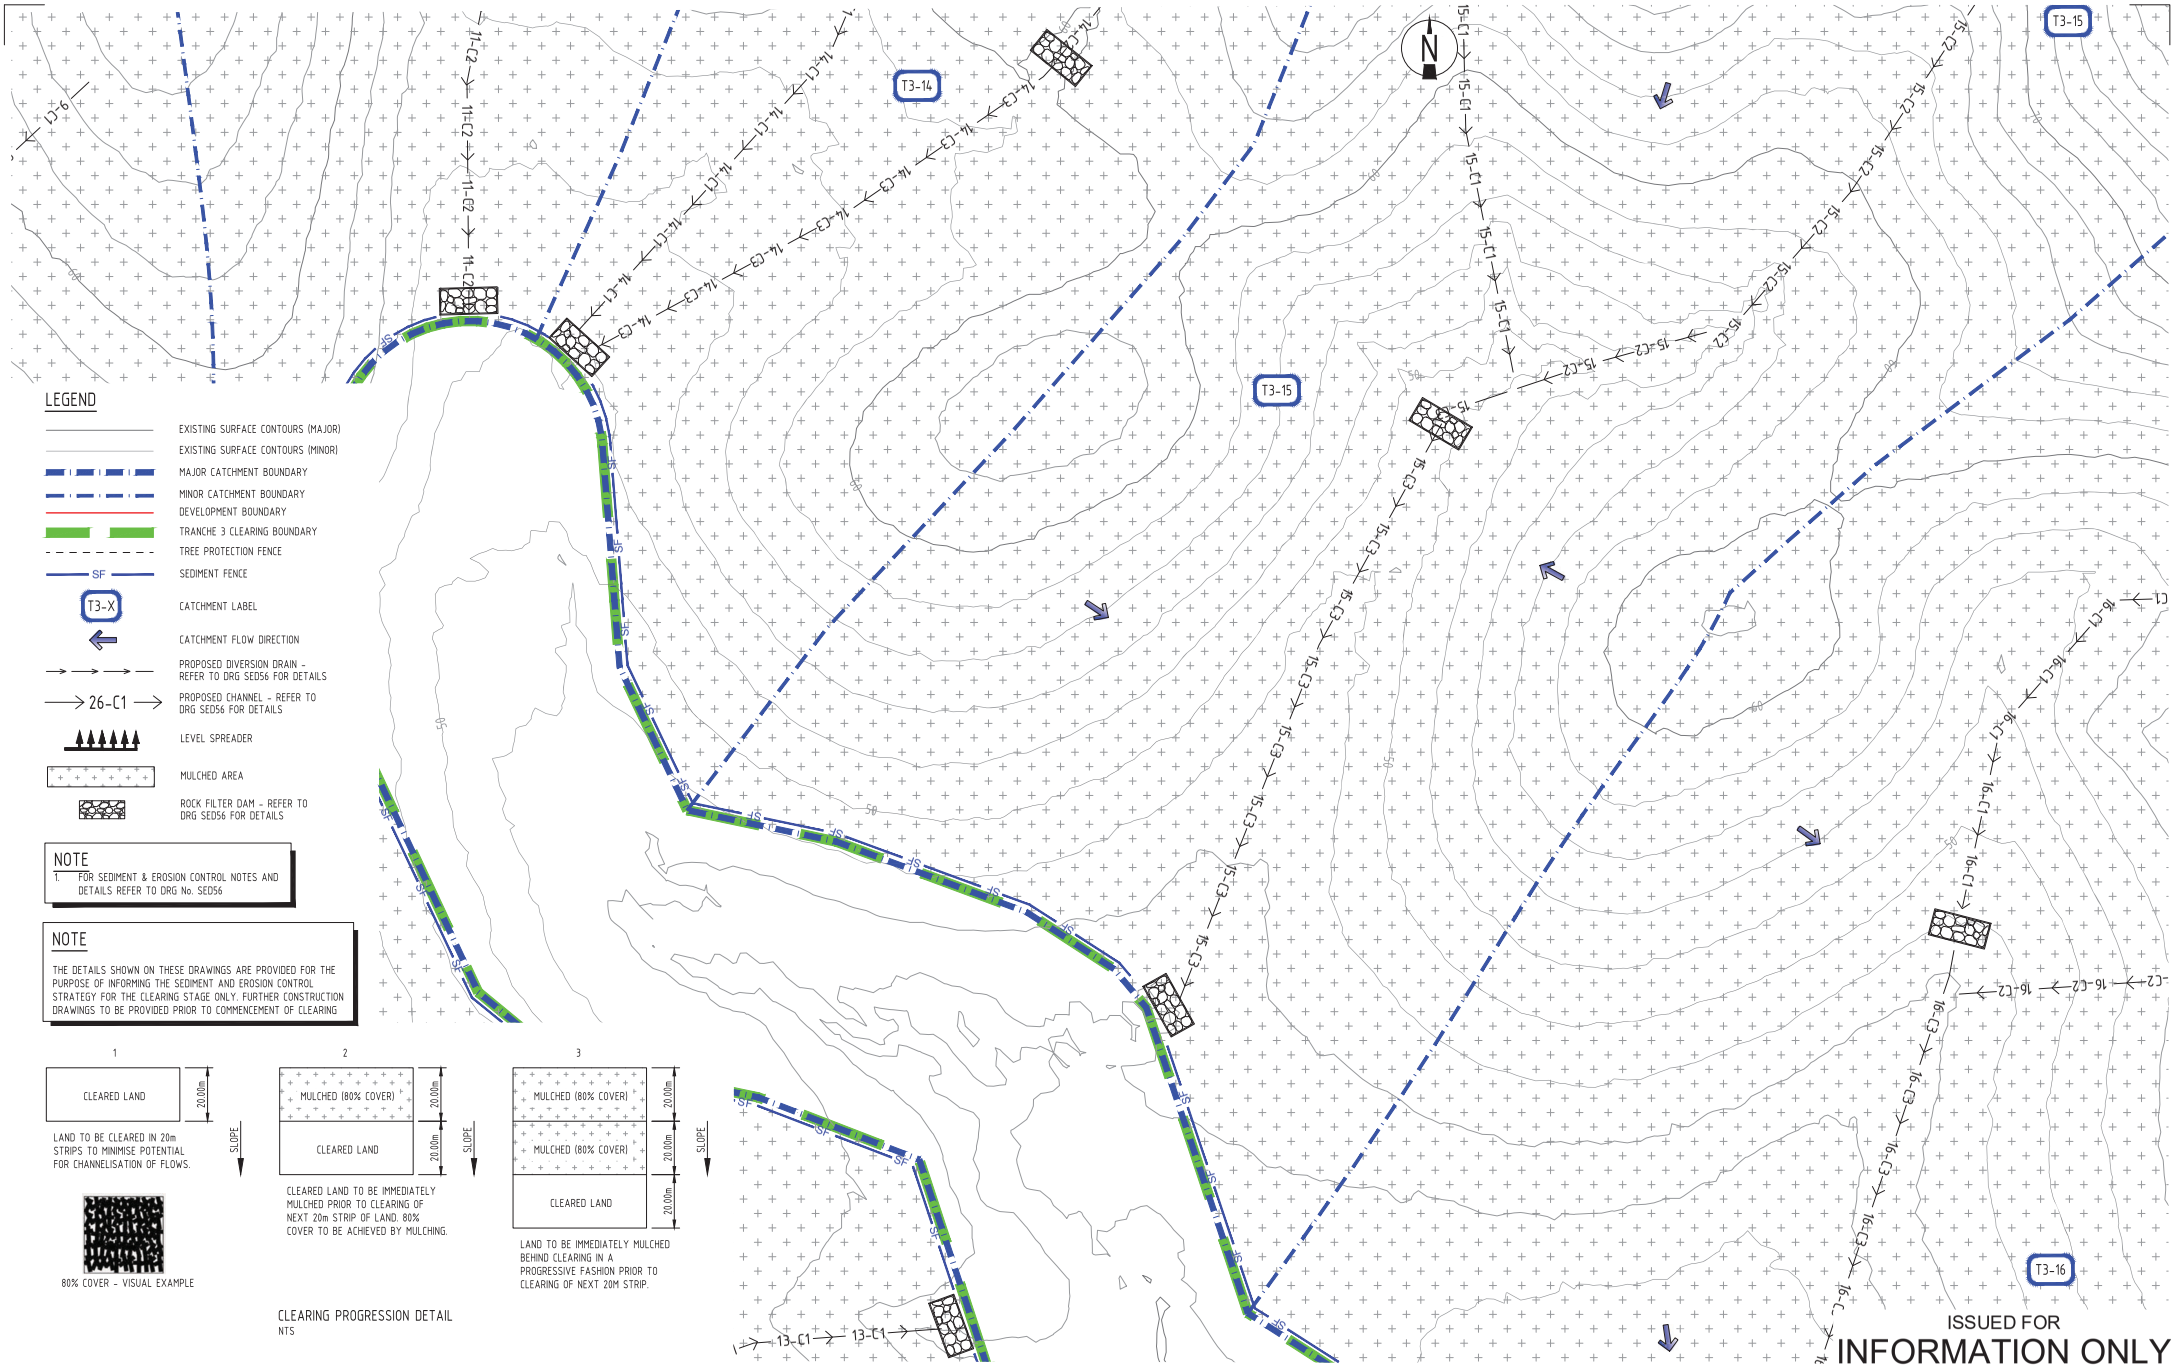

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-12 T3-13 T3-14 T3-15 CATCHMENT CLEARING PLAN
Drawing No.	SED51
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED51_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-12 T3-13 T3-14 T3-15 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

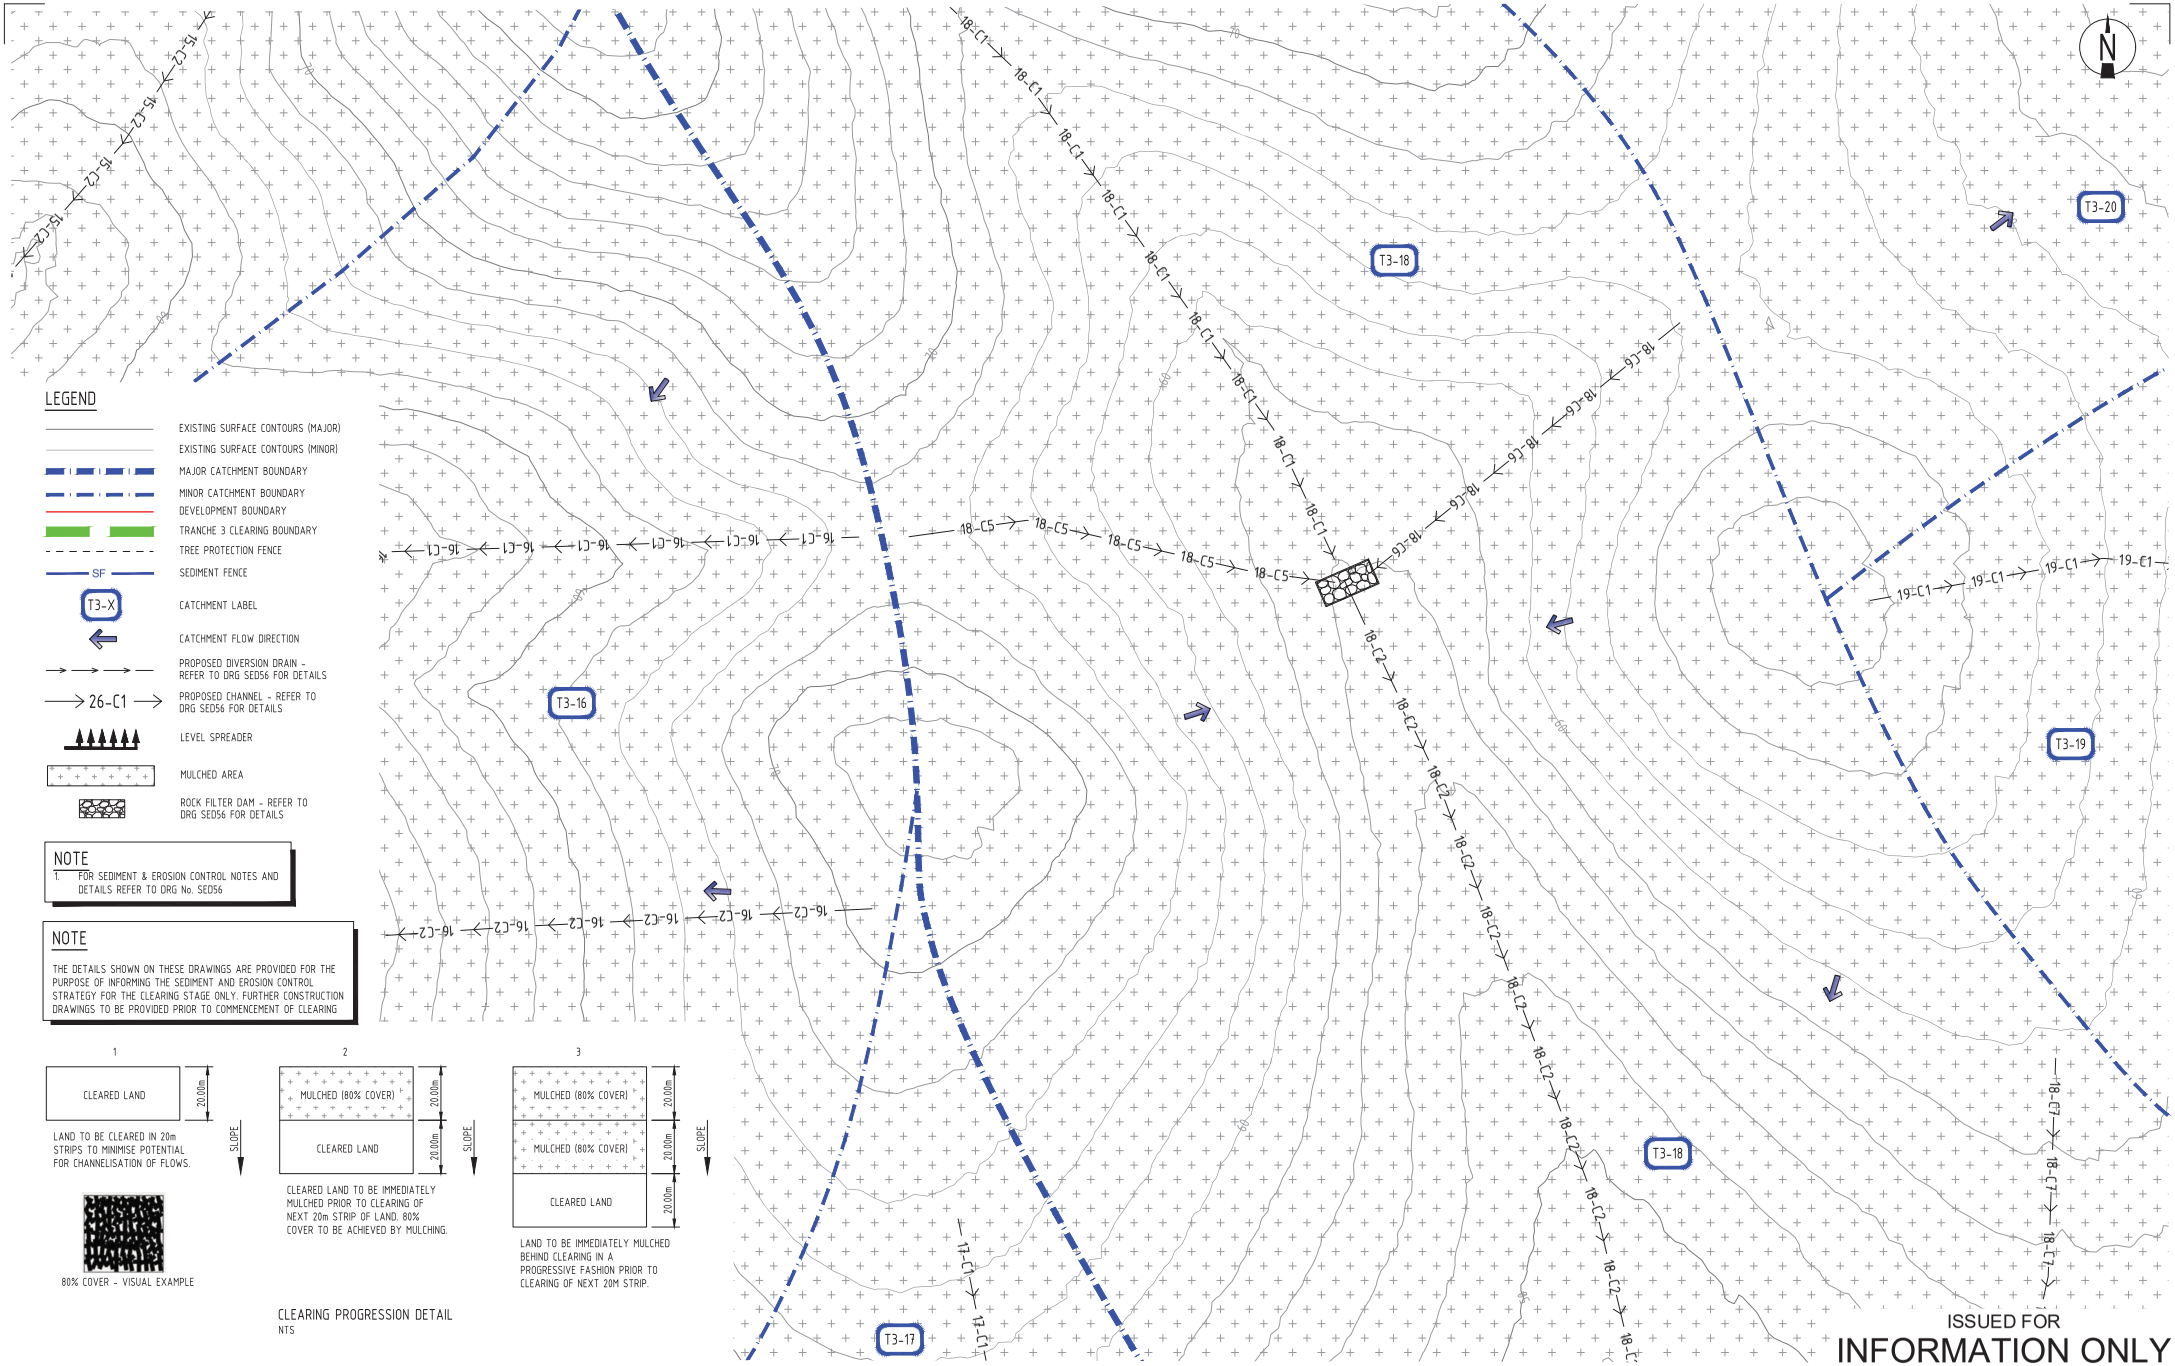

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

0 10 20 30 40 50m
SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-16 T3-17 T3-18 CATCHMENT CLEARING PLAN
Drawing No.	SED52
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED52_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-16 T3-17 T3-18 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

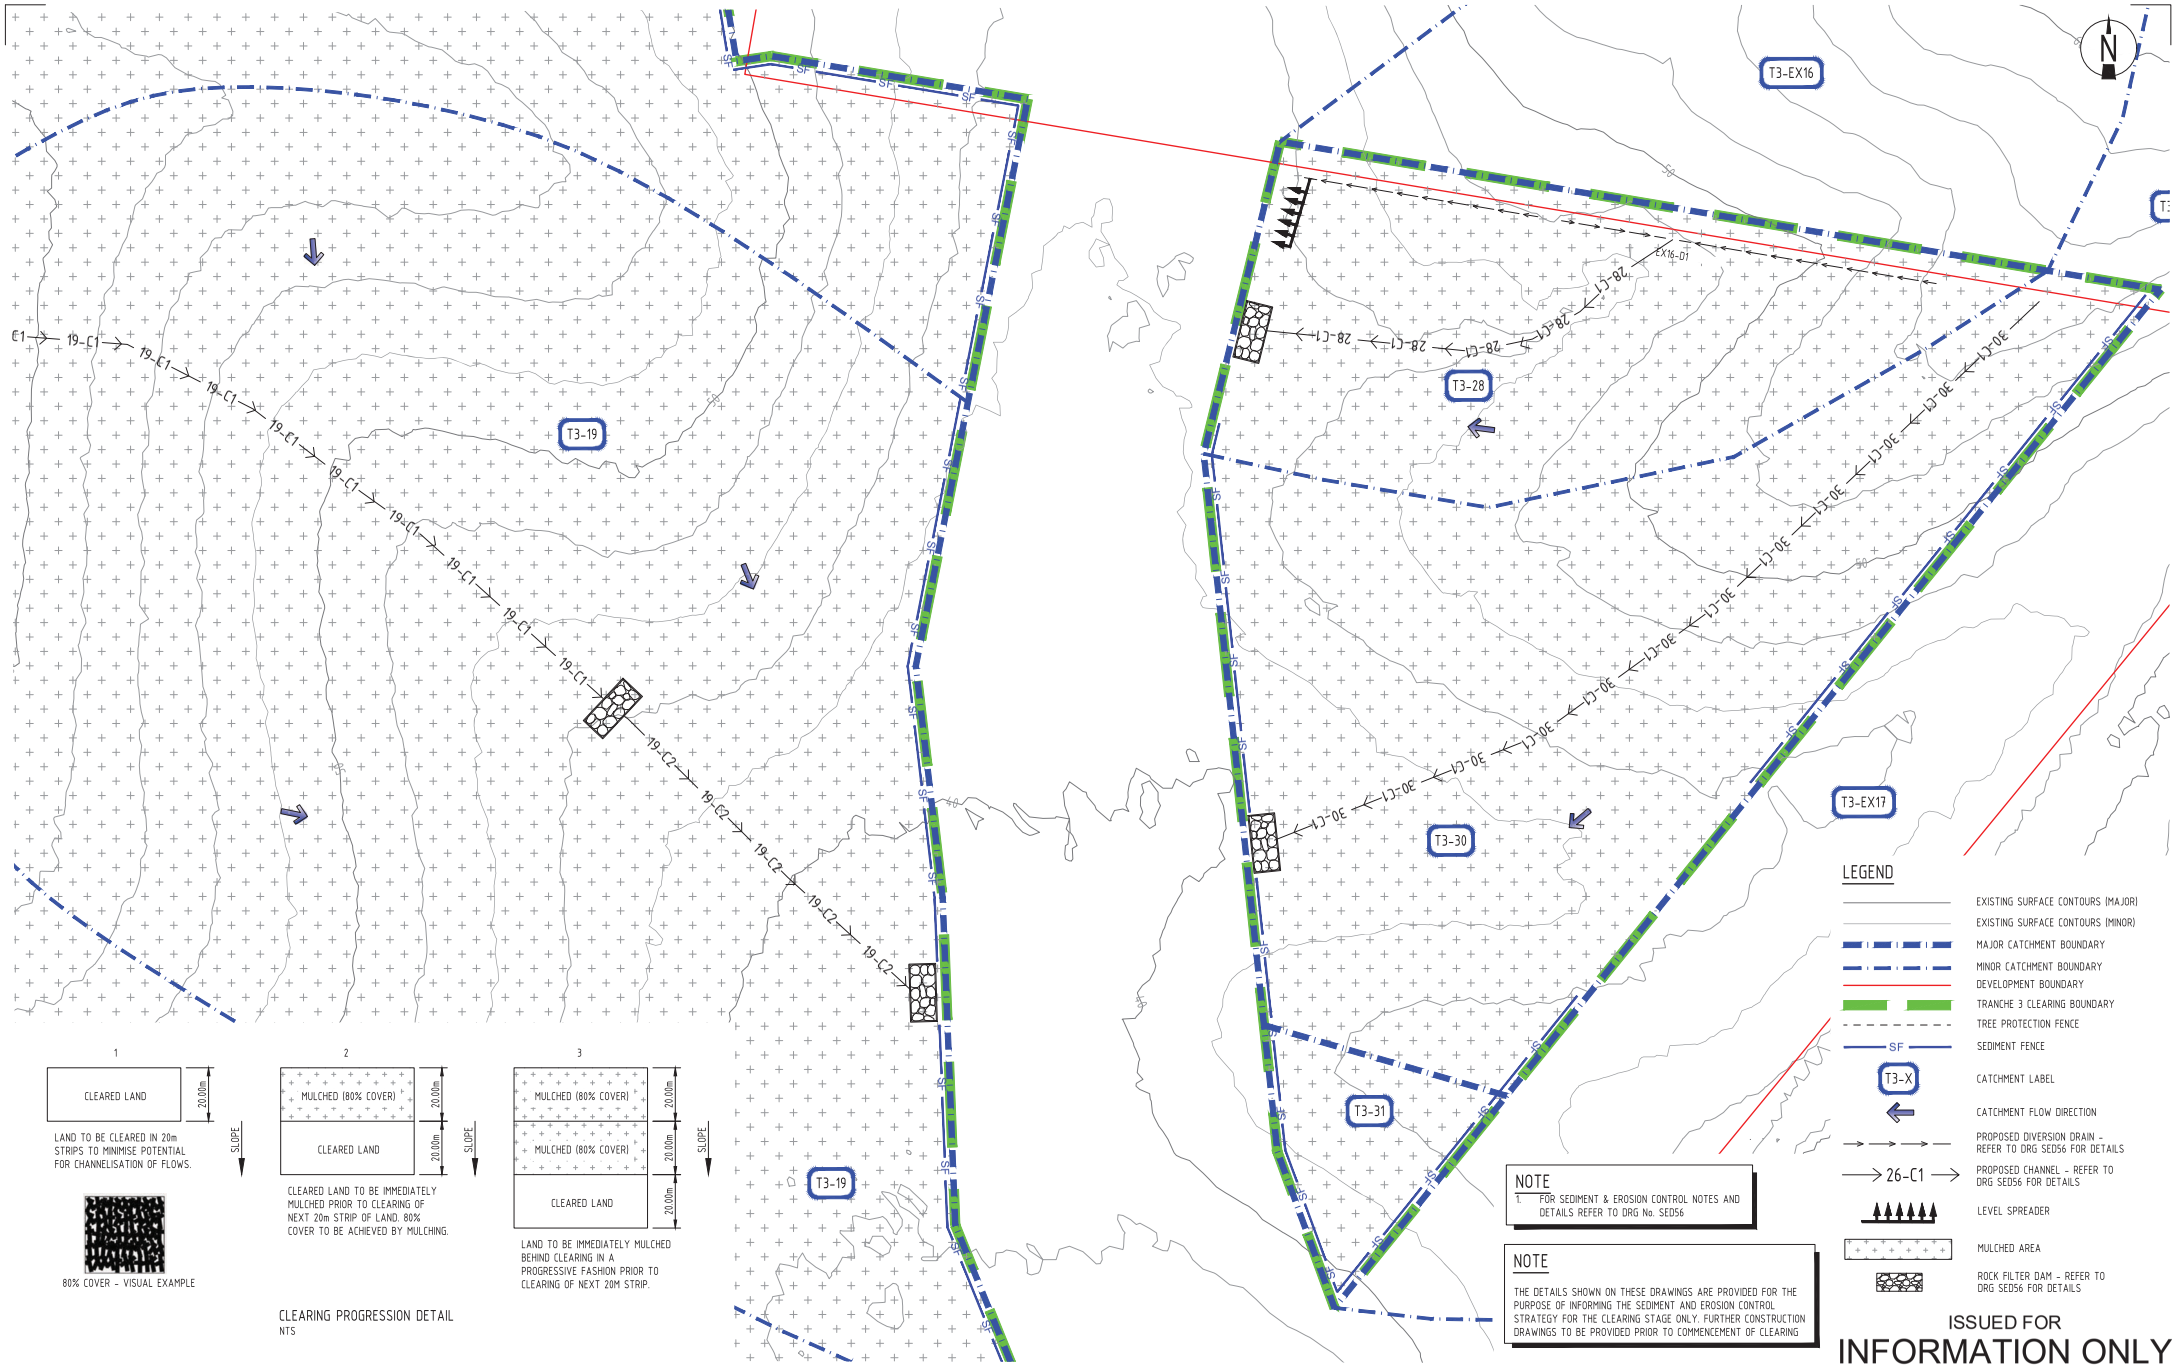

1
CLEARED LAND
20.00m
SLOPE
LAND TO BE CLEARED IN 20m STRIPS TO MINIMISE POTENTIAL FOR CHANNELISATION OF FLOWS.

2
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
CLEARED LAND TO BE IMMEDIATELY MULCHED PRIOR TO CLEARING OF NEXT 20m STRIP OF LAND. 80% COVER TO BE ACHIEVED BY MULCHING.

3
MULCHED (80% COVER)
20.00m
MULCHED (80% COVER)
20.00m
CLEARED LAND
20.00m
SLOPE
LAND TO BE IMMEDIATELY MULCHED BEHIND CLEARING IN A PROGRESSIVE FASHION PRIOR TO CLEARING OF NEXT 20M STRIP.

80% COVER - VISUAL EXAMPLE

CLEARING PROGRESSION DETAIL
NTS

NOTE
1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE
THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-19 T3-28 T3-30 CATCHMENT CLEARING PLAN
Drawing No.	SED53
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIV\DWG\TRANCHE 3\23165_SED53_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-19 T3-28 T3-30 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

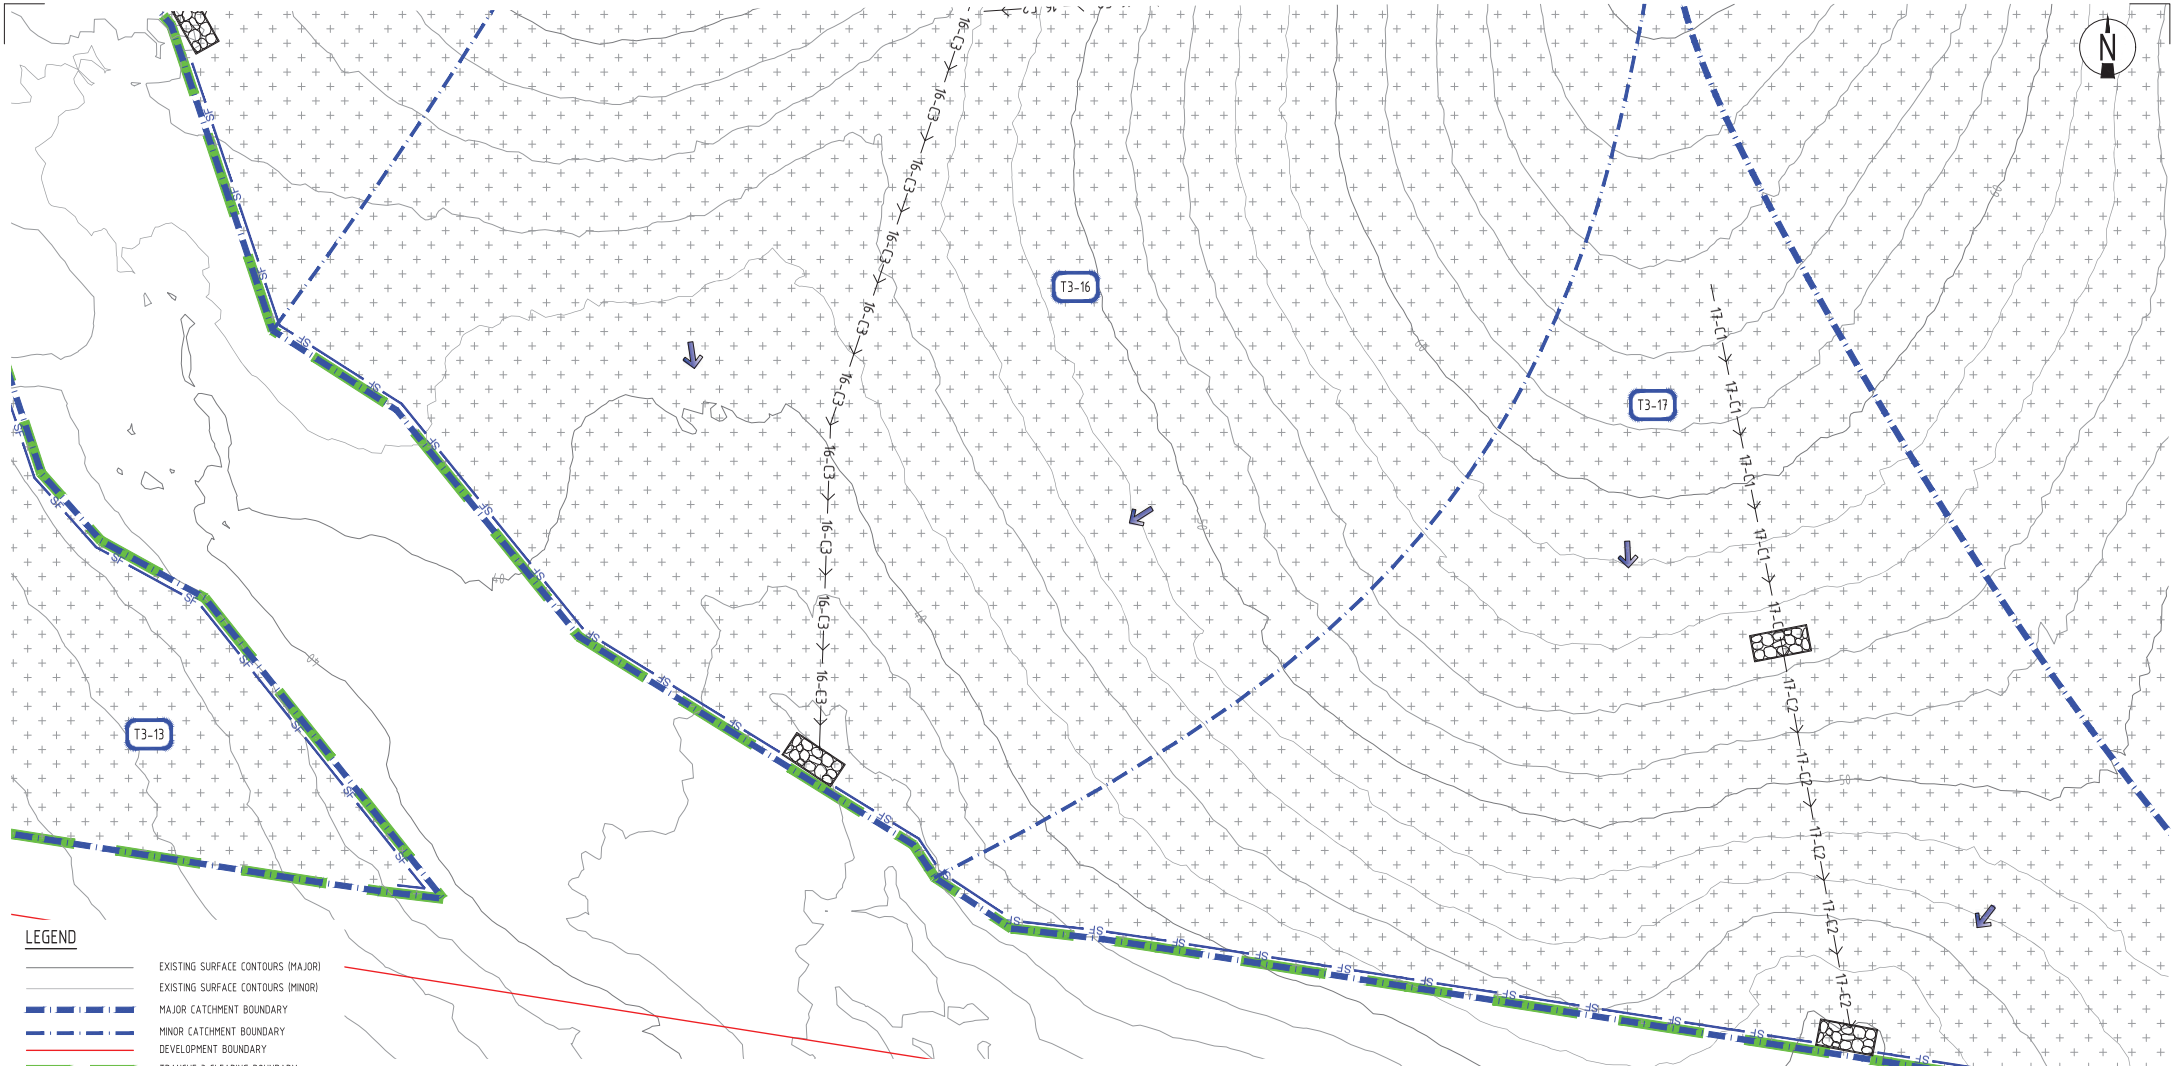

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

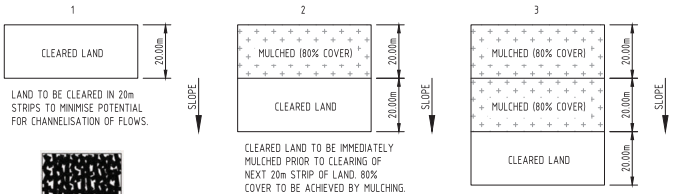

80% COVER - VISUAL EXAMPLE

CLEARING PROGRESSION DETAIL
NTS

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-13 T3-16 T3-17 CATCHMENT CLEARING PLAN
Drawing No.	SED54
Revision	02

PLOT DATE: 12/20/2021 4:53 PM FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED54_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-13 T3-16 T3-17 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

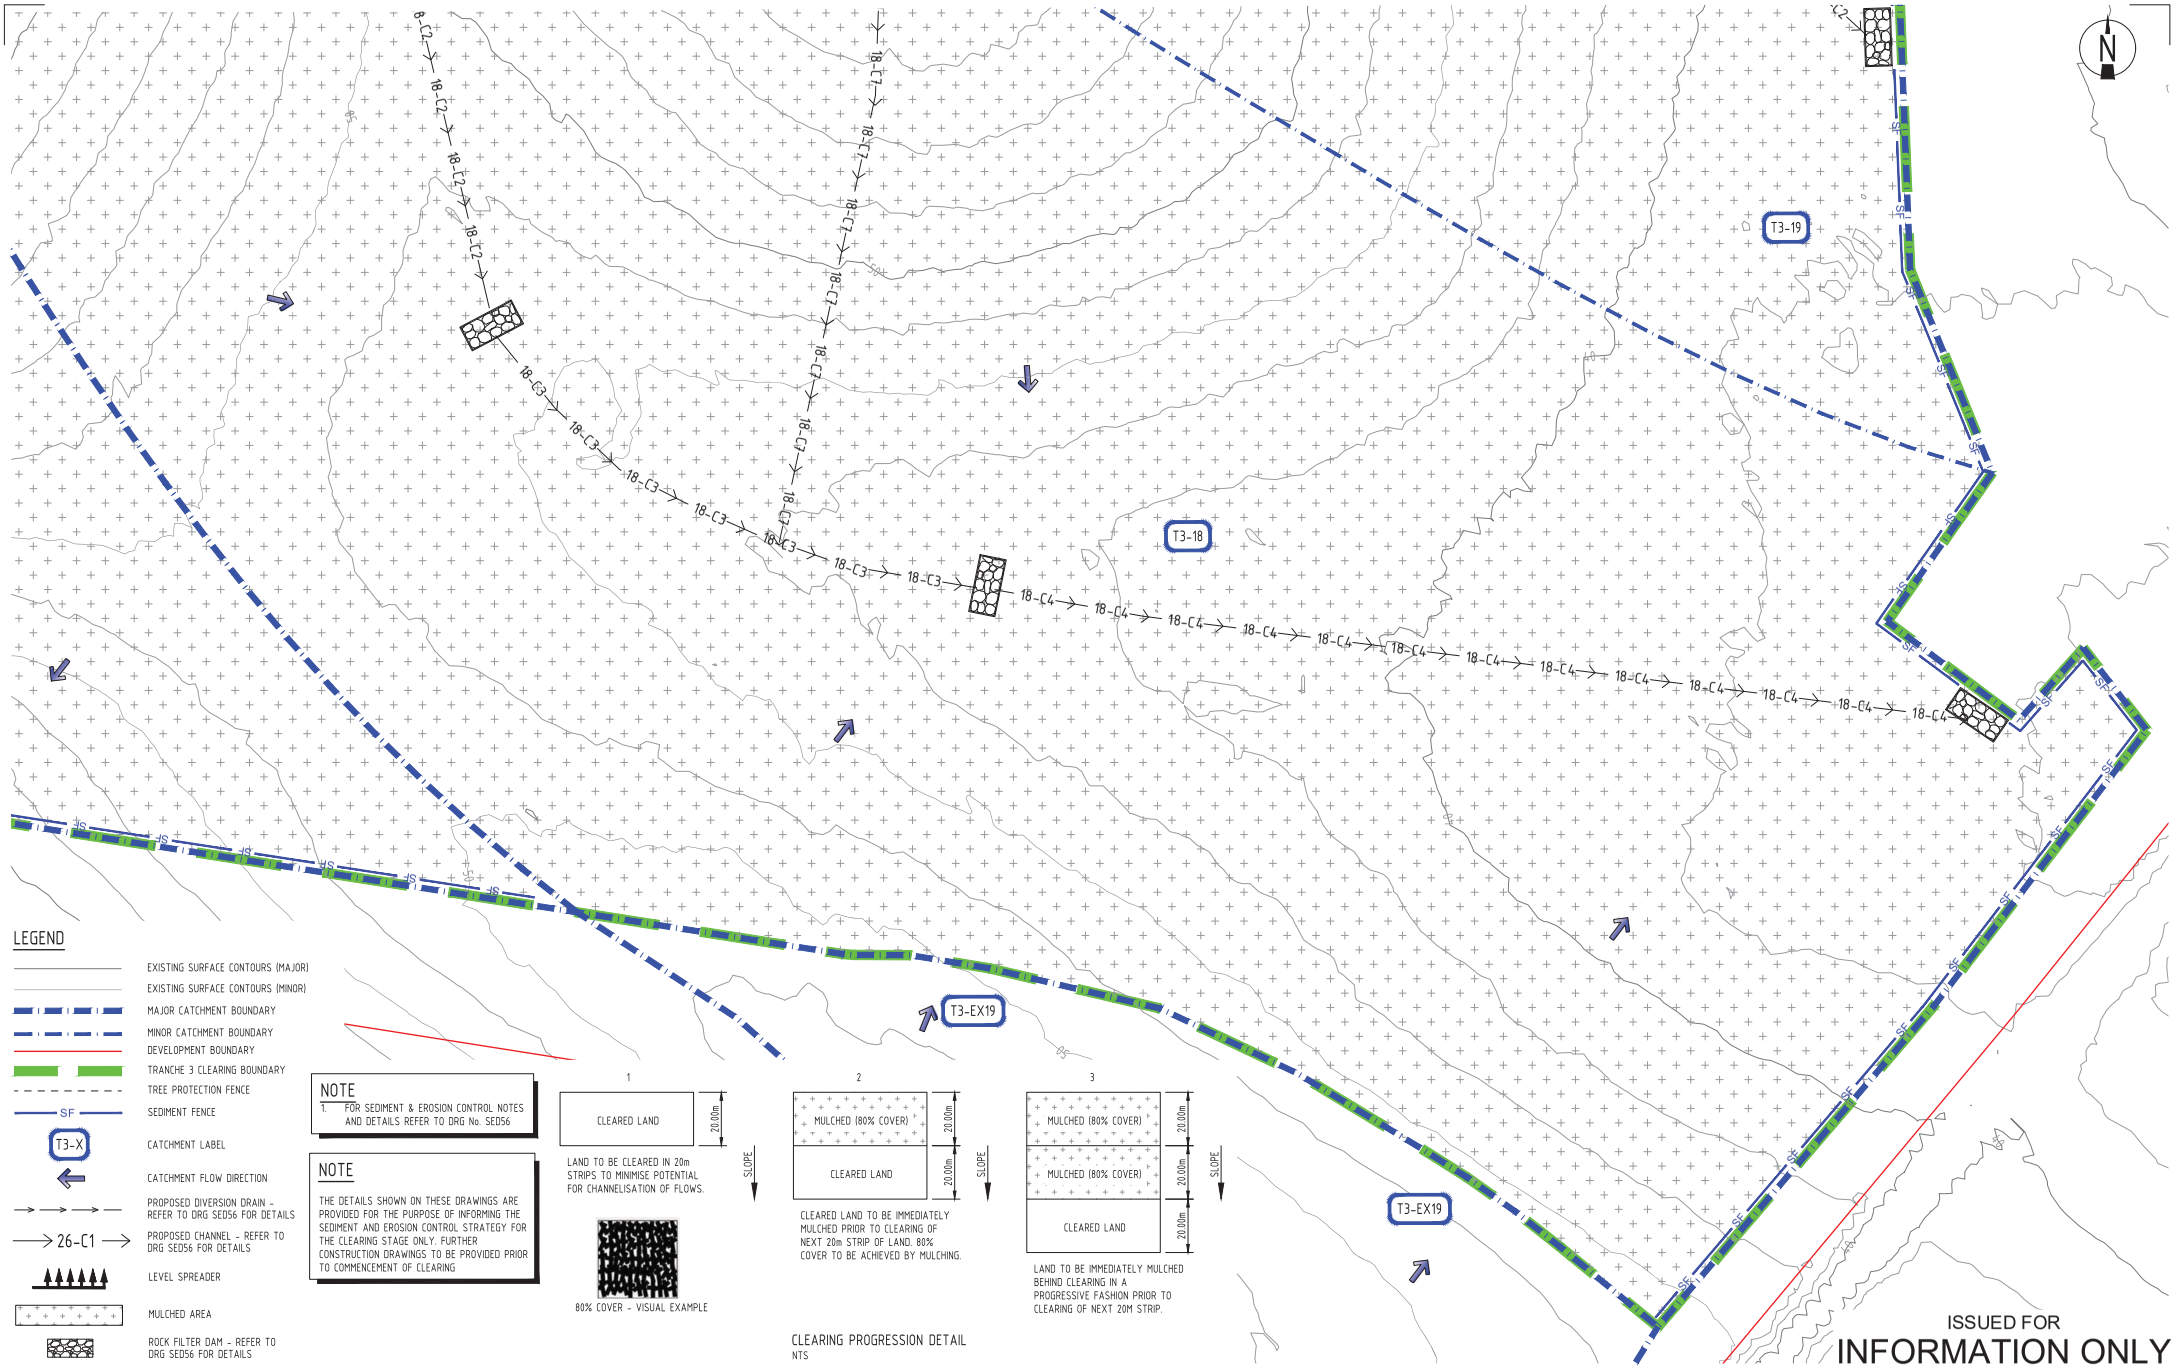

LEGEND

- EXISTING SURFACE CONTOURS (MAJOR)
- EXISTING SURFACE CONTOURS (MINOR)
- MAJOR CATCHMENT BOUNDARY
- MINOR CATCHMENT BOUNDARY
- DEVELOPMENT BOUNDARY
- TRANCHE 3 CLEARING BOUNDARY
- TREE PROTECTION FENCE
- SF — SEDIMENT FENCE
- T3-X — CATCHMENT LABEL
- CATCHMENT FLOW DIRECTION
- PROPOSED DIVERSION DRAIN - REFER TO DRG SED56 FOR DETAILS
- 26-C1 — PROPOSED CHANNEL - REFER TO DRG SED56 FOR DETAILS
- LEVEL SPREADER
- MULCHED AREA
- ROCK FILTER DAM - REFER TO DRG SED56 FOR DETAILS

NOTE

1. FOR SEDIMENT & EROSION CONTROL NOTES AND DETAILS REFER TO DRG No. SED56

NOTE

THE DETAILS SHOWN ON THESE DRAWINGS ARE PROVIDED FOR THE PURPOSE OF INFORMING THE SEDIMENT AND EROSION CONTROL STRATEGY FOR THE CLEARING STAGE ONLY. FURTHER CONSTRUCTION DRAWINGS TO BE PROVIDED PRIOR TO COMMENCEMENT OF CLEARING

CLEARING PROGRESSION DETAIL
NTS

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:1000
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	1:1000

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-18 T3-19 CATCHMENT CLEARING PLAN
Drawing No.	SED55
Revision	02

PLOT DATE: 12/20/2021 4:54 PM FILENAME: J:\23000\23165\CIV\DWG\TRANCHE 3\23165_SED55_TRANCHE 3 CLEARING PHASE SEDIMENT AND EROSION CONTROL T3-18 T3-19 CATCHMENT CLEARING PLAN.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

NOTES:

SEDIMENT CONTROL

1. ALL SEDIMENT & EROSION CONTROL MEASURES TO BE IN ACCORDANCE WITH INTERNATIONAL EROSION CONTROL ASSOCIATION (IECA) AUSTRALIA GUIDELINES AND THE SPECIFICATIONS.
2. SEDIMENT & EROSION CONTROL DETAILS SHOWN ARE MINIMUM REQUIREMENTS. IT IS THE CONTRACTORS RESPONSIBILITY TO INSTALL ADDITIONAL CONTROL MEASURES AS DEEMED NECESSARY THROUGHOUT CONSTRUCTION.
3. THE CONTRACTOR IS RESPONSIBLE TO MAINTAIN ALL SEDIMENT CONTROL DEVICES IN A FUNCTIONAL ORDER AND REPLACE ALL BLOCKED SEDIMENT DEVICES AS REQUIRED UNTIL SUCCESSFUL OFF MAINTENANCE OF WORKS.
4. CONSTRUCTION OF ALL SEDIMENT MANAGEMENT DEVICES TO THE SATISFACTION OF THE SUPERINTENDENT SHALL BE COMPLETED AND EFFECTIVE PRIOR TO:
   a. STRIPPING OF TOPSOIL AND GRASS.
   b. BULK EARTHWORKS TO THE SITE.
   c. SERVICES INSTALLATION.
   d. PAVEMENT CONSTRUCTION.
5. ALL SEDIMENT MANAGEMENT MEASURES ARE TO REMAIN IN PLACE UNTIL INSTRUCTION IS RECEIVED IN WRITING FROM THE SUPERINTENDENT TO REMOVE ALL OR PART OF THE SILT CONTROL APPLICATIONS.
6. THE BULK EARTHWORKS AND SEDIMENT CONTROL LAYOUT PLAN SHALL BE READ IN CONJUNCTION WITH THE APPROVED DRAWINGS.
7. PRIOR TO COMMENCEMENT OF CONSTRUCTION APPROVAL IS TO BE OBTAINED FROM THE SUPERINTENDENT FOR THE LOCATION OF THE SITE ACCESS POINT AND WASH DOWN AREA WHICH ARE TO BE MAINTAINED THROUGHOUT THE CONSTRUCTION PERIOD.
8. IF EROSION AND SEDIMENT CONTROL DEVICES HAVE BEEN FOUND TO BE DIFFERENT OR FAILED IN SERVICE, CORRECTIVE ACTION IS TO BE UNDERTAKEN IMMEDIATELY WHICH MAY INCLUDE AMENDMENTS' ADDITIONS TO THE ORIGINAL APPROVED EROSION CONTROL PLANS. SUCH AMENDMENTS ARE TO BE APPROVED BY SUPERINTENDENT, IF DEEMED NECESSARY AND RELEVANT.

OVERALL

9.
   a. TEMPORARY DRAINAGE CONTROL FLOW SHOULD BE DIVERTED AROUND THE WORK SITE WHERE POSSIBLE.
   b. ALL DRAINAGE, EROSION AND SEDIMENT CONTROLS TO BE INSTALLED AND BE OPERATIONAL BEFORE COMMENCING UP-SLOPE EARTHWORKS.
   c. IN AREAS WHERE RUNOFF TURBIDITY IS TO BE CONTROLLED, EXPOSED SURFACES TO BE EITHER MULCHED, COVERED WITH EROSION CONTROL BLANKETS OR TURFED IF EARTHWORKS ARE EXPECTED TO BE DELAYED FOR MORE THAN 14 DAYS.

SEDIMENT FENCE

10. FOR SEDIMENT FENCE STANDARD DETAIL AND SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWINGS SF-01 AND SF-02 SEDIMENT FENCE.

TEMPORARY CONSTRUCTION ENTRY/EXIT

11. FOR CONSTRUCTION ENTRY / EXIT STANDARD DETAIL AND SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWINGS EXIT-01 AND EXIT-02 CONSTRUCTION EXIT - ROCK PAD (CONSTRUCTION SITES ONLY), EXIT-04 AND EXIT-05 CONSTRUCTION EXIT - VIBRATION GRID.

CHECK DAMS

12. FOR CHECK DAM STANDARD DETAIL AND SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWING RCD-01 CHECK DAMS.

REVEGETATION

13. FOR REVEGETATION STANDARD SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWING R-01 REVEGETATION GENERAL.

FIELD INLET SEDIMENT TRAP

14. FOR FIELD INLET STANDARD DETAIL AND SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWING ESC-02 GRATED STORMWATER (FIELD) INLET SEDIMENT TRAP.

ROCK FILTER DAM

15. FOR ROCK FILTER DAM DETAIL & SPECIFICATION REFER TO INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWING RFD-03 ROCK FILTER DAM PART 1 & RFD-04 ROCK FILTER DAM PART 2.

OPERATION AND MAINTENANCE

16. IN ACCORDANCE WITH DENR REQUIREMENTS, ALL ESC MEASURES SHALL BE INSPECTED:
   - AT LEAST DAILY (WHEN WORK IS OCCURRING ON SITE) OR WEEKLY (WHEN WORK IS NOT OCCURRING ON SITE)
   - WITHIN 24 HOURS OF EXPECTED RAIN; AND
   - WITHIN 18 HOURS OF A RAINFALL EVENT (I.E. AN EVENT OF SUFFICIENT INTENSITY AND DURATION TO MOBILISE SEDIMENT ON SITE).

DUST SUPPRESSION

17. SHORT TERM
   - WATER TRUCK SPRAY.
20. LONG TERM
   - SOIL STABILISATION (SOIL BINDER OR MULCH).
   - GRAVEL COVER.
   - TEMPORARY GRASS SEEDING.

IECA STANDARD DRAWINGS REGISTER

DRAWING NUMBER	DRAWING DESCRIPTION
EXIT-01	CONSTRUCTION EXIT - ROCK PAD
EXIT-02	CONSTRUCTION EXIT - ROCK PAD
CD-01	CATCH DRAINS
CD-04	CATCH DRAINS (GEOTEXTILE LINED)
RCD-01	CHECK DAMS
FF-01	FILTER FENCE
SF-01	SEDIMENT FENCE
SF-02	SEDIMENT FENCE
ESC-02	GRATED STORMWATER (FIELD) INLET SEDIMENT TRAP
ESC-03	KERB INLET SEDIMENT TRAPS
R-01	REVEGETATION - GENERAL
RFD-03	ROCK FILTER DAM PART 1
RFD-04	ROCK FILTER DAM PART 2

*DRAWINGS TO BE READ IN CONJUNCTION WITH INTERNATIONAL EROSION CONTROL ASSOCIATION AUSTRALASIA (IECA) BEST PRACTICES STANDARD DRAWINGS AND SPECIFICATIONS.

NOTE
1. FOR SEDIMENT & EROSION CONTROL LAYOUT PLANS REFER TO DRGS SED42 - SED55.

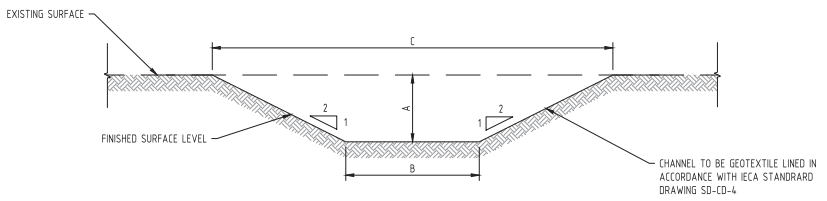

DRAINAGE CHANNEL DETAIL
SCALE: 1:20

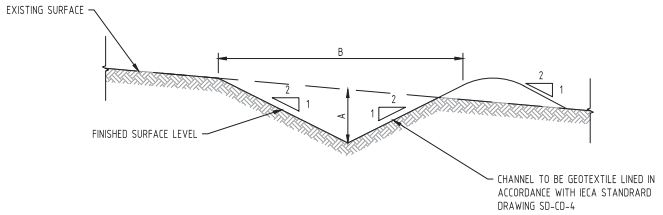

CLEAN WATER DIVERSION DRAIN DETAIL
SCALE: 1:20

DRAINAGE CHANNEL DIMENSIONS

DRAIN ID	DIMENSION A (m)	DIMENSION B (m)	DIMENSION C (m)
T3-4-C2, 5-C1, 8-C1, 8-C2, 18-C5, 23II-C1	0.4	0	1.6
T3-3-C1, 4-C1, 5-C2, 9-C1, 9-C2, 14-C1, 15-C1, 16-C2, 17-C1, 18-C6, 21-C1, 21-C4, 21-E5, 28-C1	0.4	0.5	2.1
T3-6-C1, 10-C1, 15-C2, 16-C1, 18-C7, 19-C1, 20-C1, 22-C1, 24-C1, 25-C3, 29-C1	0.4	1.0	2.6
T3-7-C1, 13-C1, 17-C2, 18-C1, 23I-C1, 24-C3, 30-C1	0.4	1.5	3.1
T3-11-C1, 11-C2, 14-C2, 26-C2	0.4	2.0	3.6
T3-1-C1, 19-C2, 21-C2, 23I-C2	0.4	2.5	5.1
T3-15-C3, 20-C2, 23II-C3, 24-C2	0.4	3.0	4.6
T3-16-C3, 21-C3, 25-C1	0.4	3.5	6.1
T3-18-C2	0.4	4.0	5.6
T3-18-C3	0.4	5.5	7.1
T3-25-C2	0.4	6.0	7.6
T3-18-C4, 26-C1	0.4	7.0	8.6
T3-23II-C2	0.4	12.0	13.6
T3-25-C4	0.4	14.0	15.6

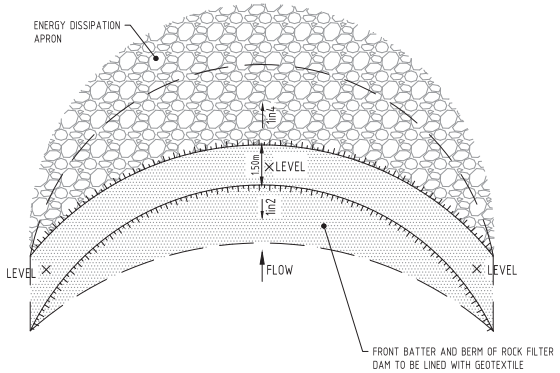

TYPICAL ROCK FILTER DAM DETAIL
SCALE: 1:100

CLEAN WATER DIVERSION DRIAN DIMENSIONS

DRAIN ID	DIMENSION A (m)	DIMENSION B (m)
T3-EXD1, EX2D2, EX3D1, EX3-D2, EX4-D1, EX4-D2, EX5-D1, EX5-D2, EX5-D3, EX5-D4, EX6-D1, EX6-D2, EX7-D1, EX7-D2, EX7-D3, EX7-D4, EX7-D5, EX7-D6, EX8-D2	0.4	1.6
T3-EX8-D1, EX10-D1, EX16-D1	0.5	3 (BASE WIDTH ±1)
T3-EX13-D1	0.5	4.5 (BASE WIDTH ±2.5)

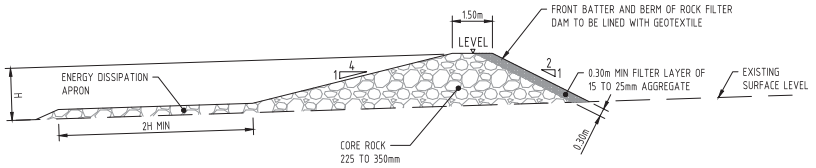

TYPICAL ROCK FILTER DAM SECTION
SCALE: 1:100

ISSUED FOR
INFORMATION ONLY

Rev	Date	Description	By	Chk
02	20.12.21	ISSUED FOR INFORMATION	MD	ML
01	15.12.21	ISSUED FOR INFORMATION	MD	ML

SCALE 1:100
AT ORIGINAL SIZE (A1)

SCALE 1:20
AT ORIGINAL SIZE (A1)

ADG
Brisbane Office
584 Milton Road (Cnr Sylvan Road),
Toowong, Queensland 4066, Australia
PO Box 1492, Toowong BC, Queensland 4066
T 1300 657 402 F +617 3871 2266
E info@adgce.com W www.adgce.com
BRISBANE / DARWIN / GOLD COAST / MELBOURNE / PERTH / SUNSHINE COAST / SYDNEY / TOOWOOMBA

Client	PIONEER FORTUNE PTY LTD
Project Name	MASTER PLANNED COMMUNITY RICE, DAIRY & WYATT ROADS UNDULLAH, QLD 4285
Discipline	CIVIL
Status	INFORMATION
Designed By	MS
Checked By	ML
Approved By	ML
Project No.	23165
Drawn By	MD
Scale at A1	AS SHOWN

The concepts and information contained in this document are the copyright of ADG Engineers (Aust) Pty Ltd. Use or copying of the document in whole or in part without the written permission of ADG Engineers (Aust) Pty Ltd constitutes an infringement of copyright. Do not scale drawings. If in doubt, ask!

Title	TRANCHE 3 SEDIMENT AND EROSION CONTROL NOTES AND DETAILS
Drawing No.	SED56
Revision	02

PLOT DATE: 12/21/2021 1:21 AM — FILENAME: J:\23000\23165\CIVIL\DWG\TRANCHE 3\23165_SED56_TRANCHE 3 SEDIMENT AND EROSION CONTROL NOTES AND DETAILS.DWG

FULL SIZE ON ORIGINAL 0 10 20 30 40 50 60 70 80 90 100mm

Appendix B
IECA Standard Drawings

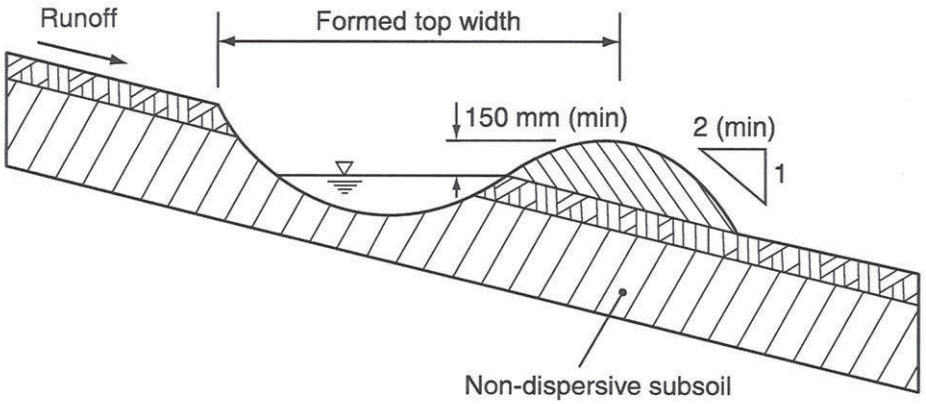

(a) Parabolic catch drain with down-slope bank

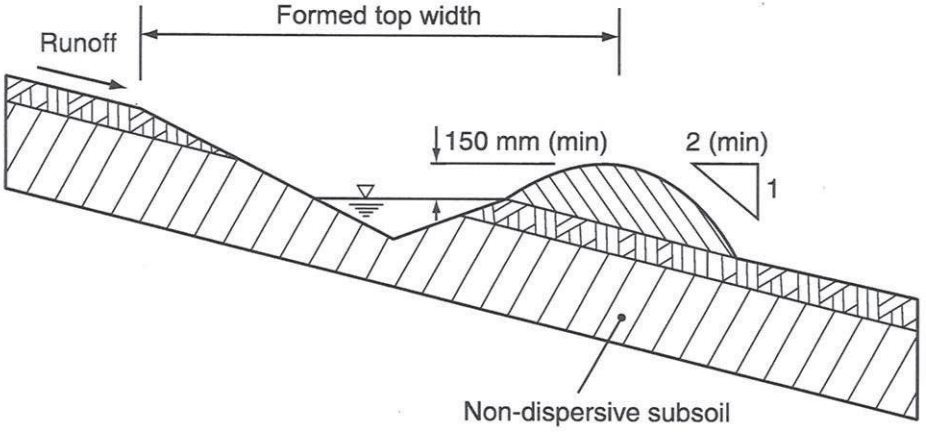

(b) Triangular V-drain with down-slope bank

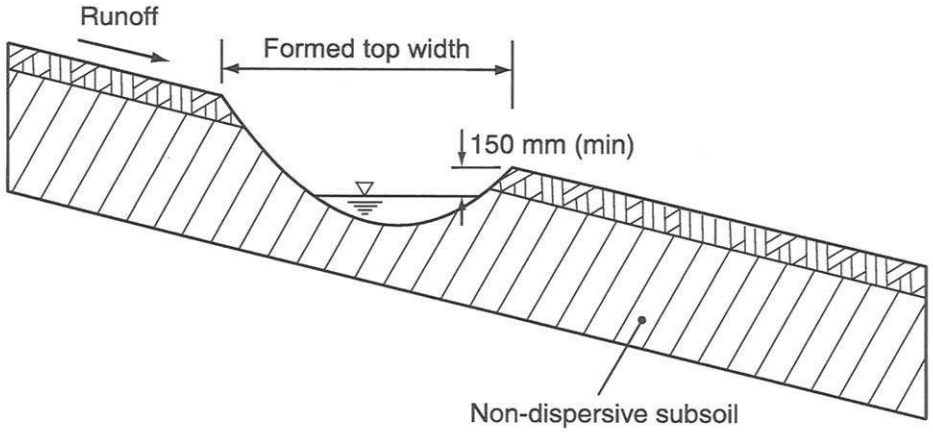

(c) Parabolic catch drain without bank

Constructed dimensions of parabolic catch drains		
Drain type	Formed top width with or without bank	Formed depth with or without bank
Type-A	1.6 m	0.30 m
Type-B	2.4 m	0.45 m
Type-C	3.6 m	0.65 m

Constructed dimensions of triangular V-drains		
Drain type	Formed top width with or without bank	Formed depth with or without bank
Type-AV	2.0 m	0.30 m
Type-BV	2.7 m	0.45 m
Type-CV	3.9 m	0.65 m

NOT TO SCALE

Drawn:	Date:		
GMW	Dec-09	Catch Drains	CD-01

Catchments & Creeks Pty Ltd

INSTALLATION (EARTH-LINED)

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CLEAR THE LOCATION FOR THE CATCH DRAIN, CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

3. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY. DO NOT USE DEBRIS TO BUILD THE BANK.

4. GRADE THE DRAIN TO THE SPECIFIED SLOPE AND FORM THE ASSOCIATED EMBANKMENT WITH COMPACTED FILL. NOTE THAT THE DRAIN INVERT MUST FALL 10cm EVERY 10m FOR EACH 1% OF REQUIRED CHANNEL GRADIENT.

5. ENSURE THE SIDES OF THE CUT DRAIN ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE AND THE EMBANKMENT FILL SLOPES NO STEEPER THAN 2:1.

6. ENSURE THE COMPLETED DRAIN HAS SUFFICIENT DEEP (AS SPECIFIED FOR THE TYPE OF DRAIN) MEASURED FROM THE DRAIN INVERT TO THE TOP OF THE EMBANKMENT.

7. ENSURE THE DRAIN HAS A CONSTANT FALL IN THE DESIRED DIRECTION FREE OF OBSTRUCTIONS.

8. ENSURE THE DRAIN DISCHARGES TO A STABLE OUTLET SUCH THAT SOIL EROSION WILL BE PREVENTED FROM OCCURRING. SPECIFICALLY, ENSURE THE DRAIN DOES NOT DISCHARGE TO AN UNSTABLE FILL SLOPE.

MAINTENANCE

1. INSPECT ALL CATCH DRAINS AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING STORM EVENTS AND REPAIR ANY SLUMPS, BANK DAMAGE, OR LOSS OF FREEBOARD.

2. ENSURE FILL MATERIAL OR SEDIMENT IS NOT PARTIALLY BLOCKING THE DRAIN. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

3. DISPOSE OF ANY SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN THE SOIL DISTURBANCE ABOVE THE CATCH DRAIN IS FINISHED AND THE AREA IS STABILISED, THE TEMPORARY DRAIN AND ANY ASSOCIATED BANKS SHOULD BE REMOVED, UNLESS IT IS TO REMAIN AS A PERMANENT DRAINAGE FEATURE.

2. DISPOSE OF ANY SEDIMENT OR EARTH IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA AND SMOOTH IT OUT IN PREPARATION FOR STABILISATION.

4. STABILISE THE AREA BY GRASSING OR AS SPECIFIED WITHIN THE APPROVED SITE REHABILITATION PLAN.

Catchments & Creeks Pty Ltd

Drawn:	Date:		
GMW	Dec-09	Catch Drains - Earth Lined	CD-02

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE ALL NECESSARY SOIL TESTING (e.g. SOIL pH, NUTRIENT LEVELS) AND ANALYSIS HAS BEEN COMPLETED, AND REQUIRED SOIL ADJUSTMENTS PERFORMED PRIOR TO PLANTING.

3. CLEAR THE LOCATION FOR THE CATCH DRAIN, CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

4. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY. DO NOT USE DEBRIS TO BUILD THE BANK.

5. GRADE THE DRAIN TO THE SPECIFIED SLOPE AND FORM THE ASSOCIATED EMBANKMENT WITH COMPACTED FILL. NOTE THAT THE DRAIN INVERT MUST FALL 10cm EVERY 10m FOR EACH 1% OF CHANNEL GRADIENT.

6. ENSURE THE SIDES OF THE CUT DRAIN ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE AND THE EMBANKMENT FILL SLOPES NO STEEPER THAN 2:1.

7. ENSURE THE COMPLETED DRAIN HAS SUFFICIENT DEEP (AS SPECIFIED FOR THE TYPE OF DRAIN) MEASURED FROM THE DRAIN INVERT TO THE TOP OF THE EMBANKMENT. WHERE NECESSARY, CUT THE DRAIN SLIGHTLY DEEPER THAN THAT SPECIFIED ON THE PLANS SUCH THAT THE CORRECT CHANNEL DIMENSIONS ARE ACHIEVED FOLLOWING PLACEMENT OF THE TURF.

8. ENSURE THE DRAIN HAS A CONSTANT FALL IN THE DESIRED DIRECTION FREE OF OBSTRUCTIONS.

9. TURF SHOULD BE USED WITHIN 12-HOURS OF DELIVERY, OTHERWISE ENSURE THE TURF IS STORED IN CONDITIONS APPROPRIATE FOR THE WEATHER CONDITIONS (e.g. A SHADED AREA).

10. MOISTENING THE TURF AFTER IT IS UNROLLED WILL HELP MAINTAIN ITS VIABILITY.

11. TURF SHOULD BE LAID ON A MINIMUM 75mm BED OF ADEQUATELY FERTILISED TOPSOIL. RAKE THE SOIL SURFACE TO BREAK THE CRUST JUST BEFORE LAYING THE TURF.

12. DURING THE WARMER MONTHS, LIGHTLY IRRIGATE THE SOIL IMMEDIATELY BEFORE LAYING THE TURF.

13. ENSURE THE TURF IS NOT LAID ON GRAVEL, HEAVILY COMPACTED SOILS, OR SOILS THAT HAVE BEEN RECENTLY TREATED WITH HERBICIDES.

14. FOR WIDE DRAINS AND HIGH VELOCITY CHUTES, LAY THE FIRST ROW OF TURF IN A STRAIGHT LINE DIAGONAL TO THE DIRECTION OF FLOW. STAGGER SUBSEQUENT ROWS IN A BRICK-LIKE (STRETCHER BOND) PATTERN. THE TURF SHOULD NOT BE STRETCHED OR OVERLAPPED. USE A KNIFE OR SHARP SPADE TO TRIM AND FIT IRREGULARLY SHAPED AREAS.

15. FOR NARROW DRAINS, LAY THE TURF ALONG THE DIRECTION OF THE DRAIN, ENSURING, WHEREVER PRACTICABLE, THAT A LONGITUDINAL JOINT BETWEEN TWO STRIPS OF TURF IS NOT POSITIONED ALONG THE INVERT OF THE DRAIN.

16. ENSURE THE TURF EXTENDS UP THE SIDES OF THE DRAIN AT LEAST 100mm ABOVE THE ELEVATION OF THE CHANNEL INVERT, OR AT LEAST TO A SUFFICIENT ELEVATION TO FULLY CONTAIN EXPECTED CHANNEL FLOW.

17. ON CHANNEL GRADIENTS OF 3:1(H:V) OR STEEPER, OR IN SITUATIONS WHERE HIGH FLOW VELOCITIES (i.e. VELOCITY >1.5m/s) ARE LIKELY WITHIN THE FIRST 2-WEEKS FOLLOWING PLACEMENT, SECURE THE INDIVIDUAL TURF STRIPS WITH WOODEN OR PLASTIC PEGS.

18. ENSURE THAT INTIMATE CONTACT IS ACHIEVED AND MAINTAINED BETWEEN THE TURF AND THE SOIL SUCH THAT SEEPAGE FLOW BENEATH THE TURF IS AVOIDED.

19. WATER UNTIL THE SOIL IS WET 100mm BELOW THE TURF. THEREAFTER, WATERING SHOULD BE SUFFICIENT TO MAINTAIN AND PROMOTE HEALTHY GROWTH.

20. ENSURE THE DRAIN DISCHARGES TO A STABLE OUTLET SUCH THAT DOWN-SLOPE SOIL EROSION WILL BE PREVENTED FROM OCCURRING. ENSURE THE DRAIN DOES NOT DISCHARGE TO AN UNSTABLE FILL SLOPE.

MAINTENANCE

1. INSPECT ALL CATCH DRAINS AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING STORM EVENTS AND REPAIR ANY SLUMPS, BANK DAMAGE, OR LOSS OF FREEBOARD.

2. ENSURE FILL MATERIAL OR SEDIMENT IS NOT PARTIALLY BLOCKING THE DRAIN. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

3. DISPOSE OF ANY SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN THE SOIL DISTURBANCE ABOVE THE CATCH DRAIN IS FINISHED AND THE AREA IS STABILISED, THE DRAIN AND ANY ASSOCIATED BANKS SHOULD BE REMOVED, UNLESS IT IS TO REMAIN AS A PERMANENT DRAINAGE FEATURE.

2. DISPOSE OF ANY SEDIMENT OR EARTH IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA AND SMOOTH IT OUT IN PREPARATION FOR STABILISATION.

4. STABILISE THE AREA BY GRASSING OR AS SPECIFIED WITHIN THE APPROVED PLAN.

Drawn:	Date:		
GMW	Dec-09	Catch Drains - Grass Lined	CD-03

Catchments & Creeks Pty Ltd

INSTALLATION (DRAIN FORMATION)

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CLEAR THE LOCATION FOR THE CATCH DRAIN, CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

3. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY. DO NOT USE DEBRIS TO BUILD THE BANK.

4. GRADE THE DRAIN TO THE SPECIFIED SLOPE AND FORM THE ASSOCIATED EMBANKMENT WITH COMPACTED FILL. NOTE THAT THE DRAIN INVERT MUST FALL 10cm EVERY 10m FOR EACH 1% OF CHANNEL GRADIENT.

5. ENSURE THE SIDES OF THE CUT DRAIN ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE AND THE EMBANKMENT FILL SLOPES NO STEEPER THAN 2:1.

6. ENSURE THE COMPLETED DRAIN HAS SUFFICIENT DEEP (AS SPECIFIED FOR THE TYPE OF DRAIN) MEASURED FROM THE DRAIN INVERT TO THE TOP OF THE EMBANKMENT.

7. ENSURE THE DRAIN HAS A CONSTANT FALL IN THE DESIRED DIRECTION FREE OF OBSTRUCTIONS.

8. ENSURE THE DRAIN DISCHARGES TO A STABLE OUTLET SUCH THAT SOIL EROSION WILL BE PREVENTED FROM OCCURRING. ENSURE THE DRAIN DOES NOT DISCHARGE TO AN UNSTABLE FILL SLOPE.

INSTALLATION (MAT PLACEMENT)

THE METHOD OF MAT INSTALLATION VARIES WITH THE TYPE OF MAT. INSTALLATION PROCEDURES SHOULD BE PROVIDED BY THE MANUFACTURER OR DISTRIBUTOR OF THE PRODUCT. A TYPICAL INSTALLATION PROCEDURE IS DESCRIBED BELOW, BUT SHOULD BE CONFIRMED WITH THE PRODUCT MANUFACTURER OR DISTRIBUTOR.

1. EROSION CONTROL MATS MUST BE STORED AWAY FROM DIRECT SUNLIGHT OR COVERED WITH ULTRAVIOLET LIGHT PROTECTIVE SHEETING UNTIL THE SITE IS READY FOR THEIR INSTALLATION.

2. VEHICLES AND CONSTRUCTION EQUIPMENT MUST NOT BE PERMITTED TO MANOEUVRE OVER THE GEOTEXTILE UNLESS IT HAS BEEN COVERED WITH A LAYER OF SOIL OR GRAVEL AT LEAST 150mm THICK. FILL MATERIAL SHALL NOT BE MIXED OVER THE GEOTEXTILE.

3. IF THE CHANNEL IS TO BE GRASSED, PREPARE A SMOOTH SEED BED OF APPROXIMATELY 75mm OF TOPSOIL, SEED, FERTILISE, WATER AND RAKE TO REMOVE ANY REMAINING SURFACE IRREGULARITIES.

4. EXCAVATE A 300mm DEEP BY 150mm WIDE ANCHOR TRENCH ALONG THE FULL WIDTH OF THE UPSTREAM END OF THE AREA TO BE TREATED.

5. AT LEAST 300mm OF THE MAT MUST BE ANCHORED INTO THE TRENCH WITH THE ROLL OF MATTING RESTING ON THE GROUND UP-SLOPE OF THE TRENCH.

6. STAPLE THE FABRIC WITHIN THE TRENCH AT 200 TO 250mm SPACING USING 100mm WIDE BY 150mm PENETRATION LENGTH U-SHAPED, 8 TO 11 GAUGE WIRE STAPLES. NARROWER U-SECTIONS MAY EASILY TEAR THE MATTING WHEN PLACED UNDER STRESS.

7. WHEN ALL MATS HAVE BEEN ANCHORED WITHIN THE TRENCH ACROSS THE FULL WIDTH OF THE TREATED AREA, THEN THE TRENCH IS BACKFILLED AND COMPACTED. THE MATS ARE THEN UNROLLED DOWN THE SLOPE SUCH THAT EACH MAT COVERS AND PROTECTS THE BACKFILLED TRENCH.

8. WHEN SPREADING THE MATS, AVOID STRETCHING THE FABRIC. THE MATS SHOULD REMAIN IN GOOD CONTACT WITH THE SOIL.

9. IF THE CHANNEL CURVES, THEN SUITABLY FOLD (IN A DOWNSTREAM DIRECTION) AND STAPLE THE FABRIC TO MAINTAIN THE FABRIC PARALLEL TO THE DIRECTION OF CHANNEL FLOW.

10. STAPLE THE SURFACE OF THE MATTING AT 1m CENTRES. ON IRREGULAR GROUND, ADDITIONAL STAPLES WILL BE REQUIRED WHEREVER THE MAT DOES NOT INITIALLY CONTACT THE GROUND SURFACE.

11. AT THE END OF EACH LENGTH OF MAT, A NEW TRENCH IS FORMED AT LEAST 300mm UP-SLOPE OF THE END OF THE MAT SUCH THAT THE END OF THE MAT WILL BE ABLE TO FULLY COVER THE TRENCH. A NEW ROLL OF MATTING IS THEN ANCHORED WITHIN THIS TRENCH AS PER THE FIRST MAT. AFTER THIS NEW MAT HAS BEEN UNROLLED DOWN THE SLOPE, THE UP-SLOPE MAT CAN BE PINNED IN PLACE FULLY COVERING THE NEW TRENCH AND AT LEAST 300mm OF THE DOWN-SLOPE MAT. THE PROCESS IS CONTINUED DOWN THE SLOPE UNTIL THE DESIRED AREA IS FULLY COVERED.

12. IN HIGH-VELOCITY CHANNELS, INTERMEDIATE ANCHOR SLOTS ARE USUALLY REQUIRED AT 10M INTERVALS DOWN THE CHANNEL.

13. ANCHOR THE OUTER MOST EDGES (TOP AND UPPER MOST SIDES) OF THE TREATED AREA IN A 300mm DEEP TRENCH AND STAPLE AT 200 TO 250mm CENTRES.

14. IF THE CHANNEL WAS GRASS SEEDED PRIOR TO PLACEMENT OF THE MATS, THEN THE MATS SHOULD BE ROLLED WITH A SUITABLE ROLLER WEIGHING 60 TO 90kg/m, THEN WATERED.

15. THE INSTALLATION PROCEDURE MUST ENSURE THAT THE MAT ACHIEVES AND RETAINS GOOD CONTACT WITH THE SOIL.

16. DAMAGED MATTING MUST BE REPAIRED OR REPLACED.

ADDITIONAL INSTRUCTIONS FOR THE INSTALLATION OF JUTE MESH (NOT JUTE BLANKETS):

1. ENSURE THE JUTE MESH IS LAID ON A FIRM EARTH SURFACE THAT HAS BEEN TRIMMED, TOPSOILED, WATERED, SOWN WITH SEED AND FERTILISER.

2. THE JUTE MESH IS THEN EITHER TAMPED OR ROLLED FIRMLY ONTO THE PREPARED SURFACE, AVOIDING STRETCHING, WATERED TO ENCOURAGE THE PENETRATION OF THE BITUMEN EMULSION, AND FINALLY SPRAYED WITH A TOP LAYER OF BITUMEN AT 1 TO 3 LITRES PER SQUARE METRE.

3. THE RATE OF EMULSION APPLICATION SHOULD BE ADJUSTED SUCH THAT THE EMULSION JUST STARTS TO POND IN THE MESH SQUARES.

MAINTENANCE

1. INSPECT ALL CATCH DRAINS AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING STORM EVENTS AND REPAIR ANY SLUMPS, BANK DAMAGE, OR LOSS OF FREEBOARD.

2. ENSURE FILL MATERIAL OR SEDIMENT IS NOT PARTIALLY BLOCKING THE DRAIN. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

3. DISPOSE OF ANY SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN THE SOIL DISTURBANCE ABOVE THE CATCH DRAIN IS FINISHED AND THE AREA IS STABILISED, THE DRAIN AND ANY ASSOCIATED BANKS SHOULD BE REMOVED, UNLESS IT IS TO REMAIN AS A PERMANENT DRAINAGE FEATURE.

2. DISPOSE OF ANY SEDIMENT OR EARTH IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA AND SMOOTH IT OUT IN PREPARATION FOR STABILISATION.

4. STABILISE THE AREA BY GRASSING OR AS SPECIFIED WITHIN THE APPROVED PLAN.

Catchments & Creeks Pty Ltd

Drawn:	Date:		
GMW	May-10	Catch Drains - Geotextile Lined	CD-04

MATERIALS

ROCK:
(i) ALL ROCK MUST BE HARD, WEATHER RESISTANT, AND DURABLE AGAINST DISINTEGRATION UNDER CONDITIONS TO BE MET IN HANDLING, PLACEMENT AND OPERATION.

(ii) ALL ROCK MUST HAVE ITS GREATEST DIMENSION NOT GREATER THAN 3 TIMES ITS LEAST DIMENSIONS.

(iii) THE ROCK USED IN FORMATION OF THE DRAIN MUST BE EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE AND HAVE SUFFICIENT SMALL ROCK TO FILL THE VOIDS BETWEEN THE LARGER ROCK. DIRT, FINES, AND SMALLER ROCK MUST NOT EXCEED 5% BY WEIGHT.

(iv) THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE. SPECIFIC GRAVITY TO BE AT LEAST 2.5.

(v) THE COLOUR OF THE RIPRAP SHALL BE [INSERT] AND MUST BE APPROVED BY THE ENGINEER. ONCE APPROVED, THE COLOUR SHALL BE KEPT CONSISTENT THROUGH THE PROJECT.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. PRIOR TO PLACEMENT, ALL ROCKS MUST BE VISUALLY CHECKED FOR SIZE, ELONGATION, CRACKS, DETERIORATION AND OTHER VISIBLE. THE DEGREE AND THOROUGHNESS OF SUCH CHECKING MUST BE APPROPRIATE FOR THE POTENTIAL CONSEQUENCES ASSOCIATED WITH FAILURE OF THE STRUCTURE OR PURPOSE FOR WHICH THE MATERIAL WILL BE USED.

3. CLEAR THE LOCATION FOR THE CATCH DRAIN, CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

4. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY. DO NOT USE DEBRIS TO BUILD THE BANK.

5. REMOVE ALL SOFT, YIELDING MATERIAL; REPLACE WITH SUITABLE ON-SITE MATERIAL; COMPACT TO SMOOTH FIRM SURFACE.

6. EXCAVATE THE DRAIN TO THE LINES AND GRADES SHOWN ON THE APPROVED PLANS. OVER-CUT THE DRAIN TO A DEPTH EQUAL TO THE SPECIFIED DEPTH OF ROCK PLACEMENT SUCH THAT THE FINISHED TOP SURFACE WILL BE AT THE ELEVATION OF THE SURROUNDING LAND. PLACEMENT OF THE ROCK LINING MUST NOT REDUCE THE DRAIN'S TOP WIDTH AND DEPTH AS SPECIFIED WITHIN THE APPROVED PLANS.

7. GRADE THE DRAIN TO THE SPECIFIED SLOPE AND FORM THE ASSOCIATED EMBANKMENT WITH COMPACTED FILL. NOTE THAT THE DRAIN INVERT MUST FALL 10CM EVERY 10m FOR EACH 1% OF CHANNEL GRADIENT.

8. ENSURE THE SIDES OF THE CUT DRAIN ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE AND THE EMBANKMENT FILL SLOPES NO STEEPER THAN 2:1.

9. IF THE DRAIN IS CUT INTO A DISPERSIVE (SODIC) SOIL, THEN PRIOR TO PLACING FILTER CLOTH, THE EXPOSED DISPERSIVE SOIL MUST BE COVERED WITH A MINIMUM 200mm THICK LAYER OF NON-DISPERSIVE SOIL PRIOR TO PLACEMENT OF FILTER CLOTH OR ROCKS.

10. IF A FILTER CLOTH UNDERLAY IS SPECIFIED, PLACE THE FILTER FABRIC DIRECTLY ON THE PREPARED FOUNDATION. IF MORE THAN ONE SHEET OF FILTER CLOTH IS REQUIRED TO OVER THE AREA, OVERLAP THE EDGE OF EACH SHEET AT LEAST 300mm, AND SECURE ANCHOR PINS AT MINIMUM 1M SPACING ALONG THE OVERLAP.

11. ENSURE THE FILTER CLOTH IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE FABRIC AND THE ROCK. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

12. PLACEMENT OF ROCK SHOULD FOLLOW IMMEDIATELY AFTER PLACEMENT OF THE FILTER LAYER. PLACE ROCK SO THAT IT FORMS A DENSE, WELL-GRADED MASS OF ROCK WITH A MINIMUM OF VOIDS.

13. PLACE ROCK LINING TO THE EXTENT AND DEPTH INDICATED WITHIN THE APPROVED PLANS.

14. ENSURE THE ROCK IS PLACED IN AN APPROPRIATE MANNER TO AVOID DISPLACING UNDERLYING MATERIALS OR PLACING UNDUE IMPACT FORCE ON THE BEDDING MATERIALS.

15. ENSURE THE ROCK IS PLACED WITH A MINIMUM THICKNESS OF 1.5 TIMES THE NOMINAL ROCK SIZE (D50).

16. ENSURE MATERIALS THAT ARE D50 AND LARGER ARE POSITIONED FLUSH WITH THE TOP SURFACE WITH FACES AND SHAPES MATCHED TO MINIMISE VOIDS.

17. ENSURE PROJECTIONS ABOVE OR DEPRESSIONS UNDER THE SPECIFIED TOP SURFACE ARE LESS THAN 20% OF THE ROCK LAYER THICKNESS. THE AVERAGE SURFACE PLANE OF THE FINISHED ROCK IS DEFINED AS THE PLANE WHERE 50% OF THE TOPS OF ROCKS WOULD CONTACT.

18. ENSURE THE COMPLETED DRAIN HAS SUFFICIENT DEEP (AS SPECIFIED FOR THE TYPE OF DRAIN) MEASURED FROM THE DRAIN INVERT (AVERAGE SURFACE PLANE ALONG CHANNEL INVERT) TO THE TOP OF THE EMBANKMENT. THE AVERAGE SURFACE PLANE OF THE FINISHED ROCK IS DEFINED AS THE PLANE WHERE 50% OF THE TOPS OF ROCKS WOULD CONTACT.

19. TO THE MAXIMUM DEGREE PRACTICABLE, THE MATERIAL BETWEEN LARGER ROCK MUST NOT BE LOOSE OR EASILY DISPLACED BY THE EXPECTED FLOW.

20. AFTER PLACEMENT OF THE ROCK LINING, ENSURE THE DRAIN HAS A CONSTANT FALL IN THE DESIRED DIRECTION FREE OF OBSTRUCTIONS.

21. ENSURE THE DRAIN DISCHARGES TO A STABLE OUTLET SUCH THAT SOIL EROSION WILL BE PREVENTED FROM OCCURRING. ENSURE THE DRAIN DOES NOT DISCHARGE TO AN UNSTABLE FILL SLOPE.

MAINTENANCE

1. INSPECT ALL CATCH DRAINS AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING STORM EVENTS AND REPAIR ANY SLUMPS, BANK DAMAGE, OR LOSS OF FREEBOARD.

2. CLOSELY INSPECT THE OUTER EDGES OF THE ROCK PROTECTION. ENSURE WATER ENTRY INTO THE ROCK-LINED AREA IS NOT CAUSING EROSION ALONG THE EDGE OF THE ROCK PROTECTION.

3. CAREFULLY CHECK THE STABILITY OF THE ROCK LOOKING FOR INDICATIONS OF PIPING, SCOUR HOLES, OR BANK FAILURES.

4. REPLACE OR REPOSITION THE SURFACE ROCK SUCH THAT THE DRAIN FUNCTIONS AS REQUIRED AND THE DRAIN'S REQUIRED HYDRAULIC CAPACITY IS NOT REDUCED.

5. REPLACE ANY DISPLACED ROCK WITH ROCK OF A SIGNIFICANTLY (MINIMUM 110%) LARGER SIZE THAN THE DISPLACED ROCK.

6. ENSURE SEDIMENT IS NOT PARTIALLY BLOCKING THE DRAIN. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

7. DISPOSE OF ANY SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

Drawn:	Date:		
GMW	Dec-09	Catch Drains - Rock Lined	CD-05

Catchments & Creeks Pty Ltd

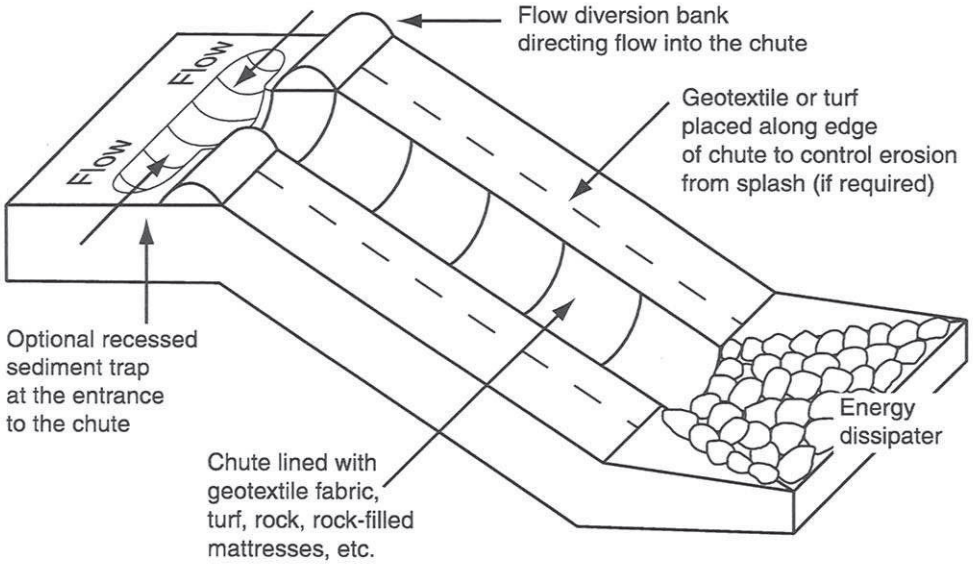

(a) Temporary drainage chute with rock pad outlet structure

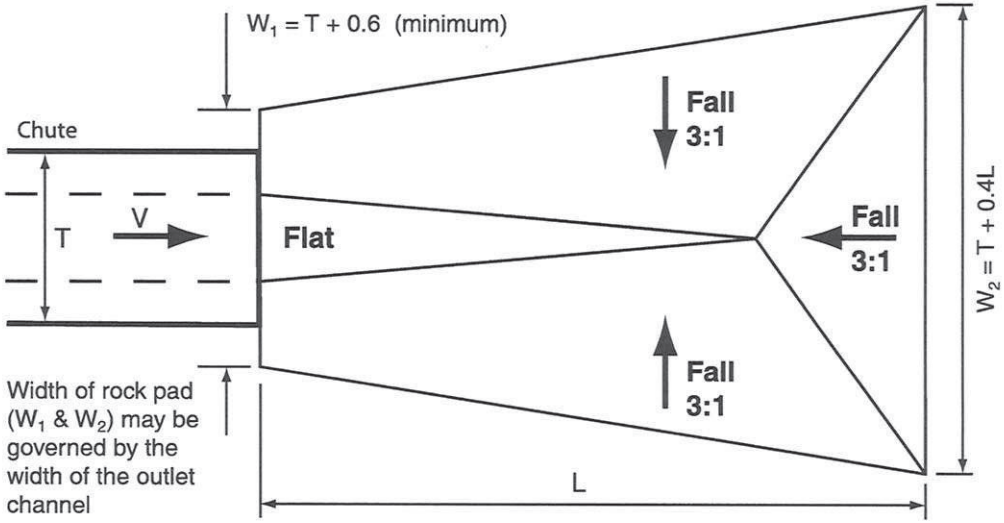

T = Maximum top width of flow at base of chute

(b) Typical layout of an outlet energy dissipater for a drainage chute

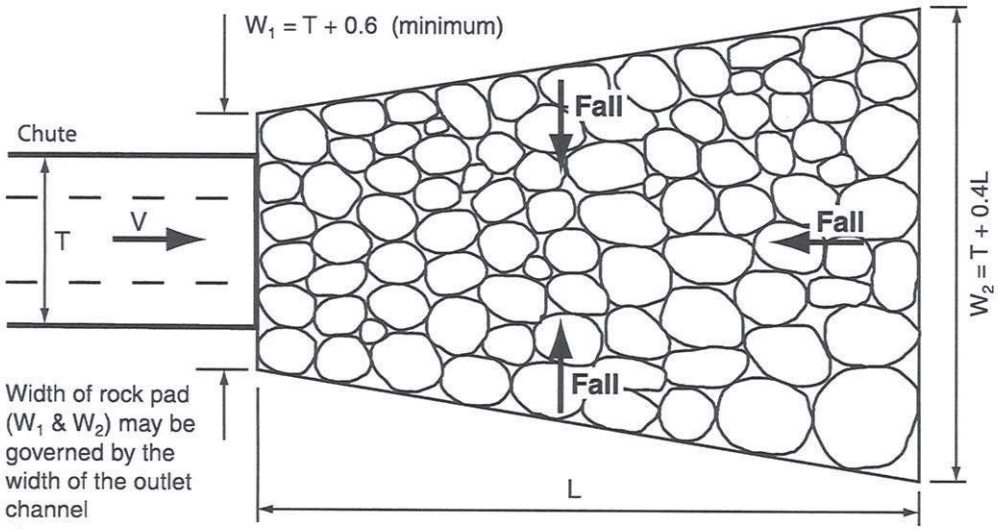

(c) Typical layout of a rock pad outlet structure for a drainage chute

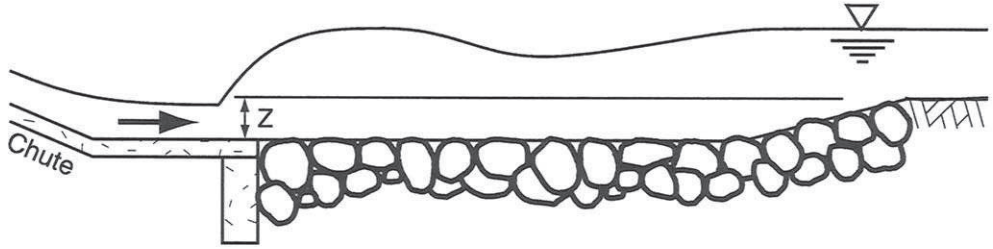

(d) Typical profile of a rock pad outlet structure for a drainage chute

Notes:

1. Drawings applicable to temporary drainage chutes, **not** basin spillways.
2. A rock pad outlet structure is just one option for the design of the outlet energy dissipater.

Drawn:	Date:		
GMW	Dec-09	Chutes - General	CH-01

Catchments & Creeks Pty Ltd

CHUTES - GENERAL SPECIFICATIONS

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CONSTRUCT THE SUBGRADE TO THE ELEVATIONS SHOWN ON THE PLANS. REMOVE ALL UNSUITABLE MATERIAL AND REPLACE WITH STABLE MATERIAL TO ACHIEVE THE DESIRED FOUNDATIONS.

3. IF THE CHUTE IS TEMPORARY, THEN COMPACT THE SUBGRADE TO A FIRM CONSISTENCY. IF THE CHUTE IS INTENDED TO BE PERMANENT, THEN COMPACT AND FINISH THE SUBGRADE AS SPECIFIED WITHIN THE DESIGN PLANS.

4. IF THE CHUTE IS TO BE LINED WITH ROCK, THEN AVOID COMPACTING THE SUBGRADE TO A CONDITION THAT WOULD PREVENT THE ROCK LINING FROM ADEQUATELY BEDDING INTO THE SUBGRADE.

5. ENSURE THE SUBGRADE IS FIRM ENOUGH TO MINIMISE WATER SEEPAGE.

6. ON FILL SLOPES, ENSURE THAT THE SOIL IS ADEQUATELY COMPACTED FOR A WIDTH OF AT LEAST ONE METRE EACH SIDE OF THE CHUTE TO MINIMISE THE RISK OF SOIL EROSION, OTHERWISE PROTECT THE SOIL WITH SUITABLE SCOUR PROTECTION MEASURES SUCH AS TURF OR EROSION CONTROL MATS.

7. PLACE AND SECURE THE CHUTE LINING AS DIRECTED.

8. IF CONCRETE IS USED AS A LINING, THEN KEEP THE SUBGRADE MOIST AT THE TIME CONCRETE IS PLACED. FORM, CUT-OFF WALLS AND ANCHOR BLOCKS AS DIRECTED IN THE APPROVED PLANS.

9. INSTALL AN APPROPRIATE OUTLET STRUCTURE (ENERGY DISSIPATER) AT THE BASE OF THE CHUTE (REFER TO SEPARATE SPECIFICATIONS).

10. ENSURE WATER LEAVING THE CHUTE AND THE OUTLET STRUCTURE WILL FLOW FREELY WITHOUT CAUSING UNDESIRABLE PONDING OR SCOUR.

11. APPROPRIATELY STABILISE ALL DISTURBED AREAS IMMEDIATELY AFTER CONSTRUCTION.

MAINTENANCE

1. DURING THE CONSTRUCTION PERIOD, INSPECT ALL CHUTES PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING STORM EVENTS, OR OTHERWISE ON A WEEKLY BASIS. MAKE REPAIRS AS NECESSARY.

2. CHECK FOR MOVEMENT OF, OR DAMAGE TO, THE CHUTE LINING, INCLUDING SURFACE CRACKING.

3. CHECK FOR SOIL SCOUR ADJACENT THE CHUTE. INVESTIGATE THE CAUSE OF ANY SCOUR, AND REPAIR AS NECESSARY.

4. WHEN MAKING REPAIRS, ALWAYS RESTORE THE CHUTE TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED.

REMOVAL

1. TEMPORARY CHUTES SHOULD BE REMOVED WHEN AN ALTERNATIVE, STABLE, DRAINAGE SYSTEM IS AVAILABLE.

2. REMOVE ALL MATERIALS AND DEPOSITED SEDIMENT, AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA IN PREPARATION FOR STABILISATION, THEN STABILISE THE AREA AS SPECIFIED IN THE APPROVED PLAN.

ADDITIONAL SPECIFICATIONS FOR ROCK PAD OUTLET STRUCTURE AT BASE OF CHUTE:

MATERIALS:

ROCK: HARD, ANGULAR, DURABLE, WEATHER RESISTANT AND EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE AND SUFFICIENT SMALL ROCK TO FILL THE VOIDS BETWEEN THE LARGER ROCK. THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE. SPECIFIC GRAVITY TO BE AT LEAST 2.5.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION (ROCK OUTLET PADS)

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, DIMENSIONS OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. THE DIMENSIONS OF THE OUTLET STRUCTURE MUST ALIGN WITH THE DOMINANT FLOW DIRECTION.

3. EXCAVATE THE OUTLET PAD FOOTPRINT TO THE SPECIFIED DIMENSION SUCH THE WHEN THE ROCK IS PLACED IN THE EXCAVATED PIT THE TOP OF THE ROCKS WILL BE LEVEL WITH THE SURROUNDING GROUND, UNLESS OTHERWISE DIRECTED.

4. IF THE EXCAVATED SOILS ARE DISPERSIVE, OVER-EXCAVATED THE ROCK PAD BY AT LEAST 300mm AND BACKFILL WITH STABLE, NON-DISPERSIVE MATERIAL.

5. LINE THE EXCAVATED PIT WITH GEOTEXTILE FILTER CLOTH, PREFERABLY USING A SINGLE SHEET. IF JOINTS ARE REQUIRED, OVERLAP THE FABRIC AT LEAST 300mm.

6. ENSURE THE FILTER CLOTH IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE FABRIC AND THE ROCK. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

7. ENSURE THERE ARE AT LEAST TWO LAYERS OF ROCKS. WHERE NECESSARY, REPOSITION THE LARGER ROCKS TO ENSURE TWO LAYERS OF ROCKS ARE ACHIEVED WITHOUT ELEVATING THE UPPER SURFACE ABOVE THE PIPE INVERT.

8. ENSURE THE ROCK IS PLACED IN A MANNER THAT WILL ALLOW WATER TO DISCHARGE FREELY FROM THE PIPE.

9. ENSURE THE UPPER SURFACE OF THE ROCK PAD DOES NOT CAUSE WATER TO BE DEFLECTED AROUND THE EDGE OF THE ROCK PAD.

10. IMMEDIATELY AFTER CONSTRUCTION, APPROPRIATELY STABILISE ALL DISTURBED AREAS.

MAINTENANCE

1. WHILE CONSTRUCTION WORKS CONTINUE ON THE SITE, INSPECT THE OUTLET STRUCTURE PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING RAINFALL, AND ON AT LEAST A WEEKLY BASIS.

2. REPLACE ANY DISPLACED ROCK WITH ROCK OF A SIGNIFICANTLY (MINIMUM 110%) LARGER SIZE THAN THE DISPLACED ROCK.

REMOVAL

1. TEMPORARY OUTLET STRUCTURES SHOULD BE COMPLETELY REMOVED, OR WHERE APPROPRIATE, REHABILITATED SO AS NOT TO CAUSE ONGOING ENVIRONMENTAL NUISANCE OR HARM.

2. FOLLOWING REMOVAL OF THE DEVICE, THE DISTURBED AREA MUST BE APPROPRIATELY REHABILITATED SO AS NOT TO CAUSE ONGOING ENVIRONMENTAL NUISANCE OR HARM.

3. REMOVE MATERIALS AND COLLECTED SEDIMENT AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

Drawn:	Date:		
GMW	Dec-09	Chutes - General	CH-02

Catchments & Creeks Pty Ltd

INSTALLATION (CHUTE FORMATION)

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CLEAR THE LOCATION FOR THE CHUTE CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

3. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY.

4. CONSTRUCT THE SUBGRADE TO THE ELEVATIONS SHOWN ON THE PLANS. REMOVE ALL UNSUITABLE MATERIAL AND REPLACE WITH STABLE MATERIAL TO ACHIEVE THE DESIRED FOUNDATIONS.

5. IF THE CHUTE IS TEMPORARY, THEN COMPACT THE SUBGRADE TO A FIRM CONSISTENCY. IF THE CHUTE IS INTENDED TO BE PERMANENT, THEN COMPACT AND FINISH THE SUBGRADE AS SPECIFIED WITHIN THE DESIGN PLANS.

6. ENSURE THE SUBGRADE IS FIRM ENOUGH TO MINIMISE WATER SEEPAGE.

7. ENSURE THE SIDES OF THE CHUTE ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE.

8. ENSURE THE COMPLETED CHUTE HAS SUFFICIENT DEEP ALONG ITS FULL LENGTH.

9. ENSURE THE CHUTE IS STRAIGHT FROM ITS CREST TO THE TOE OF THE CHUTE.

10. ON FILL SLOPES, ENSURE THAT THE SOIL IS ADEQUATELY COMPACTED FOR A WIDTH OF AT LEAST ONE METRE EACH SIDE OF THE CHUTE TO MINIMISE THE RISK OF SOIL EROSION, OTHERWISE PROTECT THE SOIL WITH SUITABLE SCOUR PROTECTION MEASURES SUCH AS TURF OR EROSION CONTROL MATS.

11. PLACE AND SECURE THE CHUTE LINING (REFER TO SEPARATE SPECIFICATIONS).

12. IF CONCRETE IS USED AS A LINING, THEN KEEP THE SUBGRADE MOIST AT THE TIME CONCRETE IS PLACED. FORM, CUT-OFF WALLS AND ANCHOR BLOCKS AS DIRECTED IN THE APPROVED PLANS.

13. INSTALL AN APPROPRIATE OUTLET STRUCTURE (ENERGY DISSIPATER) AT THE BASE OF THE CHUTE (REFER TO SEPARATE SPECIFICATIONS).

14. ENSURE WATER LEAVING THE CHUTE AND THE OUTLET STRUCTURE WILL FLOW FREELY WITHOUT CAUSING UNDESIRABLE PONDING OR SCOUR.

15. APPROPRIATELY STABILISE ALL DISTURBED AREAS IMMEDIATELY AFTER CONSTRUCTION.

INSTALLATION (FABRIC PLACEMENT)

THE METHOD OF FABRIC INSTALLATION VARIES WITH THE TYPE OF FABRIC. INSTALLATION PROCEDURES SHOULD BE PROVIDED BY THE PRODUCT MANUFACTURER OR DISTRIBUTOR. A TYPICAL INSTALLATION PROCEDURE IS DESCRIBED BELOW, BUT SHOULD BE CONFIRMED WITH THE PRODUCT MANUFACTURER OR DISTRIBUTOR.

1. GEOSYNTHETIC FABRICS MUST BE STORED AWAY FROM DIRECT SUNLIGHT OR COVERED WITH ULTRAVIOLET LIGHT PROTECTIVE SHEETING UNTIL THE SITE IS READY FOR THEIR INSTALLATION.

2. EXCAVATE A 300mm DEEP BY 150mm WIDE ANCHOR TRENCH ALONG THE FULL WIDTH OF THE UPSTREAM END OF THE AREA TO BE TREATED.

3. AT LEAST 300mm OF THE FABRIC MUST BE ANCHORED INTO THE TRENCH WITH THE ROLL OF MATTING RESTING ON THE GROUND UP-SLOPE OF THE TRENCH.

4. STAPLE THE FABRIC WITHIN THE TRENCH AT 200 TO 250mm SPACING USING 100mm WIDE BY 150mm PENETRATION LENGTH U-SHAPED, 8 TO 11 GAUGE WIRE STAPLES. NARROWER U-SECTIONS MAY EASILY TEAR THE MATTING WHEN PLACED UNDER STRESS.

5. WHEN FABRIC HAS BEEN ANCHORED WITHIN THE TRENCH, THEN BACKFILLED THE TRENCH AND COMPACT.

6. WHEN SPREADING THE FABRIC, AVOID STRETCHING THE MATERIAL.

7. ENSURE THE FABRIC REMAINS IN GOOD CONTACT WITH THE SOIL.

8. IF THE INFLOW CHANNEL CURVES (UPSTREAM OF THE CREST), THEN SUITABLY FOLD (IN A DOWNSTREAM DIRECTION) AND STAPLE THE FABRIC TO MAINTAIN THE FABRIC PARALLEL TO THE DIRECTION OF CHANNEL FLOW.

9. STAPLE THE SURFACE OF THE FABRIC AT 1m CENTRES. ON IRREGULAR GROUND, ADDITIONAL STAPLES WILL BE REQUIRED WHEREVER THE FABRIC DOES NOT INITIALLY CONTACT THE GROUND SURFACE.

10. INSTALL INTERMEDIATE ANCHOR TRENCHES AT 3m (MAX) INTERVALS.

11. IF THE CHUTE EXTENDS BEYOND THE LENGTH OF THE FABRIC, THEN FORM A NEW TRENCH IS FORMED AT LEAST 300mm UP-SLOPE OF THE END OF THE FABRIC SUCH THAT THE END OF THE FABRIC WILL BE ABLE TO FULLY COVER THE TRENCH. A NEW ROLL OF FABRIC IS THEN ANCHORED WITHIN THIS TRENCH AS PER THE FIRST. THE PROCESS IS CONTINUED DOWN THE SLOPE UNTIL THE DESIRED AREA IS FULLY COVERED.

12. IF CHUTE IS SUBJECT TO LATERAL INFLOWS, TEN ANCHOR THE OUTER MOST SIDES OF THE FABRIC IN A 300mm DEEP TRENCH AND STAPLE AT 200 TO 250mm CENTRES.

13. THE INSTALLATION PROCEDURE MUST ENSURE THAT THE FABRIC ACHIEVES AND RETAINS GOOD CONTACT WITH THE SOIL.

14. DAMAGED FABRIC MUST BE REPAIRED OR REPLACED.

MAINTENANCE

1. DURING THE CONSTRUCTION PERIOD, INSPECT ALL CHUTES PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING STORM EVENTS, OR OTHERWISE ON A WEEKLY BASIS. MAKE REPAIRS AS NECESSARY.

2. CHECK FOR MOVEMENT OF, OR DAMAGE TO, THE CHUTE LINING, INCLUDING SURFACE CRACKING.

3. CHECK FOR SOIL SCOUR ADJACENT THE CHUTE. INVESTIGATE THE CAUSE OF ANY SCOUR, AND REPAIR AS NECESSARY.

4. ENSURE SEDIMENT IS NOT PARTIALLY BLOCKING FLOW ENTRY INTO THE CHUTE. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

5. DISPOSE OF ANY SEDIMENT IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

6. WHEN MAKING REPAIRS, ALWAYS RESTORE THE CHUTE TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED.

REMOVAL

1. WHEN THE SOIL DISTURBANCE ABOVE THE CHUTE IS FINISHED AND THE AREA IS STABILISED, THE CHUTE AND ANY ASSOCIATED FLOW DIVERSION BANKS SHOULD BE REMOVED, UNLESS IT IS TO REMAIN AS A PERMANENT DRAINAGE FEATURE.

2. DISPOSE OF ANY MATERIALS, SEDIMENT OR EARTH IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA IN PREPARATION FOR STABILISATION, THEN STABILISE THE AREA AS SPECIFIED IN THE APPROVED PLAN.

Drawn:	Date:		
GMW	Dec-09	Chutes - Synthetic Linings	CH-03

Catchments & Creeks Pty Ltd

INSTALLATION (CHUTE FORMATION)

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE ALL NECESSARY SOIL TESTING (e.g. SOIL pH, NUTRIENT LEVELS) AND ANALYSIS HAS BEEN COMPLETED, AND REQUIRED SOIL ADJUSTMENTS PERFORMED PRIOR TO PLANTING.

3. CLEAR THE LOCATION FOR THE CHUTE CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

4. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY.

5. CONSTRUCT THE SUBGRADE TO THE ELEVATIONS SHOWN ON THE PLANS. REMOVE ALL UNSUITABLE MATERIAL AND REPLACE WITH STABLE MATERIAL TO ACHIEVE THE DESIRED FOUNDATIONS.

6. IF THE CHUTE IS TEMPORARY, THEN COMPACT THE SUBGRADE TO A FIRM CONSISTENCY. IF THE CHUTE IS INTENDED TO BE PERMANENT, THEN COMPACT AND FINISH THE SUBGRADE AS SPECIFIED WITHIN THE DESIGN PLANS.

7. AVOID COMPACTING THE SUBGRADE TO A CONDITION THAT WOULD PREVENT THE TURF FROM BONDING WITH THE SUBGRADE.

8. ENSURE THE SIDES OF THE CHUTE ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE.

9. ENSURE THE COMPLETED CHUTE HAS SUFFICIENT DEEP ALONG ITS FULL LENGTH.

10. ENSURE THE CHUTE IS STRAIGHT FROM ITS CREST TO THE TOE OF THE CHUTE.

11. ON FILL SLOPES, ENSURE THAT THE SOIL IS ADEQUATELY COMPACTED FOR A WIDTH OF AT LEAST 1m EACH SIDE OF THE CHUTE TO MINIMISE THE RISK OF SOIL EROSION, OTHERWISE PROTECT THE SOIL WITH SUITABLE SCOUR PROTECTION MEASURES SUCH AS TURF OR EROSION CONTROL MATS.

12. PLACE AND SECURE THE TURF AS DIRECTED.

13. INSTALL AN APPROPRIATE OUTLET STRUCTURE (ENERGY DISSIPATER) AT THE BASE OF THE CHUTE (REFER TO SEPARATE SPECIFICATIONS).

14. ENSURE WATER LEAVING THE CHUTE AND THE OUTLET STRUCTURE WILL FLOW FREELY WITHOUT CAUSING UNDESIRABLE PONDING OR SCOUR.

15. APPROPRIATELY STABILISE ALL DISTURBED AREAS IMMEDIATELY AFTER CONSTRUCTION.

ADDITIONAL REQUIREMENTS WHEN LAYING TURF WITHIN A CHUTE:

1. TURF SHOULD BE USED WITHIN 12-HOURS OF DELIVERY, OTHERWISE ENSURE THE TURF IS STORED IN CONDITIONS APPROPRIATE FOR THE WEATHER CONDITIONS.

2. MOISTENING THE TURF AFTER IT IS UNROLLED WILL HELP MAINTAIN ITS VIABILITY.

3. TURF SHOULD BE LAID ON A MINIMUM 75mm BED OF ADEQUATELY FERTILISED TOPSOIL. RAKE THE SOIL SURFACE TO BREAK THE CRUST JUST BEFORE LAYING THE TURF.

4. DURING THE WARMER MONTHS, LIGHTLY IRRIGATE THE SOIL IMMEDIATELY BEFORE LAYING THE TURF.

5. ENSURE THE TURF IS NOT LAID ON GRAVEL, HEAVILY COMPACTED SOILS, OR SOILS THAT HAVE BEEN RECENTLY TREATED WITH HERBICIDES.

6. LAY THE FIRST ROW OF TURF IN A STRAIGHT LINE DIAGONAL TO THE DIRECTION OF FLOW. STAGGER SUBSEQUENT ROWS IN A BRICK-LIKE (STRETCHER BOND) PATTERN. THE TURF SHOULD NOT BE STRETCHED OR OVERLAPPED. USE A KNIFE OR SHARP SPADE TO TRIM AND FIT IRREGULARLY SHAPED AREAS.

7. ENSURE THE TURF EXTENDS UP THE SIDES OF THE CHANNEL AT LEAST 100mm ABOVE THE ELEVATION OF THE CHANNEL BED, OR AT LEAST TO A SUFFICIENT ELEVATION TO FULLY CONTAIN THE EXPECTED CHANNEL FLOW THAT IS CONSIDERED LIKELY TO OCCUR WITHIN THE FIRST MONTH AFTER PLACEMENT.

8. ON CHUTE GRADIENTS OF 3:1(H:V) OR STEEPER, OR WHEREVER EROSION MAY BE A PROBLEM, OR IN SITUATIONS WHERE HIGH FLOW VELOCITIES (i.e. VELOCITY >1.5m/s) ARE LIKELY WITHIN THE FIRST 2-WEEKS FOLLOWING PLACEMENT, SECURE THE INDIVIDUAL TURF STRIPS WITH WOODEN OR PLASTIC PEGS.

9. ENSURE THAT INTIMATE CONTACT IS ACHIEVED AND MAINTAINED BETWEEN THE TURF AND THE SOIL SUCH THAT SEEPAGE FLOW BENEATH THE TURF IS AVOIDED.

10. WHERE PRACTICABLE, ONCE FIXED IN PLACE, THE TURF SHOULD BE ROLLED WITH A ROLLER WEIGHING 60 TO 90kg/m WIDTH, THEN WATERED.

11. AFTER ROLLING, LIGHTLY SPREAD SCREENED TOPSOIL TO REPLACE TOPSOIL LOST FROM THE TURF AND TO FILL ANY GAPS BETWEEN THE ROWS.

12. WATER UNTIL THE SOIL IS WET 100mm BELOW THE TURF. THEREAFTER, WATERING SHOULD BE SUFFICIENT TO MAINTAIN AND PROMOTE HEALTHY GROWTH.

MAINTENANCE

1. DURING THE CONSTRUCTION PERIOD, INSPECT ALL CHUTES PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING STORM EVENTS, OR OTHERWISE ON A WEEKLY BASIS. MAKE REPAIRS AS NECESSARY.

2. MAINTAIN A HEALTHY AND VIGOROUS GRASS CONDITION WHENEVER AND WHEREVER POSSIBLE, INCLUDING WATERING AND FERTILISING AS NEEDED.

3. ENSURE A MINIMUM GRASS LEAF BLADE LENGTH OF 50mm IS MAINTAINED IN AREAS SUBJECT TO MEDIUM TO HIGH FLOW VELOCITIES, AND 20 TO 50mm IN LOW VELOCITY AREAS.

4. MOWING SHOULD NOT BE ATTEMPTED UNTIL THE TURF IS FIRMLY ROOTED, USUALLY 2 TO 3 WEEKS AFTER LAYING.

5. CHECK FOR MOVEMENT OF, OR DAMAGE TO, THE TURF LINING.

6. CHECK FOR SOIL SCOUR ADJACENT THE CHUTE. INVESTIGATE THE CAUSE OF ANY SCOUR, AND REPAIR AS NECESSARY.

7. ENSURE SEDIMENT IS NOT PARTIALLY BLOCKING FLOW ENTRY INTO THE CHUTE. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

8. DISPOSE OF ANY SEDIMENT IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

9. WHEN MAKING REPAIRS, ALWAYS RESTORE THE CHUTE TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED.

REMOVAL

1. WHEN THE SOIL DISTURBANCE ABOVE THE CHUTE IS FINISHED AND THE AREA IS STABILISED, THE CHUTE AND ANY ASSOCIATED FLOW DIVERSION BANKS SHOULD BE REMOVED, UNLESS IT IS TO REMAIN AS A PERMANENT DRAINAGE FEATURE.

2. GRADE THE AREA IN PREPARATION FOR STABILISATION, THEN STABILISE THE AREA AS SPECIFIED IN THE APPROVED PLAN.

Drawn:	Date:		
GMW	Dec-09	Chutes - Grass Linings	CH-04

Catchments & Creeks Pty Ltd

THE FOLLOWING INSTALLATION PROCEDURE SHOULD BE CONFIRMED WITH THE PRODUCT MANUFACTURER OR DISTRIBUTOR.

MATERIALS

ROCK INFILL: HARD, ANGULAR, DURABLE, WEATHER RESISTANT AND EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE. THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION (ROCK MATTRESSES)

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. MATTRESSES OF DIFFERENT THICKNESSES SHOULD BE STORED ON-SITE IN SEPARATE PILES AND CLEARLY LABELLED.

3. CLEAR THE PROPOSED CHANNEL AREA OF TREES, STUMPS, ROOTS, LOOSE ROCK, AND OTHER OBJECTIONABLE MATERIALS.

4. EXCAVATE THE TREATMENT AREA TO THE LINES AND GRADES AS SHOWN ON THE PLANS. OVER-CUT THE AREA TO A DEPTH EQUAL TO THE SPECIFIED MATTRESS THICKNESS SUCH THAT THE FINISHED SURFACE WILL BE AT THE ELEVATION OF THE SURROUNDING LAND.

5. PLACE FILTER FABRIC DIRECTLY ON THE PREPARED FOUNDATION. IF MORE THAN ONE SHEET OF FILTER CLOTH IS REQUIRED TO OVER THE AREA, OVERLAP THE EDGE OF EACH SHEET AT LEAST 300mm AND PLACE ANCHOR PINS AT MINIMUM 1m SPACING ALONG THE OVERLAP.

6. ENSURE THE FILTER CLOTH IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE MATTRESSES. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

7. FLATTEN OUT EACH MATTRESS ON A HARD, FLAT SURFACE, AND STAMP OUT ANY UNNECESSARY CREASES. EDGE CREASES WILL NEED TO BE STAMPED INTO THE BOTTOM OF THE 2ND AND 4TH INTERNAL DIAPHRAGMS.

8. ENSURE THAT EACH DIAPHRAGM IS VERTICAL AND THE CORRECT HEIGHT. FOLD THE SIDES AND ENDS OF THE MATTRESS TO MEET THE TOP OF THE DIAPHRAGMS. FOLD THE SIDE PANEL FLAPS TO LIE ADJACENT TO THE DIAPHRAGMS. TACK TEMPORARILY EITHER BY USING SHORT LENGTHS OF BINDING WIRE, OR ALTERNATIVELY BY TWISTING THE TOP DIAPHRAGM WIRE OVER THE FLAP SELVEDGE WIRE.

9. THE ENDS OF THE DIAPHRAGMS MUST NOW BE PERMANENTLY LACED TO THE SIDES OF THE MATTRESS. AT THE FOUR CORNERS, BEND THE PROJECTED LENGTHS OF THE END PANELS TO OVERLAP THE SIDES, AND LACE UP WITH BINDING WIRE.

10. WHEN THE MATTRESS IS PLACED OVER A GEOTEXTILE, CARE MUST BE TAKEN TO ENSURE THAT PROJECTING ENDS OF WIRE ARE BENT UPWARDS TO AVOID PUNCTURING OR TEARING THE CLOTH. GEOTEXTILE SHOULD BE PLACED ACCORDING TO SPECIFICATIONS.

11. CARRY THE WIRED-UP MATTRESS TO ITS FINAL POSITION, AND WIRE IT SECURELY TO THE ADJACENT MATTRESSES. MATTRESSES SHOULD BE PLACED AND WIRED TOGETHER EMPTY AS IT IS DIFFICULT TO WIRE MATTRESSES TOGETHER WHEN BOTH ARE FULL OF STONE.

12. ON SLOPES, THE MATTRESS SHOULD GENERALLY BE LAID WITH THE DIAPHRAGM ACROSS THE SLOPE RATHER THAN UP AND DOWN THE SLOPE. ON CHUTE AND STREAM BEDS, THE MATTRESS SHOULD GENERALLY BE LAID WITH THE DIAPHRAGM AT RIGHT ANGLES TO THE MAIN DIRECTION OF WATER FLOW.

13. ALL HAND WIRING MUST BE DONE AS A CONTINUOUS LACING OPERATION. BEGIN WIRING BY SECURING THE BINDING WIRE TO THE CORNER OF THE PANELS TO BE JOINED BY LOOPING IT THROUGH AND TWISTING IT TOGETHER. THEN LACE WITH SINGLE LOOPS AND DOUBLE LOOPS IN TURN AT 100mm INTERVALS. FINALLY POKE THE LOOSE END INSIDE THE MATTRESS. TIGHTNESS OF THE MESH AND WIRING IS ESSENTIAL AT ALL TIMES.

14. PLACE THE FILL MATERIAL, BY HAND OR MECHANICALLY, IN THE COMPARTMENTS, STARTING AT THE BOTTOM IF ON A SLOPE. THE FILL SHOULD BE A HARD, DURABLE STONE, IN SIZE BETWEEN 80mm AND TWO-THIRDS THE THICKNESS OF THE MATTRESS, BUT GENERALLY NO GREATER THAN 200mm.

15. FILLING CAN BE DONE UNIT BY UNIT, BUT SEVERAL UNITS SHOULD BE READY FOR FILLING AT ANY ONE TIME.

16. FOR UNITS WITH PVC COATED WIRE MESH, PARTICULAR CARE SHALL BE TAKEN TO ENSURE THAT SHARP EDGES OF QUARRY STONE ARE NOT PLACED AGAINST THE MESH IN ORDER TO AVOID CAUSING UNNECESSARY ABRASION.

17. SLIGHTLY OVERFILL EACH MATTRESS TO ALLOW FOR SETTLEMENT. TACK THE LID TO THE CORNERS OF THE MATTRESS, AND THEN SECURELY WIRE IT TO THE TOPS OF THE SIDES, ENDS AND DIAPHRAGMS, USING ALTERNATE SINGLE AND DOUBLE LOOPS AS SPECIFIED ABOVE.

18. WITH MORE THAN ONE MATTRESS FILLED, THE EDGES OF ADJACENT LIDS CAN BE WIRED DOWN IN THE SAME OPERATION, SAVING BOTH TIME AND BINDING WIRE.

19. WHEN THE MATTRESS IS LAID ON A SLOPE STEEPER THAN 1.5:1(H:V), IT SHOULD BE SECURED BY STAR PICKETS OR HARDWOOD PEGS DRIVEN INTO THE GROUND JUST INSIDE THE UPPER END PANEL AT 2m CENTRES OR AS NECESSARY.

20. ON SOFT OR SANDY SLOPES, PEGS CAN BE USED TO HOLD THE MATTRESS IN POSITION DURING FILLING.

21. MATTRESSES CAN BE SHORTENED WHERE NECESSARY, BY CUTTING ALONG THE FOLD AT THE TOP OF A DIAPHRAGM AND REMOVING THE BOTTOM SPIRAL CONNECTIONS.

22. ALWAYS CONSULT MANUFACTURER'S SPECIFICATIONS AND ASSEMBLY INSTRUCTIONS BEFORE MODIFYING THE SHAPE OF THE MATTRESS OR WIRING DEFORMED MATTRESS SHAPES.

23. IMMEDIATELY UPON COMPLETION OF THE CHANNEL, VEGETATE ALL DISTURBED AREAS OR OTHERWISE PROTECT THEM AGAINST SOIL EROSION.

24. WHERE SPECIFIED, FILL ALL VOIDS WITH SOIL AND VEGETATE IN ACCORDANCE WITH THE APPROVED PLAN.

MAINTENANCE

1. DURING THE CONSTRUCTION PERIOD, INSPECT ALL CHUTES PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING STORM EVENTS, OR OTHERWISE ON A WEEKLY BASIS. MAKE REPAIRS AS NECESSARY.

2. CHECK FOR SOIL SCOUR ADJACENT THE CHUTE. INVESTIGATE THE CAUSE OF ANY SCOUR, AND REPAIR AS NECESSARY.

3. ENSURE SEDIMENT IS NOT PARTIALLY BLOCKING FLOW ENTRY INTO THE CHUTE. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

4. DISPOSE OF ANY SEDIMENT IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

5. WHEN MAKING REPAIRS, ALWAYS RESTORE THE CHUTE TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED.

Drawn:	Date:		
GMW	May-10	Chutes - Rock Mattress Linings	CH-05

Catchments & Creeks Pty Ltd

MATERIALS

ROCK: HARD, ANGULAR, DURABLE, WEATHER RESISTANT AND EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE AND SUFFICIENT SMALL ROCK TO FILL THE VOIDS BETWEEN THE LARGER ROCK. THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE. SPECIFIC GRAVITY TO BE AT LEAST 2.5.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION (CHUTE FORMATION)

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE ALL NECESSARY SOIL TESTING (e.g. SOIL pH, NUTRIENT LEVELS) AND ANALYSIS HAS BEEN COMPLETED, AND REQUIRED SOIL ADJUSTMENTS PERFORMED PRIOR TO PLANTING.

3. CLEAR THE LOCATION FOR THE CHUTE CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND EQUIPMENT FOR INSTALLATION.

4. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY.

5. CONSTRUCT THE SUBGRADE TO THE ELEVATIONS SHOWN ON THE PLANS. REMOVE ALL UNSUITABLE MATERIAL AND REPLACE WITH STABLE MATERIAL TO ACHIEVE THE DESIRED FOUNDATIONS.

6. IF THE CHUTE IS TEMPORARY, THEN COMPACT THE SUBGRADE TO A FIRM CONSISTENCY. IF THE CHUTE IS INTENDED TO BE PERMANENT, THEN COMPACT AND FINISH THE SUBGRADE AS SPECIFIED WITHIN THE DESIGN PLANS.

7. AVOID COMPACTING THE SUBGRADE TO A CONDITION THAT WOULD PREVENT THE TURF FROM BONDING WITH THE SUBGRADE.

8. ENSURE THE SIDES OF THE CHUTE ARE NO STEEPER THAN A 1.5:1 (H:V) SLOPE.

9. ENSURE THE COMPLETED CHUTE HAS SUFFICIENT DEEP ALONG ITS FULL LENGTH.

10. ENSURE THE CHUTE IS STRAIGHT FROM ITS CREST TO THE TOE OF THE CHUTE.

11. ON FILL SLOPES, ENSURE THAT THE SOIL IS ADEQUATELY COMPACTED FOR A WIDTH OF AT LEAST ONE METRE EACH SIDE OF THE CHUTE TO MINIMISE THE RISK OF SOIL EROSION, OTHERWISE PROTECT THE SOIL WITH SUITABLE SCOUR PROTECTION MEASURES SUCH AS TURF OR EROSION CONTROL MATS.

12. PLACE AND SECURE THE TURF AS DIRECTED.

13. INSTALL AN APPROPRIATE OUTLET STRUCTURE (ENERGY DISSIPATER) AT THE BASE OF THE CHUTE (REFER TO SEPARATE SPECIFICATIONS).

14. ENSURE WATER LEAVING THE CHUTE AND THE OUTLET STRUCTURE WILL FLOW FREELY WITHOUT CAUSING UNDESIRABLE PONDING OR SCOUR.

15. APPROPRIATELY STABILISE ALL DISTURBED AREAS IMMEDIATELY AFTER CONSTRUCTION.

INSTALLATION (ROCK PLACEMENT)

1. OVER-CUT THE CHANNEL TO A DEPTH EQUAL TO THE SPECIFIED DEPTH OF ROCK PLACEMENT SUCH THAT THE FINISHED ROCK SURFACE WILL BE AT THE ELEVATION OF THE SURROUNDING LAND.

2. ROCK MUST BE PLACED WITHIN THE CHANNEL AS SPECIFIED WITHIN THE APPROVED PLANS, INCLUDING THE PLACEMENT OF ANY SPECIFIED FILTER LAYER.

3. IF DETAILS ARE NOT PROVIDED ON THE ROCK PLACEMENT, THEN THE PRIMARY ARMOUR ROCK MUST BE EITHER PLACED ON:
(i) A FILTER BED FORMED FROM A LAYER OF SPECIFIED SMALLER ROCK (ROCK FILTER LAYER);
(ii) AN EARTH BED LINED WITH FILTER CLOTH;
(iii) AN EARTH BED NOT LINED IN FILTER CLOTH, BUT ONLY IF ALL VOIDS BETWEEN THE ARMOUR ROCK ARE TO BE FILLED WITH SOIL AND POCKET PLANTED IMMEDIATELY AFTER PLACEMENT OF THE ROCK.

4. IF A ROCK/AGGREGATE FILTER LAYER IS SPECIFIED, THEN PLACE THE FILTER LAYER IMMEDIATELY AFTER THE FOUNDATIONS ARE PREPARED. SPREAD THE FILTER ROCK IN A UNIFORM LAYER TO THE SPECIFIED DEPTH BUT A MINIMUM OF 150mm. WHERE MORE THAN ONE LAYER OF FILTER MATERIAL HAS BEEN SPECIFIED, SPREAD EACH LAYER SUCH THAT MINIMAL MIXING OCCURS BETWEEN EACH LAYER OF ROCK.

5. IF A GEOTEXTILE (FILTER CLOTH) UNDERLAY IS SPECIFIED, PLACE THE FABRIC DIRECTLY ON THE PREPARED FOUNDATION. IF MORE THAN ONE SHEET OF FABRIC IS REQUIRED TO OVER THE AREA, OVERLAP THE EDGE OF EACH SHEET AT LEAST 300mm AND PLACE ANCHOR PINS AT MINIMUM 1m SPACING ALONG THE OVERLAP.

6. ENSURE THE GEOTEXTILE FABRIC IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE FABRIC AND THE ROCK. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

7. WHERE NECESSARY, A MINIMUM 100mm LAYER OF FINE GRAVEL, AGGREGATE OR SAND SHOULD BE PLACED OVER THE FABRIC TO PROTECT IT FROM DAMAGE.

8. PLACEMENT OF ROCK SHOULD FOLLOW IMMEDIATELY AFTER PLACEMENT OF THE FILTER LAYER. PLACE ROCK SO THAT IT FORMS A DENSE, WELL-GRADED MASS OF ROCK WITH A MINIMUM OF VOIDS.

9. PLACE ROCK TO ITS FULL THICKNESS IN ONE OPERATION. DO NOT PLACE ROCK BY DUMPING THROUGH CHUTES OR OTHER METHODS THAT CAUSE SEGREGATION OF ROCK SIZES.

10. THE FINISHED SURFACE SHOULD BE FREE OF POCKETS OF SMALL ROCK OR CLUSTERS OF LARGE ROCKS. HAND PLACING MAY BE NECESSARY TO ACHIEVE THE PROPER DISTRIBUTION OF ROCK SIZES TO PRODUCE A RELATIVELY SMOOTH, UNIFORM SURFACE. THE FINISHED GRADE OF THE ROCK SHOULD BLEND WITH THE SURROUNDING AREA. NO OVERFALL OR PROTRUSION OF ROCK SHOULD BE APPARENT.

11. IMMEDIATELY UPON COMPLETION OF THE CHANNEL, VEGETATE ALL DISTURBED AREAS OR OTHERWISE PROTECT THEM AGAINST SOIL EROSION.

12. WHERE SPECIFIED, FILL ALL VOIDS WITH SOIL AND VEGETATE THE ROCK SURFACE IN ACCORDANCE WITH THE APPROVED PLAN.

MAINTENANCE

1. DURING THE CONSTRUCTION PERIOD, INSPECT ALL CHUTES PRIOR TO FORECAST RAINFALL, DAILY DURING EXTENDED PERIODS OF RAINFALL, AFTER SIGNIFICANT RUNOFF PRODUCING STORM EVENTS, OR OTHERWISE ON A WEEKLY BASIS. MAKE REPAIRS AS NECESSARY.

2. CHECK FOR SCOUR OR DISLODGED ROCK. REPAIR DAMAGED AREAS IMMEDIATELY.

3. CLOSELY INSPECT THE OUTER EDGES OF THE ROCK PROTECTION. ENSURE WATER ENTRY INTO THE CHANNEL OR CHUTE IS NOT CAUSING EROSION ALONG THE EDGE OF THE ROCK PROTECTION.

4. INVESTIGATE THE CAUSE OF ANY SCOUR, AND REPAIR AS NECESSARY.

5. CAREFULLY CHECK THE STABILITY OF THE ROCK LOOKING FOR INDICATIONS OF PIPING, SCOUR HOLES, OR BANK FAILURES.

6. REPLACE ANY DISPLACED ROCK WITH ROCK OF A SIGNIFICANTLY (MINIMUM 110%) LARGER SIZE THAN THE DISPLACED ROCK.

7. ENSURE SEDIMENT IS NOT PARTIALLY BLOCKING FLOW ENTRY INTO THE CHUTE. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

8. DISPOSE OF ANY SEDIMENT IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

9. WHEN MAKING REPAIRS, ALWAYS RESTORE THE CHUTE TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED.

Drawn:	Date:		
GMW	May-10	Chutes - Rock Linings	CH-06

Catchments & Creeks Pty Ltd

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE ALL NECESSARY SOIL TESTING (e.g. SOIL pH, NUTRIENT LEVELS) AND ANALYSIS HAS BEEN COMPLETED, AND REQUIRED SOIL ADJUSTMENTS PERFORMED PRIOR TO PLANTING.

3. CLEAR THE LOCATION FOR THE CHANNEL, CLEARING ONLY WHAT IS NEEDED TO PROVIDE ACCESS FOR PERSONNEL AND CONSTRUCTION EQUIPMENT.

4. REMOVE ROOTS, STUMPS, AND OTHER DEBRIS AND DISPOSE OF THEM PROPERLY. DO NOT USE DEBRIS TO BUILD ANY ASSOCIATED EMBANKMENTS.

5. EXCAVATE THE DIVERSION CHANNEL TO THE SPECIFIED SHAPE, ELEVATION AND GRADIENT. THE SIDES OF THE CHANNEL SHOULD BE NO STEEPER THAN A 2:1 (H:V) IF CONSTRUCTED IN EARTH, UNLESS SPECIFICALLY DIRECTED WITHIN THE APPROVED PLANS.

6. STABILISE THE CHANNEL AND BANKS IMMEDIATELY UNLESS IT WILL OPERATE FOR LESS THAN 30 DAYS. IN EITHER CASE, TEMPORARY EROSION PROTECTION (MATTING, ROCK, ETC.) WILL BE REQUIRED AS SPECIFIED WITHIN THE APPROVED PLANS OR AS DIRECTED.

7. ENSURE THE CHANNEL DISCHARGES TO A STABLE AREA.

ADDITIONAL REQUIREMENTS FOR TURF PLACEMENT:

1. TURF SHOULD BE USED WITHIN 12 HOURS OF DELIVERY, OTHERWISE ENSURE THE TURF IS STORED IN CONDITIONS APPROPRIATE FOR THE WEATHER CONDITIONS (e.g. A SHADED AREA).

2. MOISTENING THE TURF AFTER IT IS UNROLLED WILL HELP MAINTAIN ITS VIABILITY.

3. TURF SHOULD BE LAID ON A MINIMUM 75mm BED OF ADEQUATELY FERTILISED TOPSOIL. RAKE THE SOIL SURFACE TO BREAK THE CRUST JUST BEFORE LAYING THE TURF.

4. DURING THE WARMER MONTHS, LIGHTLY IRRIGATE THE SOIL IMMEDIATELY BEFORE LAYING THE TURF.

5. ENSURE THE TURF IS NOT LAID ON GRAVEL, HEAVILY COMPACTED SOILS, OR SOILS THAT HAVE BEEN RECENTLY TREATED WITH HERBICIDES.

6. ENSURE THE TURF EXTENDS UP THE SIDES OF THE DRAIN AT LEAST 100mm ABOVE THE ELEVATION OF THE CHANNEL INVERT, OR AT LEAST TO A SUFFICIENT ELEVATION TO FULLY CONTAIN EXPECTED CHANNEL FLOW.

7. ON CHANNEL GRADIENTS OF 3:1(H:V) OR STEEPER, OR IN SITUATIONS WHERE HIGH FLOW VELOCITIES (i.e. VELOCITY >1.5m/s) ARE LIKELY WITHIN THE FIRST TWO WEEK FOLLOWING PLACEMENT, SECURE THE INDIVIDUAL TURF STRIPS WITH WOODEN OR PLASTIC PEGS.

8. ENSURE THAT INTIMATE CONTACT IS ACHIEVED AND MAINTAINED BETWEEN THE TURF AND THE SOIL SUCH THAT SEEPAGE FLOW BENEATH THE TURF IS AVOIDED.

9. WATER UNTIL THE SOIL IS WET 100mm BELOW THE TURF. THEREAFTER, WATERING SHOULD BE SUFFICIENT TO MAINTAIN AND PROMOTE HEALTHY GROWTH

MAINTENANCE

1. DURING THE SITE'S CONSTRUCTION PERIOD, INSPECT THE DIVERSION CHANNEL WEEKLY AND AFTER ANY INCREASE IN FLOWS WITHIN THE CHANNEL. REPAIR ANY SLUMPS, WHEEL TRACK DAMAGE OR LOSS OF FREEBOARD.

2. ENSURE FILL MATERIAL OR SEDIMENT IS NOT PARTIALLY BLOCKING THE CHANNEL. WHERE NECESSARY, REMOVE ANY DEPOSITED MATERIAL TO ALLOW FREE DRAINAGE.

3. DISPOSE OF ANY COLLECTED SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN THE CONSTRUCTION WORK ABOVE A TEMPORARY DIVERSION CHANNEL IS FINISHED AND THE AREA IS STABILISED, THE AREA SHOULD BE APPROPRIATELY REHABILITATED.

2. DISPOSE OF ANY COLLECTED SEDIMENT OR FILL IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. GRADE THE AREA AND SMOOTH IT OUT IN PREPARATION FOR STABILISATION.

4. STABILISE THE AREA AS SPECIFIED IN THE APPROVED PLAN.

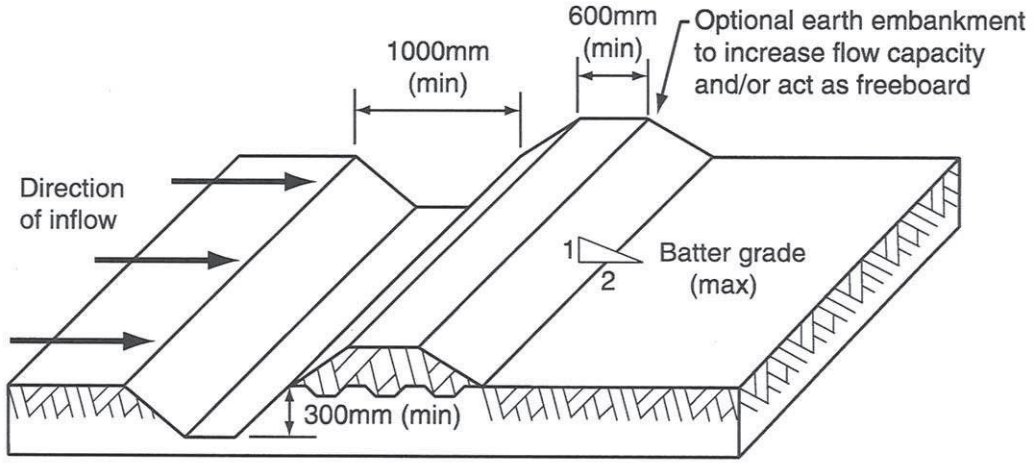

Figure 1 - Typical profile of diversion channel with bank

Drawn:	Date:		
GMW	Dec-09	Diversion Channels	DC-01

Catchments & Creeks Pty Ltd

MATERIALS

ROCK: 150 TO 300mm NOMINAL DIAMETER, HARD, EROSION RESISTANT ROCK. SMALLER ROCK MAY BE USED IF SUITABLE LARGE ROCK IS NOT AVAILABLE.

SANDBAGS: GEOTEXTILE BAGS (WOVEN SYNTHETIC, OR NON-WOVEN BIODEGRADABLE) FILLED WITH CLEAN COARSE SAND, CLEAN AGGREGATE, STRAW OR COMPOST.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. PRIOR TO PLACEMENT OF THE CHECK DAMS, ENSURE THE TYPE AND SIZE OF EACH CHECK DAMS WILL NOT CAUSE A SAFETY HAZARD OR CAUSE WATER TO SPILL OUT OF THE DRAIN.

3. LOCATE THE FIRST CHECK DAM AT THE DOWNSTREAM END OF THE SECTION OF CHANNEL BEING PROTECTED. LOCATE EACH SUCCESSIVE CHECK DAM SUCH THAT THE CREST OF THE IMMEDIATE DOWNSTREAM DAM IS LEVEL WITH THE TOE OF THE CHECK DAM BEING INSTALLED.

4. ENSURE THE CHANNEL SLOPE IS NO STEEPER THAN 10:1 (H:V). OTHERWISE CONSIDER THE USE OF A SUITABLE CHANNEL LINER INSTEAD OF THE CHECK DAMS.

5. CONSTRUCT THE CHECK DAM TO THE DIMENSIONS AND PROFILE SHOWN WITHIN THE APPROVED PLAN.

6. WHERE SPECIFIED, THE CHECK DAMS SHALL BE CONSTRUCTED ON A SHEET OF GEOTEXTILE FABRIC USED AS A DOWNSTREAM SPLASH PAD.

7. EACH CHECK DAM SHALL BE EXTENDED UP THE CHANNEL BANK (WHERE PRACTICABLE) TO AN ELEVATION AT LEAST 150mm ABOVE THE CREST LEVEL OF THE DAM.

MAINTENANCE

1. INSPECT EACH CHECK DAM AND THE DRAINAGE CHANNEL AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING RAINFALL.

2. CORRECT ALL DAMAGE IMMEDIATELY. IF SIGNIFICANT EROSION OCCURS BETWEEN ANY OF THE CHECK DAMS, THEN CHECK THE SPACING OF DAMS AND WHERE NECESSARY INSTALL INTERMEDIATE CHECK DAMS OR A SUITABLE CHANNEL LINER.

3. CHECK FOR DISPLACEMENT OF THE CHECK DAMS

4. CHECK FOR SOIL SCOUR AROUND THE ENDS OF EACH CHECK DAM. IF SUCH EROSION IS OCCURRING, CONSIDER EXTENDING THE WIDTH OF THE CHECK DAM TO AVOID SUCH PROBLEMS.

5. IF SEVERE SOIL EROSION OCCURS EITHER UNDER OR AROUND THE CHECK DAMS, THEN SEEK EXPERT ADVICE ON AN ALTERNATIVE TREATMENT MEASURE.

6. REMOVE ANY SEDIMENT ACCUMULATED BY THE CHECK DAMS, UNLESS IT IS INTENDED THAT THIS SEDIMENT WILL REMAIN WITHIN THE CHANNEL.

7. DISPOSE OF COLLECTED SEDIMENT IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN CONSTRUCTION WORK WITHIN THE DRAINAGE AREA ABOVE THE CHECK DAMS HAS BEEN COMPLETED, AND THE DISTURBED AREAS AND THE DRAINAGE CHANNEL ARE SUFFICIENTLY STABILISED TO RESTRAIN EROSION, ALL TEMPORARY CHECK DAMS MUST BE REMOVED.

2. REMOVE THE CHECK DAMS AND ASSOCIATED SEDIMENT AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

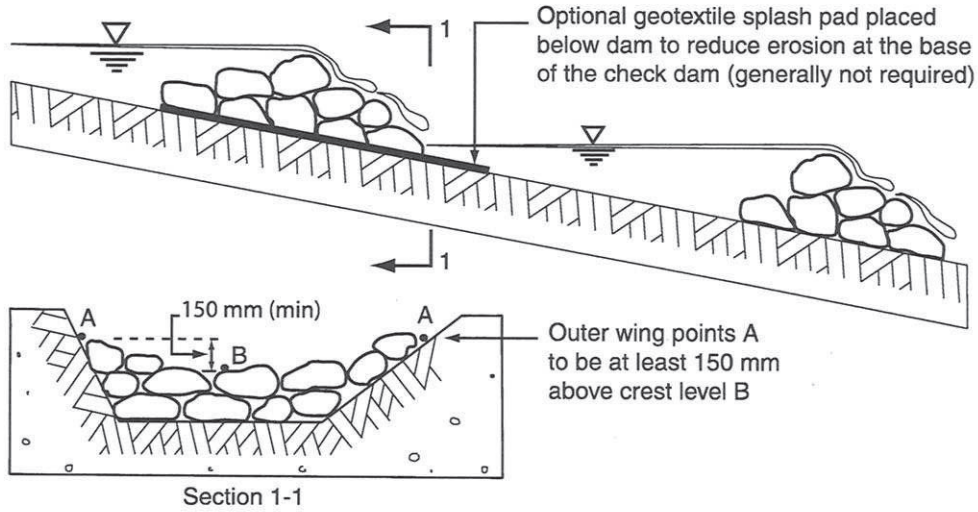

Figure 1 - Layout and profile of check dams (rock check dams shown)

Drawn:	Date:		
GMW	Dec-09	Check Dams	RCD-01

Catchments & Creeks Pty Ltd

MATERIALS

ROCK INFILL: HARD, ANGULAR, DURABLE, WEATHER RESISTANT AND EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE. THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION

INSTALLATION PROCEDURES SHOULD BE PROVIDED BY THE MANUFACTURER OR DISTRIBUTOR OF THE PRODUCT. A TYPICAL INSTALLATION PROCEDURE IS DESCRIBED BELOW, BUT SHOULD BE CONFIRMED WITH THE PRODUCT MANUFACTURER OR DISTRIBUTOR.

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. MATTRESSES OF DIFFERENT THICKNESSES SHOULD BE STORED ON-SITE IN SEPARATE PILES AND CLEARLY LABELLED.

3. CLEAR THE PROPOSED CHANNEL AREA OF TREES, STUMPS, ROOTS, LOOSE ROCK, AND OTHER OBJECTIONABLE MATERIALS.

4. EXCAVATE THE TREATMENT AREA TO THE LINES AND GRADES AS SHOWN ON THE PLANS. OVER-CUT THE AREA TO A DEPTH EQUAL TO THE SPECIFIED MATTRESS THICKNESS SUCH THAT THE FINISHED SURFACE WILL BE AT THE ELEVATION OF THE SURROUNDING LAND.

5. PLACE FILTER FABRIC DIRECTLY ON THE PREPARED FOUNDATION. IF MORE THAN ONE SHEET OF FILTER CLOTH IS REQUIRED TO OVER THE AREA, OVERLAP THE EDGE OF EACH SHEET AT LEAST 300mm AND PLACE ANCHOR PINS AT MINIMUM 1m SPACING ALONG THE OVERLAP.

6. ENSURE THE FILTER CLOTH IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE MATTRESSES. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

7. FLATTEN OUT EACH MATTRESS ON A HARD, FLAT SURFACE, AND STAMP OUT ANY UNNECESSARY CREASES. EDGE CREASES WILL NEED TO BE STAMPED INTO THE BOTTOM OF THE 2ND AND 4TH INTERNAL DIAPHRAGMS.

8. ENSURE THAT EACH DIAPHRAGM IS VERTICAL AND THE CORRECT HEIGHT. FOLD THE SIDES AND ENDS OF THE MATTRESS TO MEET THE TOP OF THE DIAPHRAGMS. FOLD THE SIDE PANEL FLAPS TO LIE ADJACENT TO THE DIAPHRAGMS. TACK TEMPORARILY EITHER BY USING SHORT LENGTHS OF BINDING WIRE, OR ALTERNATIVELY BY TWISTING THE TOP DIAPHRAGM WIRE OVER THE FLAP SELVEDGE WIRE.

9. THE ENDS OF THE DIAPHRAGMS MUST NOW BE PERMANENTLY LACED TO THE SIDES OF THE MATTRESS. AT THE FOUR CORNERS, BEND THE PROJECTED LENGTHS OF THE END PANELS TO OVERLAP THE SIDES, AND LACE UP WITH BINDING WIRE.

10. WHEN THE MATTRESS IS PLACED OVER A GEOTEXTILE, CARE MUST BE TAKEN TO ENSURE THAT PROJECTING ENDS OF WIRE ARE BENT UPWARDS TO AVOID PUNCTURING OR TEARING THE CLOTH. GEOTEXTILE SHOULD BE PLACED ACCORDING TO SPECIFICATIONS.

11. CARRY THE WIRED-UP MATTRESS TO ITS FINAL POSITION, AND WIRE IT SECURELY TO THE ADJACENT MATTRESSES. MATTRESSES SHOULD BE PLACED AND WIRED TOGETHER EMPTY AS IT IS DIFFICULT TO WIRE MATTRESSES TOGETHER WHEN BOTH ARE FULL OF STONE.

12. ON SLOPES, THE MATTRESS SHOULD GENERALLY BE LAID WITH THE DIAPHRAGM ACROSS THE SLOPE RATHER THAN UP AND DOWN THE SLOPE. ON CHUTE AND STREAM BEDS, THE MATTRESS SHOULD GENERALLY BE LAID WITH THE DIAPHRAGM AT RIGHT ANGLES TO THE MAIN DIRECTION OF WATER FLOW.

13. ALL HAND WIRING MUST BE DONE AS A CONTINUOUS LACING OPERATION. BEGIN WIRING BY SECURING THE BINDING WIRE TO THE CORNER OF THE PANELS TO BE JOINED BY LOOPING IT THROUGH AND TWISTING IT TOGETHER. THEN LACE WITH SINGLE LOOPS AND DOUBLE LOOPS IN TURN AT 100mm INTERVALS. FINALLY POKE THE LOOSE END INSIDE THE MATTRESS. TIGHTNESS OF THE MESH AND WIRING IS ESSENTIAL AT ALL TIMES.

14. PLACE THE FILL MATERIAL, BY HAND OR MECHANICALLY, IN THE COMPARTMENTS, STARTING AT THE BOTTOM IF ON A SLOPE. THE FILL SHOULD BE A HARD, DURABLE STONE, IN SIZE BETWEEN 80mm AND 2/3 THE THICKNESS OF THE MATTRESS, BUT GENERALLY NO GREATER THAN 200mm.

15. FILLING CAN BE DONE UNIT BY UNIT, BUT SEVERAL UNITS SHOULD BE READY FOR FILLING AT ANY ONE TIME.

16. FOR UNITS WITH PVC COATED WIRE MESH, PARTICULAR CARE SHALL BE TAKEN TO ENSURE THAT SHARP EDGES OF QUARRY STONE ARE NOT PLACED AGAINST THE MESH IN ORDER TO AVOID CAUSING UNNECESSARY ABRASION.

17. SLIGHTLY OVERFILL EACH MATTRESS TO ALLOW FOR SETTLEMENT. TACK THE LID TO THE CORNERS OF THE MATTRESS, AND THEN SECURELY WIRE IT TO THE TOPS OF THE SIDES, ENDS AND DIAPHRAGMS, USING ALTERNATE SINGLE AND DOUBLE LOOPS AS SPECIFIED ABOVE.

18. WITH MORE THAN ONE MATTRESS FILLED, THE EDGES OF ADJACENT LIDS CAN BE WIRED DOWN IN THE SAME OPERATION, SAVING BOTH TIME AND BINDING WIRE.

19. WHEN THE MATTRESS IS LAID ON A SLOPE STEEPER THAN 1.5:1(H:V), IT SHOULD BE SECURED BY STAR PICKETS OR HARDWOOD PEGS DRIVEN INTO THE GROUND JUST INSIDE THE UPPER END PANEL AT 2m CENTRES OR AS NECESSARY.

20. ON SOFT OR SANDY SLOPES, PEGS CAN BE USED TO HOLD THE MATTRESS IN POSITION DURING FILLING.

21. MATTRESSES CAN BE SHORTENED WHERE NECESSARY, BY CUTTING ALONG THE FOLD AT THE TOP OF A DIAPHRAGM AND REMOVING THE BOTTOM SPIRAL CONNECTIONS.

22. ALWAYS CONSULT MANUFACTURER'S SPECIFICATIONS AND ASSEMBLY INSTRUCTIONS BEFORE MODIFYING THE SHAPE OF THE MATTRESS OR WIRING DEFORMED MATTRESS SHAPES.

23. IMMEDIATELY UPON COMPLETION OF THE CHANNEL, VEGETATE ALL DISTURBED AREAS OR OTHERWISE PROTECT THEM AGAINST SOIL EROSION.

24. WHERE SPECIFIED, FILL ALL VOIDS WITH SOIL AND VEGETATE IN ACCORDANCE WITH THE APPROVED PLAN.

MAINTENANCE

1. ROCK MATTRESS CHANNELS SHOULD BE INSPECTED PERIODICALLY AND AFTER SIGNIFICANT STORM EVENTS. REPAIR DAMAGED AREAS IMMEDIATELY.

2. CLOSELY INSPECT THE OUTER EDGES OF THE TREATED AREA. ENSURE WATER ENTRY INTO THE CHANNEL OR CHUTE IS NOT CAUSING EROSION ALONG THE EDGE OF THE MATTRESSES.

3. CHECK FOR PIPING FAILURE, SCOUR HOLES, OR BANK FAILURES.

Drawn:	Date:		
GMW	May-10	Rock Mattress Linings	RM-01

Catchments & Creeks Pty Ltd

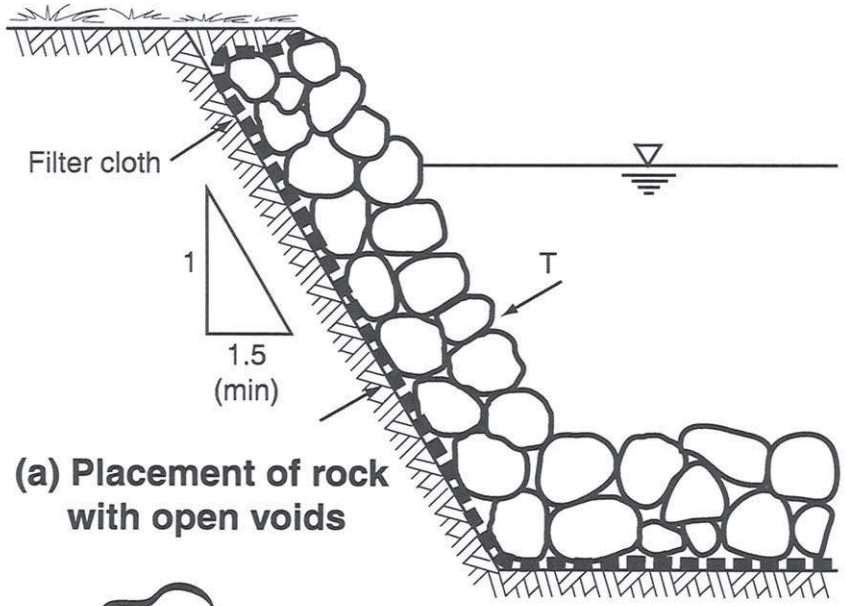

(a) Placement of rock with open voids

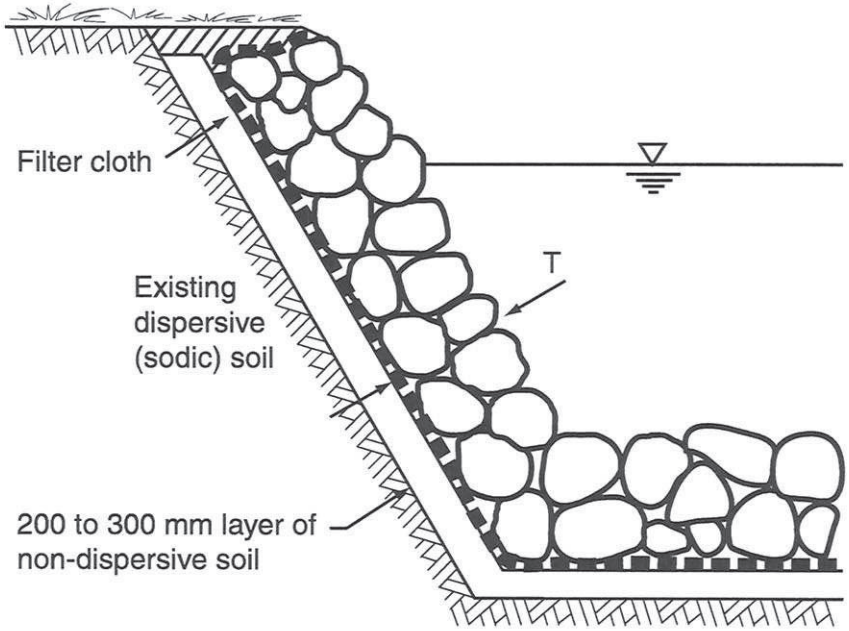

(b) Placement of rock within a channel cut into dispersive soils

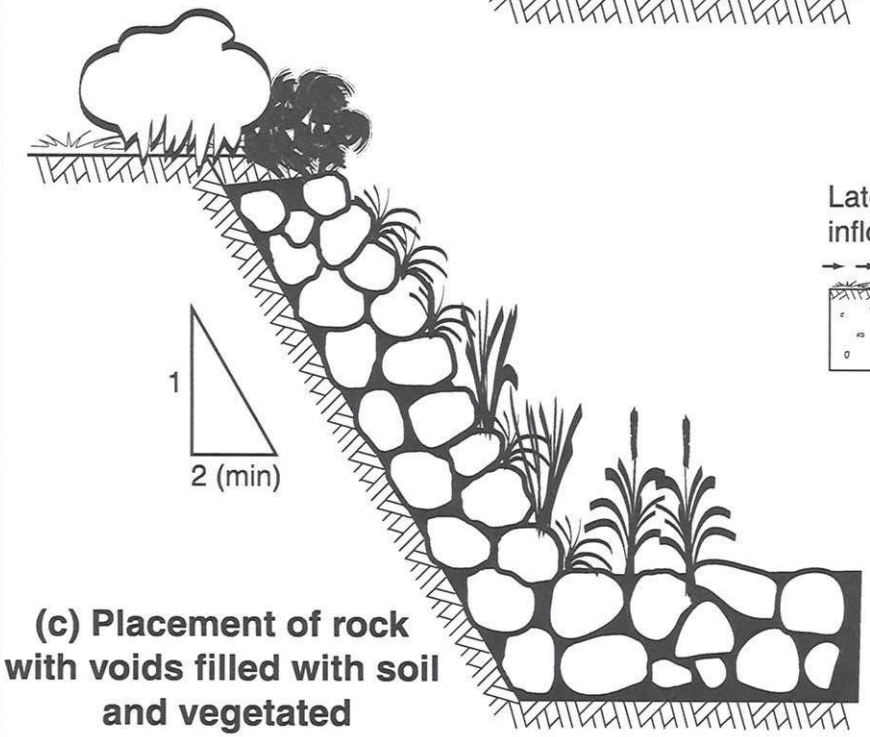

(c) Placement of rock with voids filled with soil and vegetated

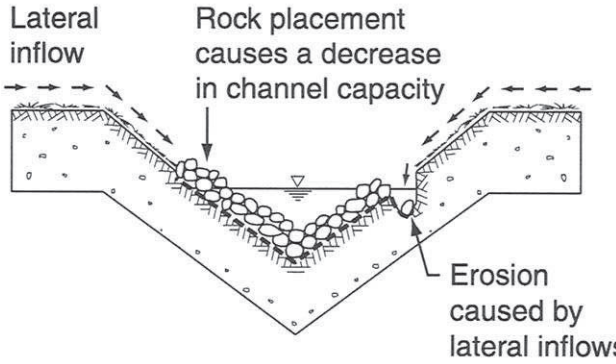

(d) Poor placement of rock along channel invert

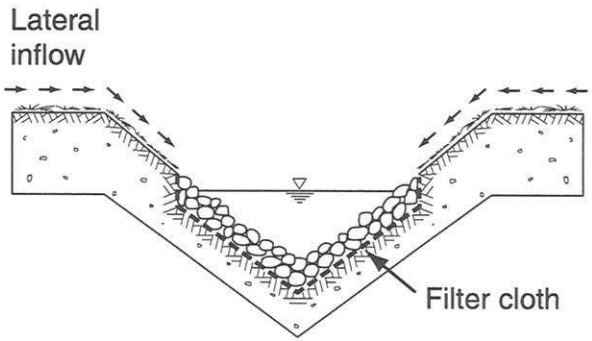

(e) Good placement of rock along channel invert

Drawn:	Date:		
GMW	Dec-09	Rock Linings	RR-01

Catchments & Creeks Pty Ltd

MATERIALS

ROCK: HARD, ANGULAR, DURABLE, WEATHER RESISTANT AND EVENLY GRADED WITH 50% BY WEIGHT LARGER THAN THE SPECIFIED NOMINAL ROCK SIZE AND SUFFICIENT SMALL ROCK TO FILL THE VOIDS BETWEEN THE LARGER ROCK. THE DIAMETER OF THE LARGEST ROCK SIZE SHOULD BE NO LARGER THAN 1.5 TIMES THE NOMINAL ROCK SIZE. SPECIFIC GRAVITY TO BE AT LEAST 2.5.

GEOTEXTILE FABRIC: HEAVY-DUTY, NEEDLE-PUNCHED, NON-WOVEN FILTER CLOTH, MINIMUM BIDIM A24 OR EQUIVALENT.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CLEAR THE PROPOSED CHANNEL AREA OF TREES, STUMPS, ROOTS, LOOSE ROCK, AND OTHER OBJECTIONABLE MATERIALS.

3. EXCAVATE THE CHANNEL TO THE LINES AND GRADES AS SHOWN ON THE PLANS. OVER-CUT THE CHANNEL TO A DEPTH EQUAL TO THE SPECIFIED DEPTH OF ROCK PLACEMENT SUCH THAT THE FINISHED ROCK SURFACE WILL BE AT THE ELEVATION OF THE SURROUNDING LAND.

4. ROCK MUST BE PLACED WITHIN THE CHANNEL AS SPECIFIED WITHIN THE APPROVED PLANS, INCLUDING THE PLACEMENT OF ANY SPECIFIED FILTER LAYER.

5. IF DETAILS ARE NOT PROVIDED ON THE ROCK PLACEMENT, THEN THE PRIMARY ARMOUR ROCK MUST BE EITHER PLACED ON:

(i) A FILTER BED FORMED FROM A LAYER OF SPECIFIED SMALLER ROCK (ROCK FILTER LAYER);

(ii) AN EARTH BED LINED WITH FILTER CLOTH;

(iii) AN EARTH BED NOT LINED IN FILTER CLOTH, BUT ONLY IF ALL VOIDS BETWEEN THE ARMOUR ROCK ARE TO BE FILLED WITH SOIL AND POCKET PLANTED IMMEDIATELY AFTER PLACEMENT OF THE ROCK.

6. IF A ROCK/AGGREGATE FILTER LAYER IS SPECIFIED, THEN PLACE THE FILTER LAYER IMMEDIATELY AFTER THE FOUNDATIONS ARE PREPARED. SPREAD THE FILTER ROCK IN A UNIFORM LAYER TO THE SPECIFIED DEPTH BUT A MINIMUM OF 150mm. WHERE MORE THAN ONE LAYER OF FILTER MATERIAL HAS BEEN SPECIFIED, SPREAD EACH LAYER SUCH THAT MINIMAL MIXING OCCURS BETWEEN EACH LAYER OF ROCK.

7. IF A GEOTEXTILE (FILTER CLOTH) UNDERLAY IS SPECIFIED, PLACE THE FABRIC DIRECTLY ON THE PREPARED FOUNDATION. IF MORE THAN ONE SHEET OF FABRIC IS REQUIRED TO OVER THE AREA, OVERLAP THE EDGE OF EACH SHEET AT LEAST 300mm AND PLACE ANCHOR PINS AT MINIMUM 1m SPACING ALONG THE OVERLAP.

8. ENSURE THE GEOTEXTILE FABRIC IS PROTECTED FROM PUNCHING OR TEARING DURING INSTALLATION OF THE FABRIC AND THE ROCK. REPAIR ANY DAMAGE BY REMOVING THE ROCK AND PLACING WITH ANOTHER PIECE OF FILTER CLOTH OVER THE DAMAGED AREA OVERLAPPING THE EXISTING FABRIC A MINIMUM OF 300mm.

9. WHERE NECESSARY, A MINIMUM 100mm LAYER OF FINE GRAVEL, AGGREGATE OR SAND SHOULD BE PLACED OVER THE FABRIC TO PROTECT IT FROM DAMAGE.

10. PLACEMENT OF ROCK SHOULD FOLLOW IMMEDIATELY AFTER PLACEMENT OF THE FILTER LAYER. PLACE ROCK SO THAT IT FORMS A DENSE, WELL-GRADED MASS OF ROCK WITH A MINIMUM OF VOIDS.

11. PLACE ROCK TO ITS FULL THICKNESS IN ONE OPERATION. DO NOT PLACE ROCK BY DUMPING THROUGH CHUTES OR OTHER METHODS THAT CAUSE SEGREGATION OF ROCK SIZES.

12. THE FINISHED SURFACE SHOULD BE FREE OF POCKETS OF SMALL ROCK OR CLUSTERS OF LARGE ROCKS. HAND PLACING MAY BE NECESSARY TO ACHIEVE THE PROPER DISTRIBUTION OF ROCK SIZES TO PRODUCE A RELATIVELY SMOOTH, UNIFORM SURFACE. THE FINISHED GRADE OF THE ROCK SHOULD BLEND WITH THE SURROUNDING AREA. NO OVERFALL OR PROTRUSION OF ROCK SHOULD BE APPARENT.

13. IMMEDIATELY UPON COMPLETION OF THE CHANNEL, VEGETATE ALL DISTURBED AREAS OR OTHERWISE PROTECT THEM AGAINST SOIL EROSION.

14. WHERE SPECIFIED, FILL ALL VOIDS WITH SOIL AND VEGETATE THE ROCK SURFACE IN ACCORDANCE WITH THE APPROVED PLAN.

MAINTENANCE

1. ROCK-LINED CHANNELS SHOULD BE INSPECTED PERIODICALLY AND AFTER SIGNIFICANT STORM EVENTS. CHECK FOR SCOUR OR DISLODGED ROCK. REPAIR DAMAGED AREAS IMMEDIATELY.

2. CLOSELY INSPECT THE OUTER EDGES OF THE ROCK PROTECTION. ENSURE WATER ENTRY INTO THE CHANNEL OR CHUTE IS NOT CAUSING EROSION ALONG THE EDGE OF THE ROCK PROTECTION.

3. CAREFULLY CHECK THE STABILITY OF THE ROCK LOOKING FOR INDICATIONS OF PIPING, SCOUR HOLES, OR BANK FAILURES.

4. REPLACE ANY DISPLACED ROCK WITH ROCK OF A SIGNIFICANTLY (MINIMUM 110%) LARGER SIZE THAN THE DISPLACED ROCK.

Drawn:	Date:		
GMW	May-10	Rock Linings	RR-02

Catchments & Creeks Pty Ltd

MATERIALS (GENERAL)

MULCH: TO THE MAXIMUM DEGREE PRACTICAL THE MULCH SHALL BE FREE OF WEED SPECIES ESPECIALLY PROHIBITED NOXIOUS WEED SEED. DO NOT USE WOODY OR OTHER HEAVY MATERIALS THAN MAY INTERFERE WITH THE EMERGENCE OF SEEDLINGS.

APPLICATION (GENERAL)

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND APPLICATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF APPLICATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE THE SURFACE IS FREE OF DEEP TRACK MARKS OF OTHER FEATURES THAT MAY RESULT IN FLOW CONCENTRATION DOWN THE SLOPE. WHERE NECESSARY, ESTABLISH UP-SLOPE DRAINAGE CONTROLS TO LIMIT RUN-ON WATER THAT MAY DISTURB THE MULCH.

3. SPREAD ENOUGH MULCH TO COMPLETELY COVER THE SURFACE OF THE SOIL AT THE DENSITY OR THICKNESS SPECIFIED IN THE APPROVED PLANS, BUT NOT GREATER THAN 50mm.

4. MACHINE APPLICATIONS SHALL COMPRISE A MINIMUM OF TWO PASSES IN OPPOSITE DIRECTIONS UNLESS OTHERWISE SPECIFIED.

5. DURING APPLICATION, ALL REASONABLE EFFORTS SHALL BE TAKEN TO AVOID SPRAY ONTO ROADS, PATHWAYS, DRAINAGE CHANNELS NOT INTENDED FOR APPLICATION, AND EXISTING VEGETATION.

6. SUITABLE ANCHORAGE OF THE MULCH MUST BE ACCOMPLISHED IMMEDIATELY AFTER THE MULCH HAS BEEN PLACED.

7. ENSURE THE MULCH IS RESTRAINED FROM EXCESSIVE MOVEMENT BY WIND OR STORMWATER RUNOFF BY THE APPROPRIATELY APPLICATION OF AN APPROVED TACKIFIER. ON FLAT OR GENTLE SLOPES, STRAW MULCH MAY BE FIXED TO THE SOIL BY MECHANICAL CRIMPING.

8. IF THE TREATED AREA WAS SEEDED, CONTINUE TO WATER AFTER MULCHING IN ACCORDANCE WITH WEATHER CONDITIONS, OR AS REQUIRED TO OBTAIN SUITABLE GERMINATION AND PLANT ESTABLISHMENT.

9. APPLICATION (SPRAYING) OF A TACKIFIER MUST NOT BE PERFORMED DURING PERIODS OF WINDY CONDITIONS THAT WOULD PREVENT THE PROPER PLACEMENT OF ADHESIVE.

10. THE CONTRACTOR MUST TAKE APPROPRIATE STEPS TO PROTECT ALL TRAFFIC, SIGNS, STRUCTURES, AND OTHER OBJECTS FROM BEING MARKED OR DISFIGURED BY THE TACKIFIER MATERIAL.

APPLICATION (HYDROMULCHING)

THE FOLLOWING SPECIFICATION APPLIES TO GRASS SEEDING, NOT THE APPLICATION OF NATIVE TREE OR SHRUB SEED.

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND APPLICATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF APPLICATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE THE SURFACE IS FREE OF DEEP TRACK MARKS OF OTHER FEATURES THAT MAY RESULT IN FLOW CONCENTRATION DOWN THE SLOPE. WHERE NECESSARY, ESTABLISH UP-SLOPE DRAINAGE CONTROLS TO LIMIT RUN-ON WATER THAT MAY DISTURB THE MULCH.

3. PRIOR TO APPLICATION, ROUGHEN THE SOIL SURFACE AND FILL AREAS BY ROLLING WITH A CRIMPING OR PUNCHING TYPE ROLLER OR BY TRACK WALKING WHERE PRACTICAL.

4. IF THE SOIL IS DRY, WATER THE TREATMENT AREA BEFORE HYDROSEEDING TO INCREASE PENETRATION OF THE ADHESIVE AND FERTILISER ADDITIVES.

5. ADD STRAW, WOOD OR PAPER CELLULOSE FIBRE MULCH TO THE SLURRY AT THE SPECIFIED RATE, OTHERWISE AT A RATE OF 2 TO 3 TONNES PER HECTARE.

6. MACHINE APPLICATIONS SHALL COMPRISE A MINIMUM OF TWO PASSES IN OPPOSITE DIRECTIONS UNLESS OTHERWISE SPECIFIED.

7. DURING APPLICATION, ALL REASONABLE EFFORTS SHALL BE TAKEN TO AVOID SPRAY ONTO ROADS, PATHWAYS, DRAINAGE CHANNELS NOT INTENDED FOR APPLICATION, AND EXISTING VEGETATION.

8. THE CONTRACTOR MUST TAKE APPROPRIATE STEPS TO PROTECT ALL TRAFFIC, SIGNS, STRUCTURES, AND OTHER OBJECTS FROM BEING MARKED OR DISFIGURED BY THE MULCH AND/OR ASSOCIATED TACKIFIER.

9. CONTINUE TO WATER AFTER ALLOWING 24 HOURS DRYING TIME. WATER IN ACCORDANCE WITH THE WEATHER CONDITIONS, OR AS REQUIRED TO MAINTAIN SUITABLE GERMINATION AND PLANT GROWTH. THE WOOD-FIBRE SHOULD BE KEPT MOIST UNTIL GERMINATION OCCURS.

MAINTENANCE

1. INSPECT ALL MULCHES FORTNIGHTLY AND AFTER RUNOFF-PRODUCING RAINFALL AND STRONG WINDS.

2. CHECK FOR RILL EROSION, OR DISLODGMENT OF THE MULCH.

3. REPLACE ANY DISPLACED MULCH TO MAINTAIN THE REQUIRED COVERAGE.

4. IF STORMWATER RUNOFF DISPLACES MORE THAN 10% OF THE MULCH, THEN INVESTIGATE THE NEED FOR ADDITIONAL DRAINAGE CONTROLS TO PREVENT FURTHER DISPLACEMENT.

5. CONTINUE INSPECTIONS UNTIL VEGETATION IS SUITABLY ESTABLISHED OR EROSION CONTROL IS NO LONGER REQUIRED.

6. IF THE MULCHING IS NOT EFFECTIVE IN CONTAINING THE SOIL EROSION IT SHOULD BE REPLACED, OR AN ALTERNATIVE EROSION CONTROL PROCEDURE ADOPTED.

Drawn:	Date:		
GMW	Dec-09	Mulching (light)	M-01

Catchments & Creeks Pty Ltd

MATERIALS

MULCH: TO THE MAXIMUM DEGREE PRACTICAL THE MULCH MUST BE FREE OF WEED SPECIES ESPECIALLY PROHIBITED NOXIOUS WEED SEED. DO NOT USE WOODCHIP MULCH THAT IS TOO FRESH OR CONTAINS SAPPY SOFTWOOD. DO NOT USE RESINOUS PINE MATERIALS THAT CAN TRANSFER WATER REPELLENCE TO THE SOIL.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND APPLICATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, OR METHOD OF APPLICATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. ENSURE THE SURFACE IS FREE OF DEEP TRACK MARKS OF OTHER FEATURES THAT MAY RESULT IN FLOW CONCENTRATION DOWN THE SLOPE. WHERE NECESSARY, ESTABLISH UP-SLOPE DRAINAGE CONTROLS TO LIMIT RUN-ON WATER THAT MAY DISTURB THE MULCH.

3. SPREAD ENOUGH MULCH TO COMPLETELY COVER THE SURFACE OF THE SOIL AT THE DENSITY OR THICKNESS SPECIFIED IN THE APPROVED PLANS, OR OTHERWISE NOT LESS THAN 100mm.

4. SUITABLE ANCHORAGE OF THE MULCH MUST BE ACCOMPLISHED IMMEDIATELY AFTER THE MULCH HAS BEEN PLACED.

5. ENSURE THE MULCH IS RESTRAINED FROM EXCESSIVE MOVEMENT BY WIND OR STORMWATER RUNOFF BY APPROPRIATELY ANCHORING OR GLUING THE MULCH WITH AN APPROVED TACKIFIER.

6. APPLICATION (SPRAYING) OF A TACKIFIER MUST NOT BE PERFORMED DURING PERIODS OF WINDY CONDITIONS THAT WOULD PREVENT THE PROPER PLACEMENT OF ADHESIVE.

7. THE CONTRACTOR MUST TAKE APPROPRIATE STEPS TO PROTECT ALL TRAFFIC, SIGNS, STRUCTURES, AND OTHER OBJECTS FROM BEING MARKED OR DISFIGURED BY THE TACKIFIER MATERIAL.

MAINTENANCE

1. INSPECT ALL MULCHES FORTNIGHTLY AND AFTER RUNOFF-PRODUCING RAINFALL AND STRONG WINDS.

2. CHECK FOR RILL EROSION, OR DISLODGMENT OF THE MULCH.

3. REPLACE ANY DISPLACED MULCH TO MAINTAIN THE REQUIRED COVERAGE.

4. IF STORMWATER RUNOFF DISPLACES MORE THAN 10% OF THE MULCH, THEN INVESTIGATE THE NEED FOR ADDITIONAL DRAINAGE CONTROLS TO PREVENT FURTHER DISPLACEMENT.

Drawn:	Date:		
GMW	Dec-09	Heavy Mulching	MH-01

Catchments & Creeks Pty Ltd

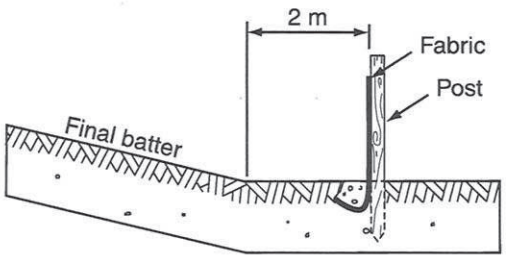

(a) Location of fence relative to base of slope

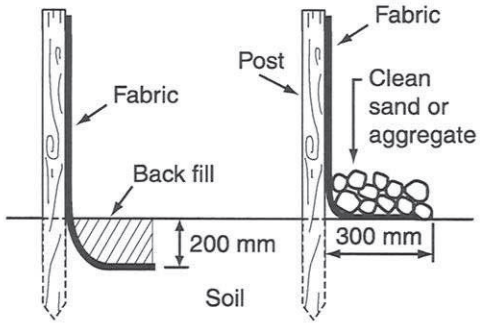

(b) Anchoring base of fabric

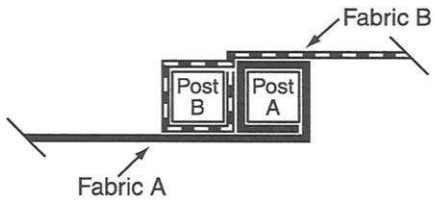

Fabric to fold around each stake one full turn.
Stake B to be drive tightly against Stake A.
The tops of both stakes to be secured with wire.

(c) Joining fabric - Method 1

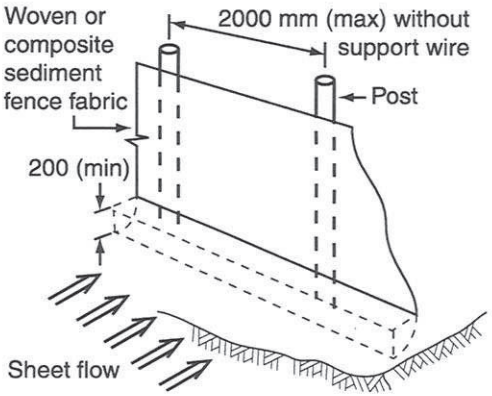

(d) Installation without backing support

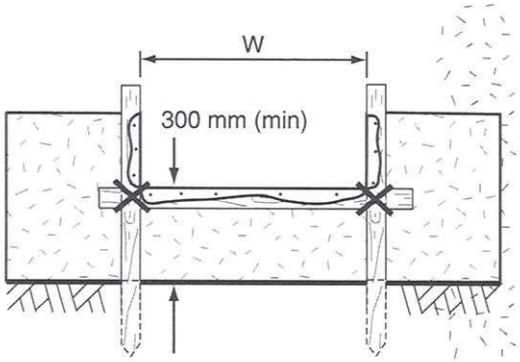

(e) Spill-through weir

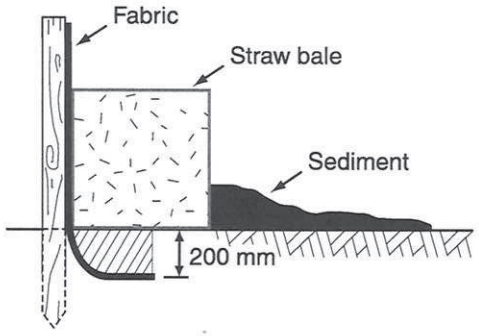

(f) Placement of up-slope straw bale

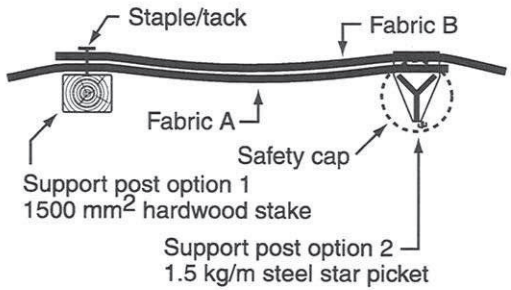

(g) Joining fabric - Method 2

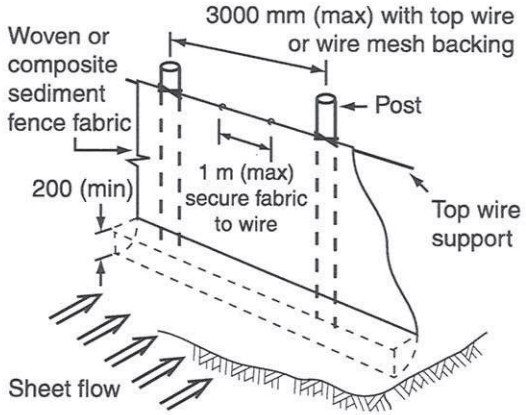

(h) Installation with top wire support

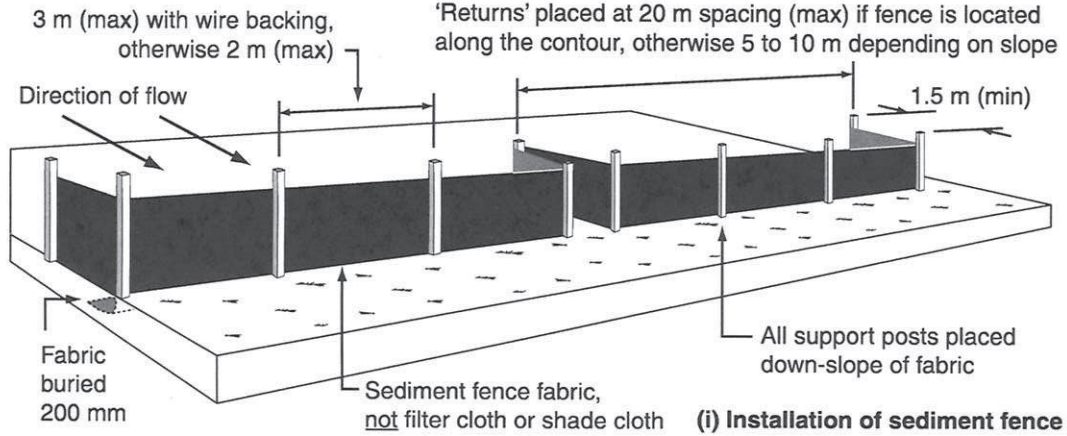

(i) Installation of sediment fence

Notes:

1. Sediment fence to be installed along a line of constant ground elevation wherever practical.
2. Both end of the sediment fence to extend up the slope at least 1m.
3. Support post to be spaced a maximum 2m unless the fence is supported by a top wire or wire mesh backing, in which case 3m maximum spacing.
4. Fence 'returns' shall be installed at maximum 20m spacing if fence is installed along the contour, otherwise 5 to 10m maximum spacing.
5. Minimum 4 staples or tie wires per stake.

Drawn:	Date:		
GMW	Dec-09	Sediment Fence	ESC-04

Catchments & Creeks Pty Ltd

MATERIALS

FABRIC: POLYPROPYLENE, POLYAMIDE, NYLON, POLYESTER, OR POLYETHYLENE WOVEN OR NON-WOVEN FABRIC, AT LEAST 700mm IN WIDTH AND A MINIMUM UNIT WEIGHT OF 140g/m^2. ALL FABRICS TO CONTAIN ULTRAVIOLET INHIBITORS AND STABILISERS TO PROVIDE A MINIMUM OF 6 MONTHS OF USEABLE CONSTRUCTION LIFE (ULTRAVIOLET STABILITY EXCEEDING 70%).

FABRIC REINFORCEMENT: WIRE OR STEEL MESH MINIMUM 14-GAUGE WITH A MAXIMUM MESH SPACING OF 200mm.

SUPPORT POSTS/STAKES: 1500mm^2 (MIN) HARDWOOD, 2500mm^2 (MIN) SOFTWOOD, OR 1.5kg/m (MIN) STEEL STAR PICKETS SUITABLE FOR ATTACHING FABRIC.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION, EXTENT, AND REQUIRED TYPE OF FABRIC (IF SPECIFIED). IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, EXTENT, FABRIC TYPE, OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. TO THE MAXIMUM DEGREE PRACTICAL, AND WHERE THE PLANS ALLOW, ENSURE THE FENCE IS LOCATED:
(i) TOTALLY WITHIN THE PROPERTY BOUNDARIES;
(ii) ALONG A LINE OF CONSTANT ELEVATION WHEREVER PRACTICAL;
(iii) AT LEAST 2m FROM THE TOE OF ANY FILLING OPERATIONS THAT MAY RESULT IN SHIFTING SOIL/FILL DAMAGING THE FENCE.

3. INSTALL RETURNS WITHIN THE FENCE AT MAXIMUM 20m INTERVALS IF THE FENCE IS INSTALLED ALONG THE CONTOUR, OR 5 TO 10m MAXIMUM SPACING (DEPENDING ON SLOPE) IF THE FENCE IS INSTALLED AT AN ANGLE TO THE CONTOUR. THE 'RETURNS' SHALL CONSIST OF EITHER:
(i) V-SHAPED SECTION EXTENDING AT LEAST 1.5m UP THE SLOPE; OR
(ii) SANDBAG OR ROCK/AGGREGATE CHECK DAM A MINIMUM 1/3 AND MAXIMUM 1/2 FENCE HEIGHT, AND EXTENDING AT LEAST 1.5m UP THE SLOPE.

4. ENSURE THE EXTREME ENDS OF THE FENCE ARE TURNED UP THE SLOPE AT LEAST 1.5m, OR AS NECESSARY, TO MINIMISE WATER BYPASSING AROUND THE FENCE.

5. ENSURE THE SEDIMENT FENCE IS INSTALLED IN A MANNER THAT AVOIDS THE CONCENTRATION OF FLOW ALONG THE FENCE, AND THE UNDESIRABLE DISCHARGE OF WATER AROUND THE ENDS OF THE FENCE.

6. IF THE SEDIMENT FENCE IS TO BE INSTALLED ALONG THE EDGE OF EXISTING TREES, ENSURE CARE IS TAKEN TO PROTECT THE TREES AND THEIR ROOT SYSTEMS DURING INSTALLATION OF THE FENCE. DO NOT ATTACH THE FABRIC TO THE TREES.

7. UNLESS DIRECTED BY THE SITE SUPERVISOR OR THE APPROVED PLANS, EXCAVATE A 200mm WIDE BY 200mm DEEP TRENCH ALONG THE PROPOSED FENCE LINE, PLACING THE EXCAVATED MATERIAL ON THE UP-SLOPE SIDE OF THE TRENCH.

8. ALONG THE LOWER SIDE OF THE TRENCH, APPROPRIATELY SECURE THE STAKES INTO THE GROUND SPACED NO GREATER THAN 3m IF SUPPORTED BY A TOP SUPPORT WIRE OR WEIR MESH BACKING, OTHERWISE NO GREATER THAN 2m.

9. IF SPECIFIED, SECURELY ATTACH THE SUPPORT WIRE OR MESH TO THE UP-SLOPE SIDE OF THE STAKES WITH THE MESH EXTENDING AT LEAST 200mm INTO THE EXCAVATED TRENCH. ENSURE THE MESH AND FABRIC IS ATTACHED TO THE UP-SLOPE SIDE OF THE STAKES EVEN WHEN DIRECTING A FENCE AROUND A CORNER OR SHARP CHANGE OF DIRECTION.

10. WHEREVER POSSIBLE, CONSTRUCT THE SEDIMENT FENCE FROM A CONTINUOUS ROLL OF FABRIC. TO JOIN FABRIC EITHER:
(i) ATTACH EACH END TO TWO OVERLAPPING STAKES WITH THE FABRIC FOLDING AROUND THE ASSOCIATED STAKE ONE TURN, AND WITH THE TWO STAKES TIED TOGETHER WITH WIRE; OR
(ii) OVERLAP THE FABRIC TO THE NEXT ADJACENT SUPPORT POST.

11. SECURELY ATTACH THE FABRIC TO THE SUPPORT POSTS USING 25 X 12.5mm STAPLES, OR TIE WIRE AT MAXIMUM 150mm SPACING.

12. SECURELY ATTACH THE FABRIC TO THE SUPPORT WIRE/MESH (IF ANY) AT A MAXIMUM SPACING OF 1m.

13. ENSURE THE COMPLETED SEDIMENT FENCE IS AT LEAST 450mm, BUT NOT MORE THAN 700mm HIGH. IF A SPILL-THOUGH WEIR IS INSTALLED, ENSURE THE CREST OF THE WEIR IS AT LEAST 300mm ABOVE GROUND LEVEL.

14. BACKFILL THE TRENCH AND TAMP THE FILL TO FIRMLY ANCHOR THE BOTTOM OF THE FABRIC AND MESH TO PREVENT WATER FROM FLOWING UNDER THE FENCE.

ADDITIONAL REQUIREMENTS FOR THE INSTALLATION OF A SPILL-THROUGH WEIR

1. LOCATE THE SPILL-THROUGH WEIR SUCH THAT THE WEIR CREST WILL BE LOWER THAN THE GROUND LEVEL AT EACH END OF THE FENCE.

2. ENSURE THE CREST OF THE SPILL-THROUGH WEIR IS AT LEAST 300mm THE GROUND ELEVATION.

3. SECURELY TIE A HORIZONTAL CROSS MEMBER (WEIR) TO THE SUPPORT POSTS/ STAKES EACH SIDE OF THE WEIR. CUT THE FABRIC DOWN THE SIDE OF EACH POST AND FOLD THE FABRIC OVER THE CROSS MEMBER AND APPROPRIATELY SECURE THE FABRIC.

4. INSTALL A SUITABLE SPLASH PAD AND/OR CHUTE IMMEDIATELY DOWN-SLOPE OF THE SPILL-THROUGH WEIR TO CONTROL SOIL EROSION AND APPROPRIATELY DISCHARGE THE CONCENTRATED FLOW PASSING OVER THE WEIR.

MAINTENANCE

1. INSPECT THE SEDIMENT FENCE AT LEAST WEEKLY AND AFTER ANY SIGNIFICANT RAIN. MAKE NECESSARY REPAIRS IMMEDIATELY.

2. REPAIR ANY TORN SECTIONS WITH A CONTINUOUS PIECE OF FABRIC FROM POST TO POST.

3. WHEN MAKING REPAIRS, ALWAYS RESTORE THE SYSTEM TO ITS ORIGINAL CONFIGURATION UNLESS AN AMENDED LAYOUT IS REQUIRED OR SPECIFIED.

4. IF THE FENCE IS SAGGING BETWEEN STAKES, INSTALL ADDITIONAL SUPPORT POSTS.

5. REMOVE ACCUMULATED SEDIMENT IF THE SEDIMENT DEPOSIT EXCEEDS A DEPTH OF 1/3 THE HEIGHT OF THE FENCE.

6. DISPOSE OF SEDIMENT IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

7. REPLACE THE FABRIC IF THE SERVICE LIFE OF THE EXISTING FABRIC EXCEEDS 6-MONTHS.

REMOVAL

1. WHEN DISTURBED AREAS UP-SLOPE OF THE SEDIMENT FENCE ARE SUFFICIENTLY STABILISED TO RESTRAIN EROSION, THE FENCE MUST BE REMOVED.

2. REMOVE MATERIALS AND COLLECTED SEDIMENT AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

3. REHABILITATE/REVEGETATE THE DISTURBED GROUND AS NECESSARY TO MINIMISE THE EROSION HAZARD.

Drawn:	Date:		
GMW	May-10	Sediment Fence	ESC-05

Catchments & Creeks Pty Ltd

MATERIALS

ROCK: 150 TO 300mm EQUIVALENT DIAMETER, HARD, EROSION RESISTANT ROCK.

SANDBAGS: GEOTEXTILE BAGS (WOVEN SYNTHETIC, OR NON-WOVEN BIODEGRADABLE) FILLED WITH CLEAN COARSE SAND, CLEAN AGGREGATE, OR COMPOST.

INSTALLATION (ROCK CHECK DAM)

1. REFER TO APPROVED PLANS FOR LOCATION AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. PRIOR TO PLACEMENT OF THE SEDIMENT TRAP, ENSURE THE DRAINAGE CHANNEL IS DEEP ENOUGH TO PREVENT WATER BEING UNSAFELY DIVERTED OUT OF THE DRAIN ONCE THE CHECK DAMS ARE INSTALLED.

3. LOCATE EACH CHECK DAM SEDIMENT TRAP AS DIRECTED WITHIN THE APPROVED PLANS, OR OTHERWISE AT SUCH A SPACING TO ACHIEVE THE REQUIRED SEDIMENT TRAPPING OUTCOMES.

4. IF THE CHECK DAMS ARE ALSO BEING USED TO CONTROL EROSION WITHIN THE DRAINAGE CHANNEL, THEN LOCATE EACH SUCCESSIVE CHECK DAM SUCH THAT THE CREST OF THE IMMEDIATE DOWNSTREAM DAM IS LEVEL WITH THE CHANNEL INVERT AT THE IMMEDIATE UPSTREAM CHECK DAM.

5. CONSTRUCT EACH CHECK DAM TO THE DIMENSIONS AND PROFILE SHOWN WITHIN THE APPROVED PLAN.

6. WHERE SPECIFIED, THE CHECK DAMS MUST BE CONSTRUCTED ON A SHEET OF GEOTEXTILE FABRIC USED AS A DOWNSTREAM SPLASH PAD.

7. EACH CHECK DAM MUST BE EXTENDED UP THE CHANNEL BANK (WHERE PRACTICABLE) TO AN ELEVATION AT LEAST 150mm ABOVE THE CREST LEVEL OF THE DAM.

INSTALLATION (COMPOST-FILLED SOCKS)

1. REFER TO APPROVED PLANS FOR LOCATION AND INSTALLATION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION OR METHOD OF INSTALLATION CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. PRIOR TO PLACEMENT OF THE SEDIMENT TRAP, ENSURE THE DRAINAGE CHANNEL IS DEEP ENOUGH TO PREVENT WATER BEING UNSAFELY DIVERTED OUT OF THE DRAIN ONCE THE CHECK DAMS ARE INSTALLED.

3. LOCATE EACH SOCK AS DIRECTED WITHIN THE APPROVED PLANS, OR OTHERWISE AT SUCH A SPACING TO ACHIEVE THE REQUIRED SEDIMENT TRAPPING OUTCOMES.

4. PLACE EACH SOCK TO THE LINES AND PROFILE SHOWN IN THE APPROVED PLAN OR AS DIRECTED BY THE SITE SUPERVISOR.

5. ENSURE EACH SOCK EXTENDS UP THE CHANNEL BANKS (WHERE PRACTICAL) TO A LEVEL AT LEAST 100mm ABOVE THE CREST LEVEL OF THE CHECK DAM.

MAINTENANCE

1. INSPECT EACH CHECK DAM AND THE DRAINAGE CHANNEL AT LEAST WEEKLY AND AFTER RUNOFF-PRODUCING RAINFALL.

2. CORRECT ALL DAMAGE IMMEDIATELY. IF SIGNIFICANT EROSION OCCURS BETWEEN ANY OF THE CHECK DAMS, THEN CHECK THE SPACING OF THE DAMS AND WHERE NECESSARY INSTALL INTERMEDIATE CHECK DAMS OR A SUITABLE CHANNEL LINER.

3. CHECK FOR DISPLACEMENT OF THE CHECK DAMS.

4. CHECK FOR SOIL SCOUR AROUND THE ENDS OF EACH CHECK DAM. IF SUCH EROSION IS OCCURRING, CONSIDER EXTENDING THE WIDTH OF THE CHECK DAM TO AVOID SUCH PROBLEMS.

5. IF SEVERE SOIL EROSION OCCURS EITHER UNDER OR AROUND THE CHECK DAMS, THEN SEEK EXPERT ADVICE ON AN ALTERNATIVE TREATMENT MEASURE.

6. DE-SILT SEDIMENT TRAP IF THE SEDIMENT LEVEL EXCEEDS 1/3 THE CREST HEIGHT.

7. DISPOSE OF COLLECTED SEDIMENT IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN CONSTRUCTION WORK WITHIN THE DRAINAGE AREA ABOVE THE CHECK DAMS HAS BEEN COMPLETED AND DISTURBED AREAS SUFFICIENTLY STABILISED TO RESTRAIN EROSION, THE DAMS MUST BE REMOVED, UNLESS THE SEDIMENT TRAPS ARE TO REMAIN AS A PERMANENT FEATURE.

2. REMOVE COLLECTED SEDIMENT AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

3. REMOVE AND APPROPRIATELY DISPOSE OF ALL MATERIALS INCLUDING ANY GEOTEXTILE FABRIC.

4. STABILISE THE DISTURBED CHANNEL WITH A LINING OF FABRIC AND ROCK, OR ESTABLISH VEGETATION AS APPROPRIATE.

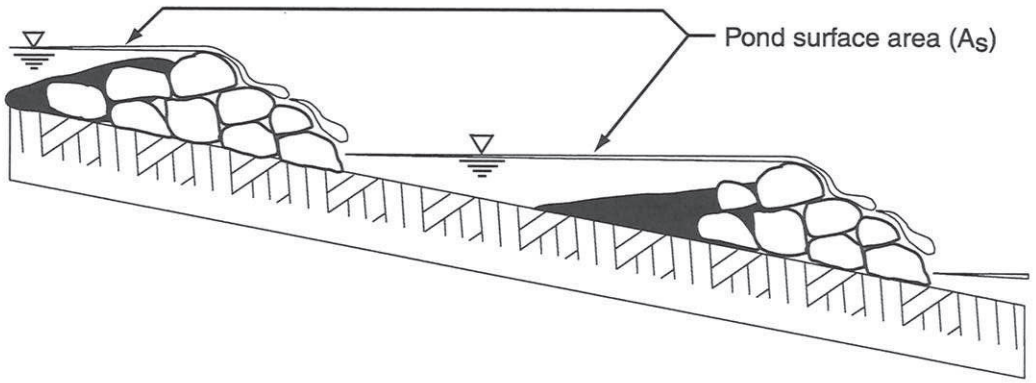

Figure 1 - Placement of check dam sediment traps

Drawn:	Date:		
GMW	Apr-10	Check Dam Sediment Trap	CDT-01

Catchments & Creeks Pty Ltd

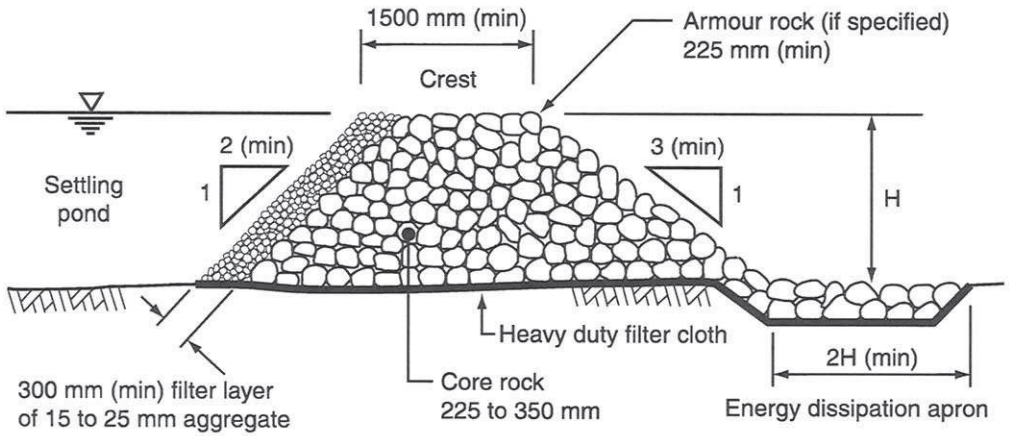

(a) Rock filter dam with aggregate filter

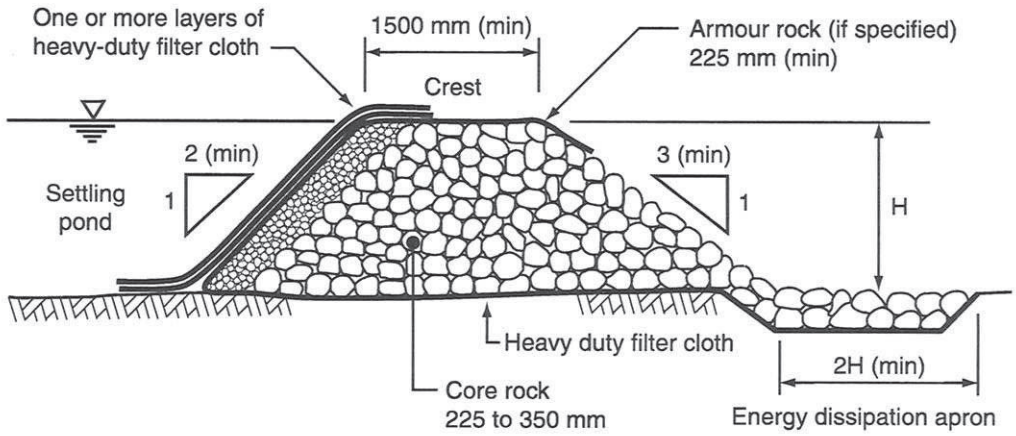

(b) Rock filter dam with geotextile and aggregate filter

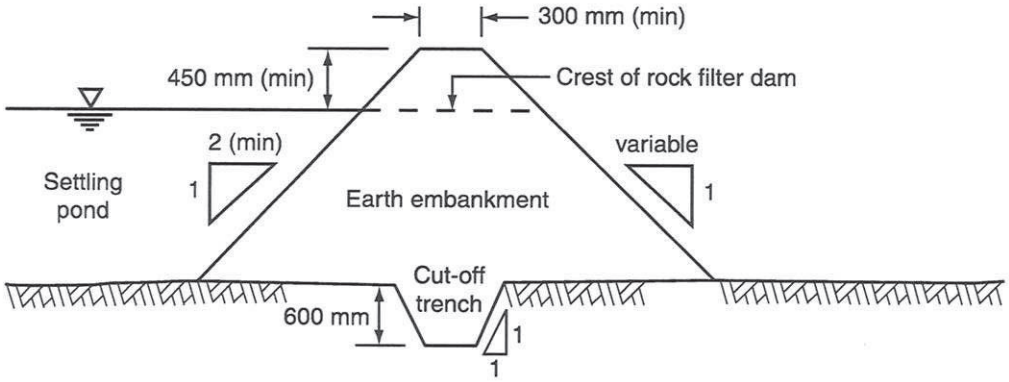

(c) Typical cross-section of constructed earth abutment

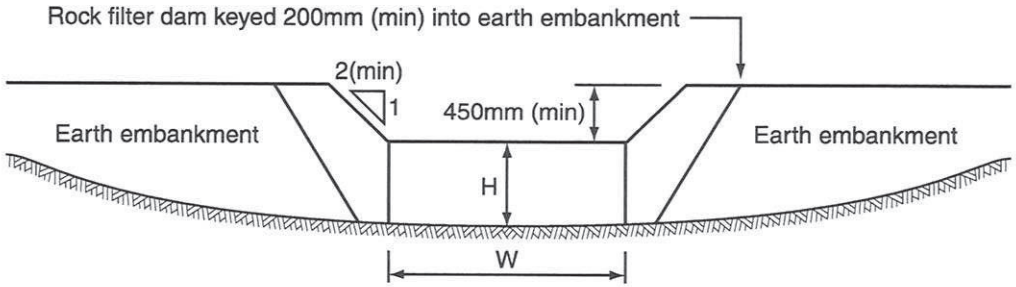

(d) Typical profile of rock filter dam crest when integrated into an earth embankment

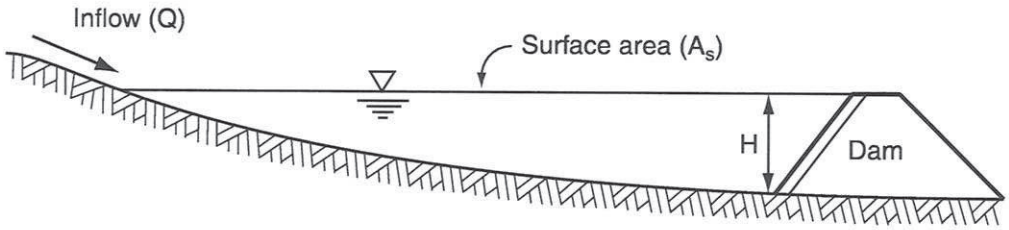

(e) Settling pond

Drawn:	Date:		
GMW	Feb-10	Rock Filter Dam	RFD-01

Catchments & Creeks Pty Ltd

MATERIALS

PRIMARY CORE ROCK: WELL GRADED, HARD, ANGULAR, EROSION RESISTANT ROCK, WITH MEAN SIZE AS SPECIFIED IN THE APPROVED PLAN, BUT NOT LESS THAN 225mm, OR GREATER THAN 350mm.

ARMOUR ROCK: WELL GRADED, HARD, ANGULAR, EROSION RESISTANT ROCK, WITH MEAN SIZE AS SPECIFIED IN THE APPROVED PLAN, BUT NOT LESS THAN 225mm.

AGGREGATE FILTER: 15 TO 25mm CLEAN AGGREGATE.

GEOTEXTILE FILTER FABRIC: HEAVY-DUTY NON-WOVEN, NEEDLE-PUNCHED FILTER FABRIC, MINIMUM 'BIDIM' A34 OR EQUIVALENT.

INSTALLATION

1. REFER TO APPROVED PLANS FOR LOCATION AND CONSTRUCTION DETAILS. IF THERE ARE QUESTIONS OR PROBLEMS WITH THE LOCATION, OR METHOD OF INSTALLATION, CONTACT THE ENGINEER OR RESPONSIBLE ON-SITE OFFICER FOR ASSISTANCE.

2. CLEAR THE FOUNDATION AREA OF THE ROCK FILTER DAM OF WOODY VEGETATION AND ORGANIC MATTER. DELAY CLEARING THE UP-SLOPE POND AREA UNTIL THE DAM IS FORMED AND IS ABLE TO ACT AS A SUITABLE SEDIMENT TRAP, OTHERWISE AN ALTERNATIVE TEMPORARY DOWNSTREAM SEDIMENT TRAP MAY BE REQUIRED DURING CONSTRUCTION OF THE ROCK FILTER DAM.

3. IF SPECIFIED ON THE PLANS, EXCAVATE A CUT-OFF TRENCH ALONG THE CENTRE-LINE OF THE DAM AND EARTH ABUTMENTS (IF ANY).

4. COVER THE FOUNDATION AREA AND CUT-OFF TRENCH WITH HEAVY-DUTY FILTER FABRIC BEFORE BACKFILLING WITH THE CORE ROCK. OVERLAP ADJOINING FABRIC SHEETS A MINIMUM OF 600mm.

5. CONSTRUCT THE ASSOCIATED EARTH ABUTMENT (IF ANY). ALL CUT AND FILL SLOPES SHOULD BE 2:1(H:V) OR FLATTER. THE DOWNSTREAM FACE OF EARTH ABUTMENTS SHOULD BE 3:1(H:V) OR FLATTER. EARTH ABUTMENTS SHOULD BE CONSTRUCTED OF WELL-COMPACTED, EROSION RESISTANT SOIL THAT IS FREE OF VEGETATION AND ROOTS. OVERFILL EARTH ABUTMENTS 150mm TO ALLOW FOR SETTLEMENT.

6. PLACE THE CORE ROCK FOR THE ROCK FILTER DAM. ENSURE THE UPSTREAM FACE IS 2:1(H:V) OR FLATTER, AND THE DOWNSTREAM FACE IS 3:1(H:V) OR FLATTER.

7. ENSURE THE ROCK IS MACHINE PLACED WITH THE SMALLER ROCKS WORKED INTO THE VOIDS OF THE LARGER ROCKS.

8. IF SPECIFIED, CONSTRUCT THE SPILLWAY SECTION USING THE SPECIFIED ARMOUR ROCK. THE SPILLWAY SHOULD HAVE A MINIMUM PROFILE DEPTH OF 300mm. THE SPILLWAY WEIR CREST MUST BE LEVEL ACROSS ITS FULL WIDTH. THE MAXIMUM LONGITUDINAL SLOPE OF THE ROCK SPILLWAY SHOULD BE 3:1(H:V). THE MINIMUM THICKNESS OF ARMOUR ROCK PROTECTION SHOULD BE 500mm, OR TWICE THE NOMINAL ROCK SIZE, WHICHEVER IS THE GREATER.

9. ENSURE THE SPILLWAY OUTLET SECTION EXTENDS DOWNSTREAM PAST THE TOE OF THE FORMED EMBANKMENT UNTIL STABLE CONDITIONS ARE REACHED, OR A DISTANCE EQUAL TO THE HEIGHT OF THE DAM, WHICHEVER IS THE GREATER. THE EDGES OF THE SPILLWAY SHOULD BE LEFT FLUSH WITH THE SURROUNDING GROUND.

10. INSTALL THE SPECIFIED FILTER (AGGREGATE AND/OR FILTER CLOTH) ON THE UPSTREAM FACE OF THE ROCK FILTER DAM.

11. IF FILTER CLOTH IS USED, THEN:
(i) EXTEND THE FABRIC OVER THE CREST OF THE ROCK FILTER DAM INTO THE SPILLWAY CHUTE;
(ii) CONSIDER THE PLACEMENT OF SEVERAL LAYERS OF OVERLAPPING FABRIC, THUS ALLOWING EACH LAYER TO BE REMOVED INDIVIDUALLY ONCE THE FABRIC BECOMES BLOCKED WITH SEDIMENT.

12. CLEAR THE SETTLING POND AREA OF WOODY VEGETATION AND ORGANIC MATTER TO THE DIMENSIONS SPECIFIED WITHIN THE PLANS.

13. WHERE NECESSARY, EXCAVATE THE UPSTREAM SETTLING POND AND/OR SEDIMENT STORAGE PIT IN ACCORDANCE WITH THE APPROVED PLANS. EXCAVATED PITS TYPICALLY HAVE SIDE SLOPES OF 2:1(H:V) OR FLATTER UNLESS STEEPER SLOPES ARE KNOWN TO BE STABLE.

14. STABILISE ANY ASSOCIATED EARTH EMBANKMENTS IMMEDIATELY AFTER CONSTRUCTION THROUGH APPROPRIATE COMPACTION, VEGETATION AND/OR EROSION CONTROL MATTING.

15. ESTABLISH ALL NECESSARY UP-SLOPE DRAINAGE CONTROL MEASURES TO ENSURE THAT SEDIMENT-LADEN RUNOFF IS APPROPRIATELY DIRECTED INTO THE SEDIMENT TRAP.

16. TAKE ALL NECESSARY MEASURE TO MINIMISE THE SAFETY RISK CAUSED BY THE STRUCTURE.

MAINTENANCE

1. CHECK ALL ROCK FILTER DAMS AFTER EACH RUNOFF EVENT AND MAKE REPAIRS IMMEDIATELY.

2. INSPECT ALL ROCK AND EARTH EMBANKMENTS FOR UNDERCUTTING OR UNDESIRABLE SEEPAGE FLOWS.

3. IDEALLY, ROCK FILTER DAMS SHOULD DISCHARGE (FROM FULL) OVER NO LESS THAN 8 HOURS. IF DRAINAGE IS TOO RAPID, THEN ADDITIONAL FILTER AGGREGATE MAYBE REQUIRED TO ACHIEVE OPTIMUM HYDRAULIC PERFORMANCE.

4. IF FLOW THROUGH THE STRUCTURE IS REDUCED TO AN UNACCEPTABLE LEVEL, THE UPSTREAM FILTER MEDIUM (AGGREGATE OR FILTER CLOTH) SHOULD BE REMOVED AND REPLACED.

5. IF A GREATER DEGREE OF WATER TREATMENT (FILTRATION) IS REQUIRED, EXTRA GEOTEXTILE FILTER FABRIC SHOULD BE PLACED OVER THE UPSTREAM FACE OF THE STRUCTURE.

6. CHECK THE STRUCTURE AND DOWNSTREAM CHANNEL BANKS FOR DAMAGE FROM OVERTOPPING FLOWS. MAKE REPAIRS AS NECESSARY.

7. IMMEDIATELY REPLACE ANY ROCK DISPLACED FROM THE SPILLWAY.

8. REMOVE SEDIMENT AND RESTORE ORIGINAL SEDIMENT STORAGE VOLUME WHEN COLLECTED SEDIMENT EXCEEDS 10% OF THE SPECIFIED STORAGE VOLUME.

9. DISPOSE OF SEDIMENT AND DEBRIS IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

REMOVAL

1. WHEN THE UP-SLOPE DRAINAGE AREA HAS BEEN STABILISED, REMOVE ALL MATERIALS INCLUDED DEPOSITED SEDIMENT AND DISPOSE OF IN A SUITABLE MANNER THAT WILL NOT CAUSE AN EROSION OR POLLUTION HAZARD.

2. ALL WATER AND SEDIMENT SHOULD BE REMOVED FROM THE SETTLING POND PRIOR TO THE DAM'S REMOVAL. DISPOSE OF SEDIMENT AND WATER IN A MANNER THAT WILL NOT CREATE AN EROSION OR POLLUTION HAZARD.

3. BRING THE DISTURBED AREA TO A PROPER GRADE, THEN SMOOTH, COMPACT AND STABILISE AND/OR REVEGETATE AS REQUIRED TO MINIMISE THE EROSION HAZARD.

Drawn:	Date:		
GMW	Apr-10	Rock Filter Dam	RFD-02

Catchments & Creeks Pty Ltd

Appendix C
Veris Australia Pty Ltd Site Context Plan

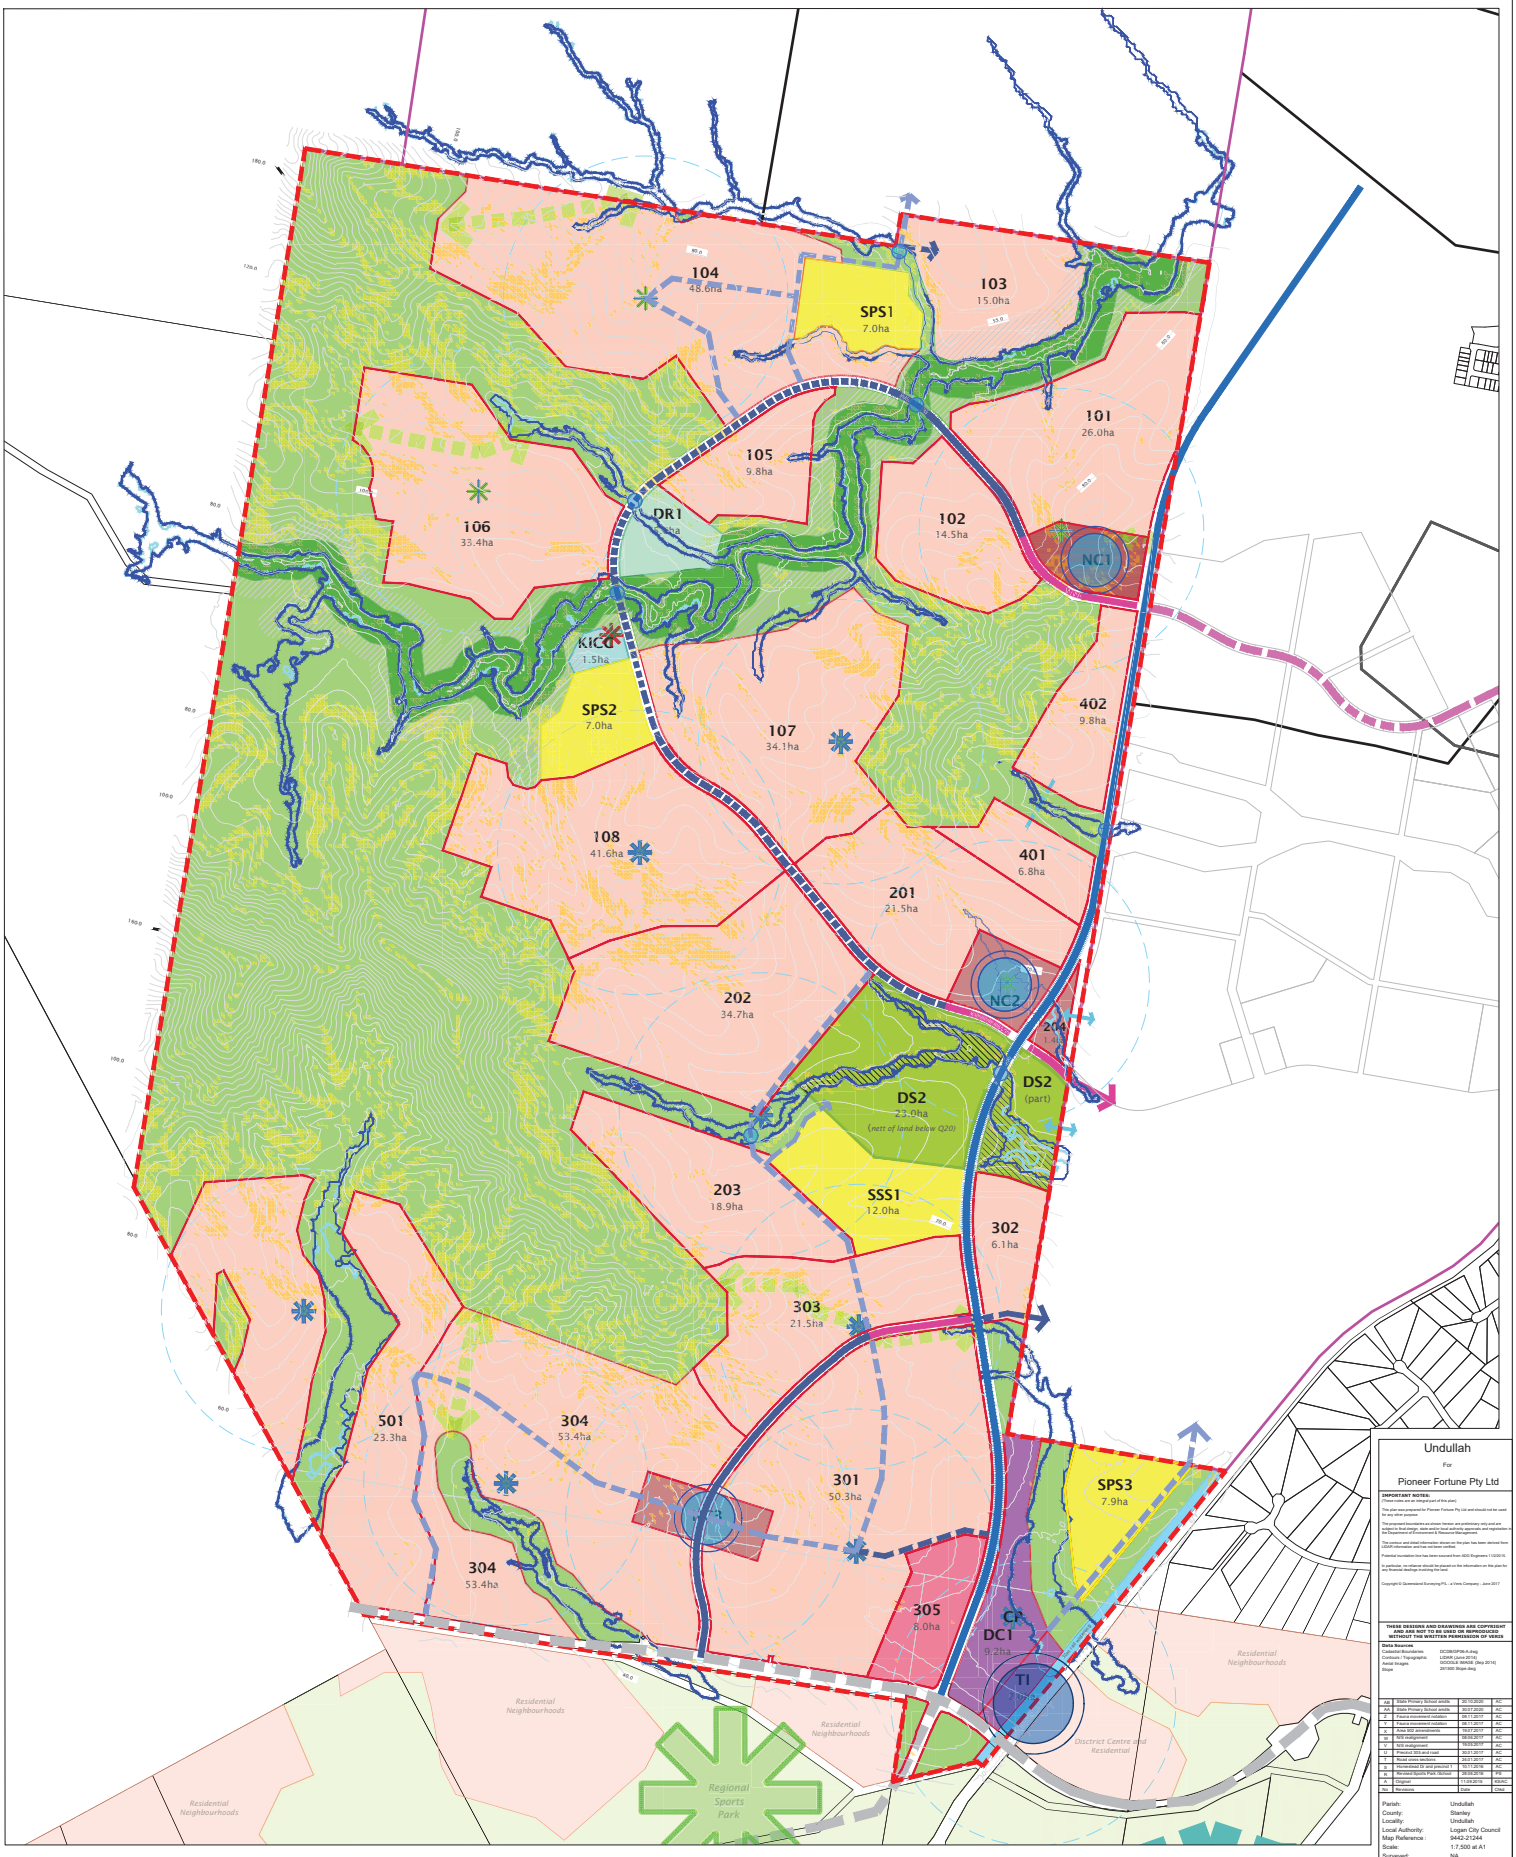

Undullah

For

Pioneer Fortune Pty Ltd

IMPORTANT NOTES:

(These notes are an integral part of this plan)

This plan was prepared for Pioneer Fortune Pty Ltd and should not be used for any other purpose.

The proposed boundaries are shown hereon are preliminary only and are subject to final design, state and/or local authority approvals and registration of the Department of Environment & Resource Management.

The contour and detail information shown on the plan has been derived from Aerial Photography and Digital Cadastral Data.

Residual Inundation line has been sourced from SEQ Ingenia / Q1000 DL

In particular, no reliance should be placed on the information on this plan for any financial dealings involving the land.

Copyright © Queensland Surveying P/L – a Veris Company – June 2017

THESE DESIGNS AND DRAWINGS ARE COPYRIGHT AND ARE NOT TO BE USED OR REPRODUCED WITHOUT THE WRITTEN PERMISSION OF VERIS

Data Sources

Cadastral Boundaries:	DCDB/PSM-A.dwg
Contours / Topographic:	LIDAR (June 2016)
Aerial Images:	GOOGLE IMAGE (Sep 2016)
Slope:	2013D Slope.dwg

AB	State Primary School amdts	03/10/2020	AC
AA	State Primary School amdts	05/07/2020	AC
Z	Feature movement notation	09/11/2017	AC
Y	Feature movement notation	08/11/2017	AC
X	Area 902 amendments	19/07/2017	AC
W	902 realignment	08/06/2017	AC
V	902 realignment	16/05/2017	AC
U	Precinct 305 and road	30/01/2017	AC
T	Road cross sections	04/01/2017	AC
S	Numbered DI and precinct 1	30/11/2016	AC
R	Revised Sports Park Precinct	28/09/2016	AC
A	Original	11/08/2016	KS/AC
No	Revisions	Date	Chkd

Parish: Undullah
County: Stanley
Locality: Undullah
Local Authority: Logan City Council
Map Reference : 9442-21244
Scale: 1:7,500 at A1
Surveyed: NA
Designed: NA
Drawn: AC
Checked: AC
Plot Date: 20 Oct, 2020
Computer File Ref: 30729 GP07-AB Context Plan 150M 2014.dwg

Context Plan

Land Uses				Centres and Employment			Open Space		Site Information
Residential		Av Density	Area			Area			Site Boundary
District Centre		40dw/ha	9.3ha	District Centre	DC	4.5ha	Environmental / Buffers / Waterways		Gradient - 0% - 16%
District Centre Transition		25dw/ha	8ha	Transport Interchange	TI	2.0ha	District Sports	DS	Gradient - 16% - 20%
Neighbourhood Centre		20dw/ha	9.0ha	Neighbourhood Centre	NC	6.5ha	District Recreation	DR	Gradient (over 20%)
Urban Res Neighbourhoods		14.5dw/ha		Karawatha Interpretive Community Centre	KICC	1.5ha	Neighbourhood Recreation Park		Flood Line (Q20)
Urban	10%	18dw/ha		Employment Land	EL	2.0ha	Civic Park	CP	Flood Line (Q100)
Semi-Urban	40%	15dw/ha					Urban Linkages (integrated into layout)		Ridgelines (major)
Suburban	45%	12.5dw/ha		**Roads**			Biodiversity Corridor (Development Scheme)		Endangered Vegetation
Urban Fringe	5%	8dw/ha		38m Urban Arterial Road			400m walkable neighbourhood (around N/R)		Sandy Creek 100m Core
				32.6m Trunk Connector (4 lane)			Potential location of fauna movement structure *(subject to detailed assessment at ROL stage)*		Sandy Creek Buffer
Education Facilities			Area	23.4m Trunk Connector (no parking)					Connected Watercourse
State Primary School		SPS1	7.0ha	23.4m Trunk Connector (parking)					Unconnected Watercourse
State Secondary School		SSS1	12.0ha	22.4m Neighbourhood Connector					Powerful Owl Site

0 375m 750m 1125m SCALE BAR

veris

BRISBANE (07) 3466 4760
WHITSUNDAYS (07) 4941 1702
MACKAY (07) 4957 2911
CAIRNS (07) 4051 8732

veris.com.au

ACN 615 735 727
Veris Australia Pty Ltd

Drawing No. 30729-GP07

Issue AB

Appendix D
Department of Natural Resources Soil and Land Information

Project LARA Site 152 Observation 1

SALI2078

Project description

Project name:	Soil and Land Resources of the Logan and Albert Rivers Catchment
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	Areas of Logan and Albert rivers catchments south of Greenbank-Park Ridge not covered by the Boonah (BNH) survey.

Site characteristics

Date described:	13/09/2006	Observation type:	Relatively undisturbed soil core
Described by:	LOIJ	Observation class:	Class I (detailed soil profile description)

Slope (%):	11	Morphological type:	Mid-slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Rises

Soil Name:	Pine Vale(1) (Pv)	Substrate lithology:	Sandstone
Runoff:	Moderately rapid	Depth to free water:	Not recorded
Permeability:	Moderately permeable (50-500 mm/day)	Erosion:	No type recorded - old data only
Drainage:	Imperfectly drained	Microrelief type:	Zero or none
Disturbance:	Limited clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Hard setting	Horizontal interval (m):	N/A
Surface coarse fragments:	No coarse fragments	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.81405	152.91943	56	492065	6923393	Not recorded	Averaging GPS
GDA 2020	-27.81404	152.91944	56	492066	6923394		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Bleached-Mottled, Mesotrophic, Grey Chromosol; medium, non-gravelly, loamy, clayey, moderate.	No analytical data are available but confidence is fair.	Isbell (2002) The Australian Soil Classification Revised Edition.	N/A		

Vegetation

Community name	Tree, Corymbia citriodora	
Stratum	Species	Common name
Tallest	*Corymbia citriodora*	lemon-scented gum
	Acacia	A wattle

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.18	Greyish yellow-brown (10YR 4/2) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	
2	A2e	0.18	0.39	Dull yellowish orange (10YR 6/3) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	
3	B21	0.39	0.59	Greyish yellow-brown (10YR 6/2) moist	many (20-50%) medium (5-15 mm) distinct orange mottles;	Fine sandy light medium clay	Strong 10-20 mm Prismatic structure;	very few (<2%) subrounded quartz medium pebbles (6-20 mm);	No segregations;	Moderately moist, Weak strength;	
4	B22	0.59	0.82	Brownish grey (10YR 5/1) moist	common (10-20%) fine (<5 mm) distinct orange mottles;	Fine sandy light medium clay	Strong 5-10 mm Angular blocky structure;	no coarse fragments;	No segregations;	Moderately moist, Firm strength;	
5	C	0.82	0.85		no mottles or other colour patterns mottles;		Massive structure;	very abundant (>90%) sandstone not recorded;	No segregations;		

Field test	
pH by Raupach and Tucker method	
Depth (m)	Value
0.05	6
0.3	6.0
0.6	6.5
0.8	7.0

Field test	
Field EC 1:5 soil/water dS/m	
Depth (m)	Value
0.05	0.12
0.3	0.12
0.6	0.14
0.8	0.17

Notes			
Note level	Horizon name	Horizon no	Note
Observation			This landscape appears sandier than the Mundoolun Gatton Sandstones, particularly in the surface.
Observation			B2's felt slightly sodic, however permeability given from structure and low EC.
Observation			Depth stopped due to weathered rock
Observation			Site location, mid slope, slightly accumulative. Vegetation is mid dense Acacia scrub with 4-5m high spotted gums scattered throughout.
Observation			Similar to site 151 (which is very nearby), just a bit deeper, indicating the accumulation of material at this site and the loss of material at the site above.
Horizon	A1	1	Drainage 5
Horizon	A2e	2	Drainage 4
Horizon	B21	3	Drainage 3
Horizon	B22	4	Drainage 3
Horizon	B22	4	John suspects might be closer to drainage 2

Project description

Project name:	Soil and Land Resources of the Logan and Albert Rivers Catchment
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	Areas of Logan and Albert rivers catchments south of Greenbank-Park Ridge not covered by the Boonah (BNH) survey.

Site characteristics

Date described:	13/09/2006	Observation type:	Relatively undisturbed soil core
Described by:	LOIJ	Observation class:	Class I (detailed soil profile description)

Slope (%):	14	Morphological type:	Mid-slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Low hills

Soil Name:	Pine Vale(1) (Pv)	Substrate lithology:	Sandstone
Runoff:	Moderately rapid	Depth to free water:	Not recorded
Permeability:	Moderately permeable (50-500 mm/day)	Erosion:	No type recorded - old data only
Drainage:	Imperfectly drained	Microrelief type:	Zero or none
Disturbance:	Limited clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Firm	Horizontal interval (m):	N/A
Surface coarse fragments:	No coarse fragments	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.80650	152.90981	56	491117	6924228	Not recorded	Averaging GPS
GDA 2020	-27.80650	152.90982	56	491118	6924229		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Bleached-Mottled, Dystrophic, Grey Kurosol; thick, non-gravelly, sandy, clayey, deep.	No analytical data are available but confidence is fair.	Isbell (2002) The Australian Soil Classification Revised Edition.	N/A		

Vegetation

Community name	Very tall woodland, Eucalyptus tereticornis	
Stratum	Species	Common name
Tallest 20.01-35 m	*Eucalyptus tereticornis*	blue gum, forest red gum
	Corymbia intermedia	pink bloodwood, red bloodwood

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.08	Greyish yellow-brown (10YR 4/2) moist	no mottles or other colour patterns mottles;	Loamy sand	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	gradual
2	A21	0.08	0.35	Dull yellowish brown (10YR 5/3) moist	few (2-10%) fine (<5 mm) distinct brown mottles;	Loamy sand	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	gradual
3	A22e	0.35	0.49	Dull yellowish orange (10YR 6/3) moist	few (2-10%) fine (<5 mm) distinct brown mottles;	Loamy sand	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	clear
4	B2	0.49	1.1	Light grey (10YR 7/1) moist	many (20-50%) medium (5-15 mm) distinct orange mottles;	Fine sandy light medium clay	Strong 10-20 mm Prismatic structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	gradual
5	C	1.1	1.13		no mottles or other colour patterns mottles;				No segregations;	Dry, Weak strength;	

Field test	
pH by Raupach and Tucker method	
Depth (m)	Value
0.05	6.5
0.3	6.0
0.6	5.0
0.9	5.0
1.1	5.0

Notes			
Note level	Horizon name	Horizon no	Note
Observation			All textures non-sodic.
Horizon	A1	1	Drainage 5
Horizon	A21	2	Drainage 4
Horizon	A22e	3	Drainage 4
Horizon	B2	4	Drainage 3

Project description

Project name:	Soil and Land Resources of the Logan and Albert Rivers Catchment
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	Areas of Logan and Albert rivers catchments south of Greenbank-Park Ridge not covered by the Boonah (BNH) survey.

Site characteristics

Date described:	13/09/2006	Observation type:	Relatively undisturbed soil core
Described by:	LOIJ	Observation class:	Class I (detailed soil profile description)

Slope (%):	4	Morphological type:	Lower slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Low hills

Soil Name:	Stockleigh(1) (St)	Substrate lithology:	Sandstone
Runoff:	Moderately rapid	Depth to free water:	Not recorded
Permeability:	Moderately permeable (50-500 mm/day)	Erosion:	No type recorded - old data only
Drainage:	Imperfectly drained	Microrelief type:	Zero or none
Disturbance:	Extensive clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Hard setting	Horizontal interval (m):	N/A
Surface coarse fragments:	Very few (<2%), angular, sandstone, cobbles (60-200 mm)	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.80969	152.91643	56	491769	6923876	Not recorded	Averaging GPS
GDA 2020	-27.80968	152.91644	56	491770	6923877		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Mottled, Mesotrophic, Grey Chromosol; medium, non-gravelly, loamy, clayey, deep.	No analytical data are available but confidence is fair.	Isbell (2002) The Australian Soil Classification Revised Edition.	N/A		

Vegetation

Community name	Tall woodland, Eucalyptus tereticornis	
Stratum	Species	Common name
Tallest 12.01-20 m	*Eucalyptus tereticornis*	blue gum, forest red gum

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.11	Greyish yellow-brown (10YR 4/2) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Moderate 2-5 mm Subangular blocky structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	
2	B21	0.11	0.38	Brownish grey (10YR 4/1) moist	common (10-20%) fine (<5 mm) distinct brown mottles;	Fine sandy light medium clay	Strong 10-20 mm Prismatic structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	
3	B22	0.38	0.8	Dull yellowish orange (10YR 6/4) moist	common (10-20%) medium (5-15 mm) distinct orange mottles; few (2-10%) fine (<5 mm) distinct pale mottles;	Fine sandy light medium clay	Strong 10-20 mm Prismatic structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	
4	B23	0.8	1.25	Greyish yellow (2.5Y 7/2) moist	many (20-50%) medium (5-15 mm) distinct orange mottles;	Fine sandy light medium clay	Moderate 5-10 mm Angular blocky structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	
5	C	1.25	1.27		no mottles or other colour patterns mottles;				No segregations;		

Field test	
pH by Raupach and Tucker method	
Depth (m)	Value
0.05	5.5
0.3	6.0
0.6	6
0.9	5.0
1.2	5.0

Field test	
Field EC 1:5 soil/water dS/m	
Depth (m)	Value
0.05	0.07
0.3	0.09
0.6	0.18
0.9	0.34
1.2	0.41

Notes			
Note level	Horizon name	Horizon no	Note
Observation			B2 textures slightly sodic
Horizon	A1	1	Drainage 5
Horizon	B21	2	Drainage 4
Horizon	B22	3	Drainage 3
Horizon	B23	4	Drainage 3

Project description

Project name:	Soil and Land Resources of the Logan and Albert Rivers Catchment
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	Areas of Logan and Albert rivers catchments south of Greenbank-Park Ridge not covered by the Boonah (BNH) survey.

Site characteristics

Date described:	13/09/2006	Observation type:	Relatively undisturbed soil core
Described by:	LOIJ	Observation class:	Class I (detailed soil profile description)

Slope (%):	2	Morphological type:	Crest
Slope type:	Estimate	Landform element:	Hillcrest
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Low hills

Soil Name:	Birnam(1) (Bi)	Substrate lithology:	Sandstone
Runoff:	Slow	Depth to free water:	Not recorded
Permeability:	Moderately permeable (50-500 mm/day)	Erosion:	No type recorded - old data only
Drainage:	Imperfectly drained	Microrelief type:	Zero or none
Disturbance:	Limited clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Hard setting	Horizontal interval (m):	N/A
Surface coarse fragments:	Many (20-50%), angular, sandstone, boulders (600 mm-2 m)	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.80862	152.92759	56	492868	6923995	Not recorded	Averaging GPS
GDA 2020	-27.80861	152.92760	56	492869	6923996		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Mottled, Mesotrophic, Yellow Chromosol; medium, non-gravelly, loamy, clayey, moderate.	No analytical data are available but confidence is fair.	Isbell (2002) The Australian Soil Classification Revised Edition.	N/A		

Vegetation

Community name	Very tall woodland, Eucalyptus melanophloia	
Stratum	Species	Common name
Tallest 20.01-35 m	*Eucalyptus melanophloia*	silver-leaved ironbark, silver ironbark
	Corymbia citriodora	lemon-scented gum

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.08	Greyish yellow-brown (10YR 4/2) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Very weak strength;	gradual
2	A2e	0.08	0.23	Dull yellowish orange (10YR 6/3) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Weak structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	clear
3	B2	0.23	0.6	Dull yellowish orange (10YR 6/4) moist	common (10-20%) fine (<5 mm) distinct red mottles; few (2-10%) fine (<5 mm) distinct pale mottles;	Light medium clay	Strong 10-20 mm Prismatic structure;	no coarse fragments;	No segregations;	Moderately moist, Firm strength;	gradual
4	C	0.6	0.62		no mottles or other colour patterns mottles;				No segregations;		

Field test

pH by Raupach and Tucker method

Depth (m)	Value
0.05	6.0
0.3	6.0
0.6	6.0

Notes			
Note level	Horizon name	Horizon no	Note
Site			John says the rocks here look finer grained and more feldspathic than observed at Mundoolun.
Observation			Depth - fortunate to get over 0.5m.
Observation			B2 only slightly sodic.
Horizon	A1	1	Drainage 5
Horizon	A2e	2	Drainage 4
Horizon	B2	3	B2 feels slightly sodic
Horizon	B2	3	Drainage 3

Project description	
Project name:	Soil and Land Resources of the Logan and Albert Rivers Catchment
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	Areas of Logan and Albert rivers catchments south of Greenbank-Park Ridge not covered by the Boonah (BNH) survey.

Site characteristics			
Date described:	13/09/2006	Observation type:	Relatively undisturbed soil core
Described by:	LOIJ	Observation class:	Class I (detailed soil profile description)

Slope (%):	12	Morphological type:	Lower slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Rises

Soil Name:	Pine Vale(1) (Pv)	Substrate lithology:	Sandstone
Runoff:	Moderately rapid	Depth to free water:	Not recorded
Permeability:	Moderately permeable (50-500 mm/day)	Erosion:	No type recorded - old data only
Drainage:	Imperfectly drained	Microrelief type:	Zero or none
Disturbance:	Extensive clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Hard setting	Horizontal interval (m):	N/A
Surface coarse fragments:	No coarse fragments	Microrelief component sampled:	N/A

Site location							
Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.81618	152.92168	56	492287	6923157	Not recorded	Averaging GPS
GDA 2020	-27.81617	152.92169	56	492288	6923158		

Soil classification					
Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Bleached-Mottled, Eutrophic, Grey Chromosol; thick, non-gravelly, sandy, clayey, deep.	No analytical data are available but confidence is fair.	Isbell (2002) The Australian Soil Classification Revised Edition.	N/A		

Profile morphology											
No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.12	Greyish yellow-brown (10YR 4/2) moist	no mottles or other colour patterns mottles;	Loamy sand	Weak structure;	no coarse fragments;	No segregations;	Moist, Very weak strength;	gradual
2	A2e	0.12	0.35	Greyish yellow-brown (10YR 6/2) moist	no mottles or other colour patterns mottles;	Loamy sand	Weak structure;	no coarse fragments;	No segregations;	Wet, Very weak strength;	clear
3	B21	0.35	0.74	Greyish yellow (2.5Y 6/2) moist	common (10-20%) medium (5-15 mm) distinct orange mottles;	Fine sandy light medium clay	Strong 10-20 mm Prismatic structure;	no coarse fragments;	No segregations;	Moderately moist, Weak strength;	gradual
4	B22	0.74	1	Dark greyish yellow (2.5Y 5/2) moist	common (10-20%) medium (5-15 mm) distinct grey mottles;	Fine sandy light clay	Moderate 5-10 mm Angular blocky structure;	no coarse fragments;	No segregations;	Moderately moist, Firm strength;	

Field test	
pH by Raupach and Tucker method	
Depth (m)	Value
0.05	5.5
0.3	6.0
0.6	7.0
0.9	7.5

Field test	
Field EC 1:5 soil/water dS/m	
Depth (m)	Value
0.05	0.07
0.3	0.08
0.6	0.14
0.9	0.18

Notes			
Note level	Horizon name	Horizon no	Note
Observation			Depth - not sure if hit rock or not, might be a little deeper.
Observation			B2 textures only slightly sodic.
Horizon	A1	1	Depth 4
Horizon	A2e	2	Drainage 4
Horizon	B21	3	Drainage 3
Horizon	B22	4	Drainage 3

Based on or contains data provided by the State of Queensland 2020. The State makes no representations or warranties in relation to the supplied data, and you agree that, to the extent permitted by law, all warranties relating to accuracy, reliability, completeness, currency or suitability for any particular purpose and all liability for any loss, damage or costs (including consequential damage) incurred in any way (including but not limited to that arising from negligence) in connection with any use of or reliance on the supplied data are excluded or limited. You agree to continually indemnify the State (including its officers and employees) against any loss, cost, expense, damage and liability of any kind (including consequential damage and liability in negligence) arising directly or indirectly from or related to any claim relating to your use of the supplied data or any product made from the supplied data.

© State of Queensland, 2020 The Queensland Government supports and encourages the dissemination and exchange of its information. The copyright in this publication is licensed under a Creative Commons Attribution 4.0 International (CC BY 4.0) licence. Under this licence you are free, without having to seek our permission, to use this publication in accordance with the licence terms. You must keep intact the copyright notice and attribute the State of Queensland as the source of the publication.

Project LASER Site 100 Observation 1

SALI2078

Project description

Project name:	Logan Albert Soil Erodibility and Nutrient mapping project
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	

Site characteristics

Date described:	29/07/2019	Observation type:	Relatively undisturbed soil core
Described by:	WALT	Observation class:	Class IIIa (limited chemistry)

Slope (%):	8	Morphological type:	Lower slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Low hills

Soil Name:	Lowood(1) (Lw)	Substrate lithology:	Sandstone
Runoff:	Moderately rapid	Depth to free water:	Not recorded
Permeability:	Slowly permeable (5-50 mm/day)	Erosion:	Minor or present, active, gully erosion
Drainage:	Imperfectly drained	Microrelief type:	Not recorded
Disturbance:	Limited clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Firm	Horizontal interval (m):	N/A
Surface coarse fragments:	No coarse fragments	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.82576	152.92363	56	492479	6922096	Not recorded	Single GPS
GDA 2020	-27.82575	152.92364	56	492480	6922097		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Eutrophic, Mottled-Mesonatric, Grey Sodosol; medium, non-gravelly, clay loamy, clayey, moderate.	All necessary analytical data is available	Isbell and NCST (2016) The Australian Soil Classification Second Edition.	N/A		

Vegetation

Community name	Tall woodland, Eucalyptus dominant	
Stratum	Species	Common name
Tallest	*Eucalyptus tereticornis*	blue gum, forest red gum
	Corymbia intermedia	pink bloodwood, red bloodwood
	Eucalyptus crebra	narrow-leaved ironbark
Mid	*Alphitonia excelsa*	red ash, soapbush, soap tree

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.25	Brown (10YR 4/3) moist		Sandy clay loam	Weak 5-10 mm Subangular blocky structure;	no coarse fragments;	No segregations;	Dry, Very weak strength;	clear
2	A2e	0.25	0.45	Dark yellowish brown (10YR 4/4) moist White (2.5YR 8/1) dry		Sandy loam	Massive structure;	no coarse fragments;	No segregations;	Dry, Very weak strength;	abrupt
3	B2t	0.45	0.75	Light brownish grey (10YR 6/2) moist	common (10-20%) very coarse (>30 mm) distinct brown mottles; common (10-20%) medium (5-15 mm) prominent orange mottles;	Fine sandy medium clay	Moderate 20-50 mm Prismatic structure; Moderate 5-10 mm Subangular blocky structure;	no coarse fragments;	No segregations;	Dry, Strong strength;	clear

4	B3	0.75	0.8	Light brownish grey (10YR 6/2) moist	many (20-50%) coarse (15-30 mm) prominent orange mottles;	Fine sandy light medium clay	Massive structure;	no coarse fragments;	No segregations;	Dry, Very firm strength;	

Field test

pH by Raupach and Tucker method

Depth (m)	Value
0.01	5.0
0.1	4.0
0.3	4.5
0.6	4.5
0.8	4.0

Field test

Field dispersion test as per LRO guidelines 2012

Depth (m)	Value
0.55	0
0.8	0

Field test

Field slaking test as per LRO guideline (2012)

Depth (m)	Value
0.55	0
0.8	0

Notes

Note level	Horizon name	Horizon no	Note
Observation			Changed from Pine Vale (Pv) SPC to Lowood (Lw) based on lab results.
Observation			30m NW of LARA site 165 (Pine Vale/Wyatt).

Laboratory test results

				Sample	1	2
				Upper depth (m)	0	0.5
				Lower depth (m)	0.1	0.6
Group	Method	Code	Units	Bulked Sample	N	N
Profile General	pH - 1:5 water	4A1			5	5.4
	EC - 1:5 water	3A1	dS/m		0.04	0.13
	Total OC - Dumas, volumetric	6B2a	%		1.31	0.34
	Organic Carbon, LECO furnace	6B5	%		1.18	0.35
	Total N - Kjeldahl, automated	7A2	%		0.089	0.042
	Total N - Dumas	7A5	%		0.07	0.17
	Coarse sand	2Z2_CS	%		53	34
	Fine sand	2Z2_FS	%		28	20
	Silt	2Z2_Silt	%		13	10
	Clay	2Z2_Clay	%		13	39
	Total P - Kjeldahl P (KP)	9A3a	%		<0.013	<0.013
	Moisture content - air-dry	2A1	%		<1.5	2.4
Acid Cations	Exch Ca - NH4Cl no wash	15A1_Ca	meq/100g		1.82	0.55
	Exch Mg - NH4Cl no wash	15A1_Mg	meq/100g		2.16	5.72
	Exch Na - NH4Cl no wash	15A1_Na	meq/100g		0.12	2.31
	Exch K - NH4Cl no wash	15A1_K	meq/100g		0.16	0.32
	Exchangeable Al – KCl	15G1_Al	meq/100g		1.7	6.41
	Exchange acidity (H + Al)	15G1_H	meq/100g		1.89	7.97
	ECEC	15J1	meq/100g		6.1	14.6
Other Cations	ESP	15N1	%		1.31	0.55
Other Analyses Completed	Al sat %	15O1	%		27.9	43.8
	Phosphorus buffer index + Col P	9I2			54	187
	Phosphorus buffer index unadj	9I4			53	187
	Total P - Kjeldahl P (KP)	9A3a	%		<0.013	<0.013
	P (BiCarb Extr)- automated	9B2	mg/kg		3	3

Project description

Project name:	Logan Albert Soil Erodibility and Nutrient mapping project
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	

Site characteristics

Date described:	29/07/2019	Observation type:	Relatively undisturbed soil core
Described by:	WALT	Observation class:	Class I (detailed soil profile description)

Slope (%):	6	Morphological type:	Simple Slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Koukandowie Formation: Lithofeldspathic labile and sublabile to quartzose sandstone, siltstone, shal	Landform pattern:	Low hills

Soil Name:	Lowood(1) (Lw)	Substrate lithology:	Sandstone
Runoff:	Not recorded	Depth to free water:	Not recorded
Permeability:	Slowly permeable (5-50 mm/day)	Erosion:	Minor or present, active, gully erosion
Drainage:	Imperfectly drained	Microrelief type:	Not recorded
Disturbance:	Limited clearing	Proportion gilgai:	N/A
Rock outcrop:	No bedrock exposed	Vertical interval (m):	N/A
Surface condition:	Hard setting	Horizontal interval (m):	N/A
Surface coarse fragments:	No coarse fragments	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.82410	152.91938	56	492060	6922280	Not recorded	Single GPS
GDA 2020	-27.82409	152.91938	56	492061	6922281		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Bleached-Mottled, Dystrophic, Grey Kurosol; medium, non-gravelly, loamy, clayey, shallow.	Analytical data are incomplete but reasonable confidence	Isbell and NCST (2016) The Australian Soil Classification Second Edition.	N/A		

Vegetation

Community name	Tall open forest, Corymbia citriodora	
Stratum	Species	Common name
Tallest 12.01-20 m	*Corymbia citriodora*	lemon-scented gum
	Eucalyptus crebra	narrow-leaved ironbark

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.1	Brown (10YR 4/3) moist	no mottles or other colour patterns mottles;	Fine sandy loam	Massive structure;	no coarse fragments;	No segregations;	Dry, Very firm strength;	clear
2	A2e	0.1	0.25	Pale brown (10YR 6/3) moist White (2.5Y 8/1) dry	common (10-20%) fine (<5 mm) distinct dark mottles;	Fine sandy loam	Massive structure;	no coarse fragments;	No segregations;	Dry, Very firm strength;	clear
3	B2t	0.25	0.45	Greyish brown (10YR 5/2) moist	common (10-20%) coarse (15-30 mm) prominent orange mottles;	Fine sandy medium clay	Moderate 20-50 mm Prismatic structure; Moderate 5-10 mm Angular blocky structure;	no coarse fragments;	No segregations;	Dry, Strong strength;	gradual
4	C	0.45	0.6							Dry, Very firm strength;	

Field test

pH by Raupach and Tucker method

Depth (m)	Value
0.01	4.0
0.15	4.5
0.4	5.5
0.6	6.0

Notes			
Note level	Horizon name	Horizon no	Note
Observation			Near LARA 164 (Lowood SPC). More acidic than LARA 164, not obviously sodic. Check after lab results.

Project description	
Project name:	Logan Albert Soil Erodibility and Nutrient mapping project
Project status:	Data is from an active project and may be subject to change through additions/updates or further quality assessment processes
Location:	

Site characteristics			
Date described:	29/07/2019	Observation type:	Relatively undisturbed soil core
Described by:	WALT	Observation class:	Class IVa (brief mapping observation, some morphological data)

Slope (%):	4	Morphological type:	Lower slope
Slope type:	Abney level or clinometer and tape	Landform element:	Hillslope
Geology:	Gatton Sandstone: Lithic labile and feldspathic labile sandstone	Landform pattern:	Low hills

Soil Name:	Pine Vale(1) (Pv)	Substrate lithology:	Sandstone
Runoff:	Not recorded	Depth to free water:	Not recorded
Permeability:	Not recorded	Erosion:	Not recorded
Drainage:	Not recorded	Microrelief type:	Not recorded
Disturbance:	Not recorded	Proportion gilgai:	N/A
Rock outcrop:	Not recorded	Vertical interval (m):	N/A
Surface condition:	Not recorded	Horizontal interval (m):	N/A
Surface coarse fragments:	Not recorded	Microrelief component sampled:	N/A

Site location

Datum	Latitude (dd)	Longitude (dd)	Zone	Easting (m)	Northing (m)	Location accuracy (m)	Location measurement method
GDA 94	-27.81910	152.92114	56	492233	6922834	Not recorded	Single GPS
GDA 2020	-27.81909	152.92114	56	492234	6922835		

Soil classification

Australian Soil Classification (ASC)	Confidence	ASC Technical Reference	Buried	GSG	PPF
Grey Chromosol	No analytical data are available but confidence is fair.	Isbell and NCST (2016) The Australian Soil Classification Second Edition.	N/A		

Profile morphology

No	Name	Upper depth (m)	Lower depth (m)	Colour	Mottles	Textures	Structures	Coarse fragments	Segregations	Strengths	Bounds
1	A1	0	0.1								
2	A2e	0.1	0.35								
3	B2t	0.35	0.5								
4	C	0.5	0.6								

Field test

pH by Raupach and Tucker method

Depth (m)	Value
0.45	6.0

Notes

Note level	Horizon name	Horizon no	Note
Observation			Pine Vale (Pc) SPC

Based on or contains data provided by the State of Queensland 2020. The State makes no representations or warranties in relation to the supplied data, and you agree that, to the extent permitted by law, all warranties relating to accuracy, reliability, completeness, currency or suitability for any particular purpose and all liability for any loss, damage or costs (including consequential damage) incurred in any way (including but not limited to that arising from negligence) in connection with any use of or reliance on the supplied data are excluded or limited. You agree to continually indemnify the State (including its officers and employees) against any loss, cost, expense, damage and liability of any kind (including consequential damage and liability in negligence) arising directly or indirectly from or related to any claim relating to your use of the supplied data or any product made from the supplied data.

© State of Queensland, 2020 The Queensland Government supports and encourages the dissemination and exchange of its information. The copyright in this publication is licensed under a Creative Commons Attribution 4.0 International (CC BY 4.0) licence. Under this licence you are free, without having to seek our permission, to use this publication in accordance with the licence terms. You must keep intact the copyright notice and attribute the State of Queensland as the source of the publication.

Brisbane
584 Milton Road, Car Sylvan Road
Toowong, QLD 4066
PO Box 1492
Toowong BC, QLD 4066
Phone: +61 07 3300 8800
Email: info@adgce.com

Sydney
13 / 20 Berry Street,
North Sydney NSW 4006
Phone: +61 02 8908 5400
Email: info@adgce.com

Melbourne
Suite 323, 838 Collins Street,
Docklands VIC 3008
Phone: +61 03 9269 6300
Email: info@adgce.com

Gold Coast
Suite 201, Level 1, 1 Short Street
Southport, QLD 4215
PO Box 208
Southport, QLD 4215
Phone: +61 07 5552 4700
Email: info@adgce.com

Sunshine Coast
Level 3, 2 Emporium Place
Maroochydore, QLD 4558
PO Box 5014
Maroochydore BC, QLD 4558
Phone: +61 07 5444 0400
Email: info@adgce.com

Toowoomba
Tenancy 8, 158 Margaret Street
Toowoomba QLD 4350, Australia
Phone: +61 07 3300 8800
Email: info@adgce.com

Darwin
Tenancy 3, Lull 1, 5 Edmunds St,
Darwin NT 0800
GPO Box 2422
Darwin, NT 0801
Phone: +61 08 8944 6300
Email: info@adgce.com

Perth
Level 3, Suite 15, 23 Railway Road,
Subiaco, WA 6008
PO Box 443
Subiaco, WA 6904
Phone: +61 08 9217 0900
Email: info@adgce.com

ADG

CERTIFI ISO 9001 Quality Management ★★★★★
CERTIFI AS/NZS 4801 Safety Management ★★★★★