




PLANS AND DOCUMENTS
referred to in the PDA
DEVELOPMENT APPROVAL

Approval no: DEV2025/1710
Date: 20-May-2026



Queensland
Government



Environmental Noise Assessment

Proposed Mixed Use Development

At 825 Stanley Street, Woolloongabba

On behalf of 825 Stanley Pty Ltd

23BRA0006 R01_1



Disclaimer

This report has been prepared by Colliers for the exclusive use of the client for the specific purpose stated within. The findings, conclusions, and recommendations presented in this report are based on the information available, assumptions made, and methodologies applied at the time of analysis.

Colliers shall not be held liable for any losses, damages, or reliance placed on this report beyond the scope of the agreed-upon engagement. Any reproduction or distribution of this report without Colliers' consent is prohibited

Revision Record

No.	Author	Reviewed/Approved	Description	Date
A	S Yorke	A Ashworth	Report draft	06/03/2023
0	S Yorke	A Ashworth	Client issue	06/03/2023
1	S Yorke	A Ashworth	New design	17/10/2025

Executive Summary

Colliers (previously TTM) was engaged by 825 Stanley Pty Ltd to undertake a revised environmental noise assessment of a proposed re-design of the mixed-use development located at 825 Stanley Street, Woolloongabba. The assessment was based on the Brisbane City Council (BCC) *City Plan 2014* planning scheme.

The previous version of this report (23BRA0006 R01_0 dated 6/03/2023) was approved by BCC as part of the current development approval for the site. This report updates noise emissions in relation to the revised design for the gallery/event use.

Unattended noise monitoring was conducted to determine the current ambient noise levels in the vicinity of the site location.

Noise impacts from relevant onsite activities were assessed for the following operating hours:

- Retail tenancies (ground floor): between 6am - 10pm, 7 days (code allowed hours)
- Gallery (Levels 1 – 6): typical 10am – 5pm, Wednesday – Sunday. Assessed for between 7am – 10pm, 7 days.
- Event use (Level 6): between 6am - 10pm (internal) and 7am – 10pm (external), 7 days

Compliance with the relevant noise criteria and the Brisbane City Council *City Plan 2014* planning scheme is predicted at the nearest noise sensitive receivers with building façade recommendations and noise management strategies as outlined in Section 7 of this report.

Contents

Executive Summary	2
1 Introduction	5
1.1 Background	5
1.2 References.....	5
1.3 Scope.....	5
2 Site Description	6
2.1 Site Location	6
2.2 Current Site Conditions	6
3 The Proposed Development	7
3.1 Development Description.....	7
4 Measurements	8
4.1 Equipment.....	8
4.2 Unattended Noise Monitoring	8
4.3 Noise Source Measurements	9
4.4 Results of Measurements.....	9
4.4.1 Ambient Noise Levels	9
5 Noise Criteria	10
5.1 Centre or Mixed Use Code	10
5.1.1 Noise (Planning) Criteria.....	11
5.2 Community Facilities Code	13
5.2.1 Noise (planning) criteria	13
6 Analysis – Onsite Noise	15
6.1 Noise Sensitive Receivers	15
6.2 Noise Source Levels.....	16
6.3 Calculation Assumptions	16
6.4 Predicted Onsite Noise Levels at Receivers.....	17
6.4.1 Noise Planning Criteria - L_{eq}	17
6.5 Internal Sound Levels	18
7 Recommendations	20
7.1 Building Attenuation	20

7.1.1	Habitable Rooms	20
7.1.2	Gallery and Event Spaces	20
7.2	Acoustic Barrier	20
7.3	Management Strategies	21
7.4	Mechanical Plant Noise	22
8	Conclusion.....	23
Appendix A	Development Plans.....	24
Appendix B	Unattended Noise Monitoring Graphs	27
Appendix C	Calculations.....	33

Table Index

Table 1: Measured Ambient Noise Levels	9
Table 2: City Plan 2014 – Relevant Codes	10
Table 3: Centre or Mixed Use Code Performance Outcome P01	10
Table 4: Noise (Planning) Criteria (Table 9.3.3.3.F)	11
Table 5: Centre or Mixed Use Code - Performance Outcome PO7	12
Table 6: Community Facilities Code Performance Outcomes	13
Table 7: Noise (Planning) Criteria (Table 9.3.5.3.B)	14
Table 8: Relevant Noise Sources	16
Table 9: Predicted Noise Planning Impacts	18
Table 10: Indicative Maximum Allowable Internal Sound Level Predictions	18

Figure Index

Figure 1: Site Locality	6
Figure 2: Ground Floor Plan	7
Figure 3: Noise Monitoring Location.....	8
Figure 4: Tenancy Locations - Potential Outdoor Dining Locations.....	12
Figure 5: Noise Sensitive Receiver Locations	15
Figure 6: Noise Source Locations – Gallery/Event Outdoor Use (Level 6).....	17
Figure 7: Recommended Acoustic Barrier	21

1 Introduction

1.1 Background

Colliers (previously TTM) was engaged by 825 Stanley Pty Ltd to undertake a revised environmental noise assessment of a proposed re-design of the mixed-use development located at 825 Stanley Street, Woolloongabba. This report will form part of a development application for consideration by Brisbane City Council.

1.2 References

This report is based on the following:

- Brisbane City Council *City Plan 2014*
- *Noise impact assessment planning scheme policy* - Schedule 6, City Plan 2014
- Development plans shown in Appendix A
- Site inspection, noise measurements, analysis and calculations conducted by Colliers

1.3 Scope

The assessment includes the following:

- Description of the development site and proposal.
- Measurement of existing ambient noise levels.
- Statement of assessment criteria relating to environmental noise emissions.
- Assessment of noise generated by the development onto the nearest noise sensitive receivers.
- Analysis of measured and predicted noise levels.
- Details of noise control recommendations to be incorporated to achieve predicted compliance.

2 Site Description

2.1 Site Location

The site is described by the following:

- 825 Stanley Street, Woolloongabba

The site locality is shown in Figure 1.

Figure 1: Site Locality



2.2 Current Site Conditions

The site is bound by Stanley St to the north, Jurgens St to the west, multiple dwelling with podium levels to the east, and Trafalgar Street to the south. The current acoustic environment at the site and surrounding area is primarily comprised of road traffic noise from the surrounding road network.

3 The Proposed Development


3.1 Development Description

The proposal is for a mixed-use development consisting of the following uses and operating hours:

- Residential apartments
- Retail tenancies (ground floor): between 6am - 10pm, 7 days (code allowed hours)
- Gallery: typical 10am – 5pm, Wednesday – Sunday. Assessed for internal (Levels 1 – 6) and outdoor area (Level 6) between 7am – 10pm, 7 days (with recommended limitations)
- Event use (Level 6): internal between 6am - 10pm, 7 days and possible outdoor area (Level 6) between 7am – 10pm (with recommended limitations)

A ground floor plan of the development is presented in Figure 2. Further development plans are shown in Appendix A.

Figure 2: Ground Floor Plan

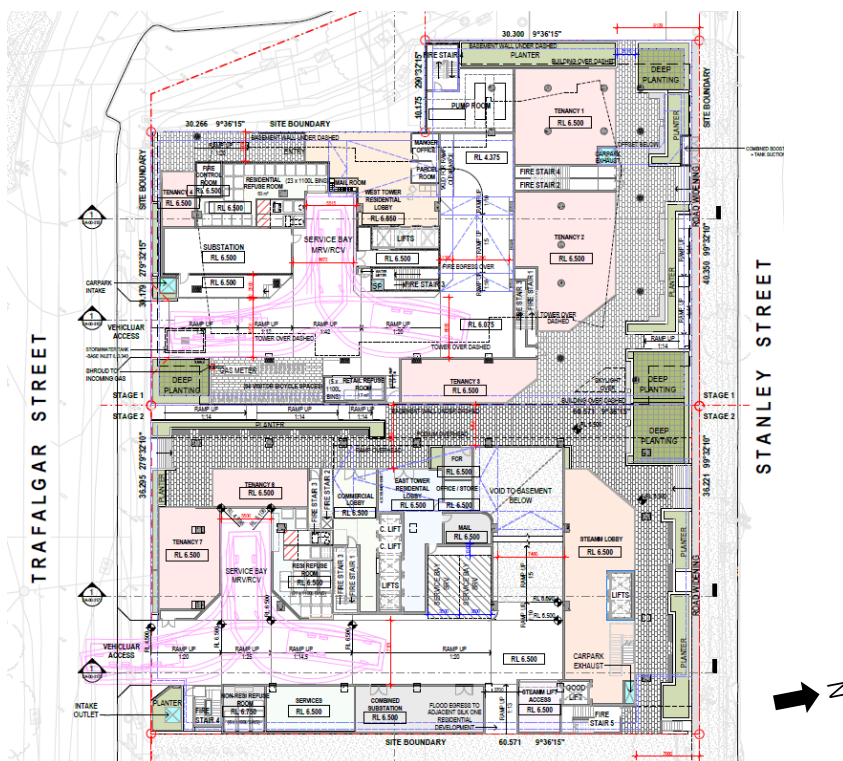

4 Measurements

4.1 Equipment

The following equipment was used to measure existing noise levels:


- ARL Ngara Environmental noise logger (SN# 8782A5)
- Norsonic 131 Sound Level Meter (SN# 1313158)
- Bruel & Kjaer Sound Calibrator type 4231 (SN# 3009814)

All equipment was calibrated by a National Association of Testing Authorities (NATA) accredited laboratory. The equipment was field calibrated before and after the measurement session. No significant drift from the reference signal was recorded.

4.2 Unattended Noise Monitoring

Unattended noise monitoring was conducted to establish the existing ambient noise levels between Tuesday 21st February to Tuesday 28th February, 2023. The noise monitoring location is shown in Figure 3. The monitor was in a position considered representative of the current ambient noise levels experienced in the vicinity of the site with consideration to access and security requirements.

Figure 3: Noise Monitoring Location

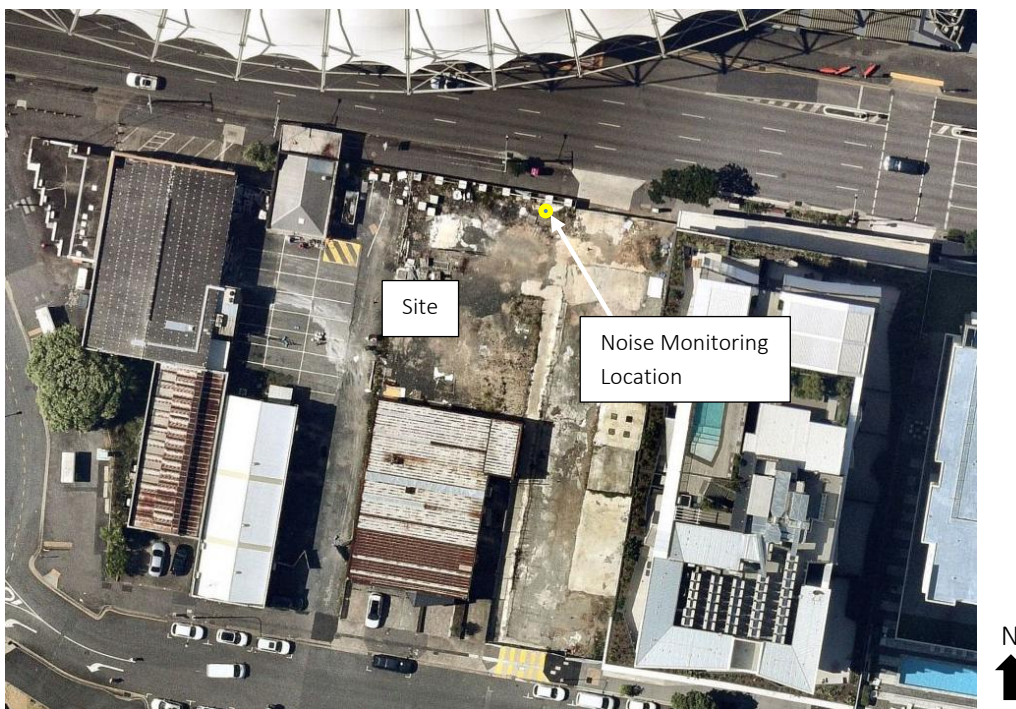

The microphone was in a free-field location and 2.0m above ground level. The noise monitor was set to measure statistical noise levels in 'A'-weighting, 'Fast' response, over 15 minute intervals. Ambient noise levels were measured in accordance with Australian Standard *AS1055:1997 Acoustics – Description and Measurement of Environmental Noise* (AS1055).

Weather during the monitoring period was generally fine with rainfall recorded between 9am 22/02 – 9am 23/02 (source: Bureau of Meteorology). Data affected by rainfall was excluded from the analysis.

4.3 Noise Source Measurements

Noise levels associated with typical on-site activities were taken from similar investigations conducted by Colliers. All measurements were conducted generally in accordance with AS1055.

4.4 Results of Measurements

4.4.1 Ambient Noise Levels

Table 1 presents the measured ambient noise levels. The Rating Background Level (RBL) was determined in accordance with the *BCC Noise Impact Assessment Planning Scheme Policy* (NIAPSP). Graphical presentation of the measured levels is shown in Appendix B. The measurement results were used to determine the assessment criteria for the development.

Table 1: Measured Ambient Noise Levels

Time Period	Measured Noise Levels, dB(A)	
	RBL L_{90}	L_{eq}
Daytime (7am – 6pm)	58	68
Evening (6pm – 10pm)	55	67
Night time (10pm – 7am)	52	65

5 Noise Criteria

The previous Brisbane City Council *Information Request* (28/11/2022) asked for noise assessment in accordance with the Centre or mixed use code (AO1.1 - AO1.2) and the Community facilities code (AO1.1 – AO2.2). Table 2 summarises the planning scheme requirements for the site which are relevant to this environmental noise assessment.

Table 2: City Plan 2014 – Relevant Codes

Location	Zone	Code
Site	Mixed use zone	Centre or mixed use code Community facilities code
Nearest sensitive receivers	Mixed use zone	N/A

It is noted that the previous development approval for the site included a noise assessment (by Vipac dated 17/06/2016) that addressed road traffic noise and potential Gabba stadium noise.

5.1 Centre or Mixed Use Code

The proposed retail and function facility use is applicable for assessment under the Centre or mixed use code. Table 3 summarises the Performance Outcome PO1 of the code.

Table 3: Centre or Mixed Use Code Performance Outcome P01

Performance Outcomes	Acceptable Outcomes
<p>PO1</p> <p>Development:</p> <p>(a) has hours of operation which are controlled so that the use does not detrimentally impact on the amenity of adjoining residents;</p> <p>(b) where not located in a Special entertainment precinct identified in a neighbourhood plan, does not result in noise emissions that exceed the noise (planning) criteria in Table 9.3.3.F low frequency noise criteria in Table 9.3.3.3.G and night-time noise criteria in Table 9.3.3.3.H in a sensitive zone or a nearby sensitive use.</p> <p>Note—A noise impact assessment report prepared in accordance with the Noise impact assessment planning scheme policy can assist in demonstrating achievement of this performance outcome.</p>	<p>AO1.1</p> <p>Development:</p> <p>(a) for accommodation activities, dwelling unit or emergency services has unlimited hours of operation;</p> <p>(b) for a club, if licensed, function facility, hotel or nightclub entertainment facility does not generate noise which is clearly audible and detectable, or impacts on the amenity of a resident, in a dwelling or other sensitive use;</p> <p>Note-Development for a club, if licensed, function facility, hotel or nightclub entertainment facility is not expected to achieve this outcome.</p> <p>(c) for any other use:</p> <ol style="list-style-type: none"> i. Where in the Principal centre zone or Major centre zone has unlimited hours of operation; ii. Where in the District centre zone, Neighbourhood centre zone or Mixed use zone: <ol style="list-style-type: none"> a. Has hours of operation, including deliveries, which are limited to 6am to 10pm; or b. Does not generate noise which is clearly audible and disturbing in a dwelling or other sensitive use; iii. Where in any other zone:

	<ul style="list-style-type: none"> a. Has hours of operation, including for deliveries, which are limited to 6am to 8pm; or b. Does not generate noise which is clearly audible and disturbing in a dwelling or other sensitive use.
	<p>A01.2 Development ensures mechanical plant or equipment is acoustically screened from an adjoining sensitive use.</p>

The site is located in a Mixed-use zone. In accordance with AO1.1(c)ii, the proposed development is allowed hours of operation, including for deliveries, of 6am to 10pm. The proposed hours of operation for retail uses are between 6am – 10pm in compliance with AO1.1(c)ii.

To comply with Acceptable Outcome AO1.2, it is recommended the development apply acoustic screening to exposed mechanical plant with the potential to impact adjacent noise sensitive receivers.

The garden gallery outdoor area (Level 6) is assessed in accordance with PO1 for potential gallery/event use.

5.1.1 Noise (Planning) Criteria

The Centre or mixed use code, Performance Outcome P01, *Table 9.3.3.3.F* outlines noise (planning) criteria for noise emissions from the development. This criteria, described by $L_{Aeq,adj,T}$, is reproduced in Table 7 for the applicable hours of operation.

Table 4: Noise (Planning) Criteria (Table 9.3.3.3.F)

Criteria Location	Intrusive noise criteria, dB(A) Day, evening and night $L_{Aeq,adj,T}$ are not greater than the RBL plus the amount in 'Column 1' for the relevant criteria location				Acoustic amenity criteria, dB(A) Day, evening and night $L_{Aeq,adj,T}$ are not greater than the values in this column for the relevant criteria location		
	Column 1	Day 7am-6pm	Evening 6pm-10pm	Night 10pm-7am	Day	Evening	Night
At a sensitive use in the Mixed use zone	5	63	60	57	60	55	50
Project Specific Criteria*		60	55	50			

Day: 7am – 6pm. Evening: 6pm – 10pm. Night: 10pm – 7am.

*The project specific noise criterion is taken as the most stringent value for each time period from the Intrusive and Amenity noise criteria.

Table 5 summarises the Performance Outcome PO7 of the Centre or mixed use code.


Table 5: Centre or Mixed Use Code - Performance Outcome PO7

Performance Outcome	Acceptable Outcome
<p>PO7</p> <p>Development mitigates impacts on residential amenity in or adjoining the building through:</p> <ol style="list-style-type: none"> providing an outdoor dining area that is appropriately located; ensuring external dining and entertainment areas are visually and acoustically screened from an adjoining dwelling. 	<p>A07</p> <p>Development provides for external dining or entertainment areas to be:</p> <ol style="list-style-type: none"> located in or directly adjacent to the public realm; visually and acoustically screened from an adjoining dwelling.

Potential outdoor dining locations are adjacent to retail tenancy locations as shown in Figure 4. Adjacent, existing residential dwellings to the east (and approximately at floor level 5 height) are acoustically screened from these areas by the building structure above.

Onsite residential dwellings have mandatory façade treatment requirements in accordance with PO21, Multiple dwelling code, which are intended to address mixed-use zone noise environments such as retail and outdoor dining. Hence, acoustic screening is provided in accordance with A07/PO7.

Figure 4: Tenancy Locations - Potential Outdoor Dining Locations

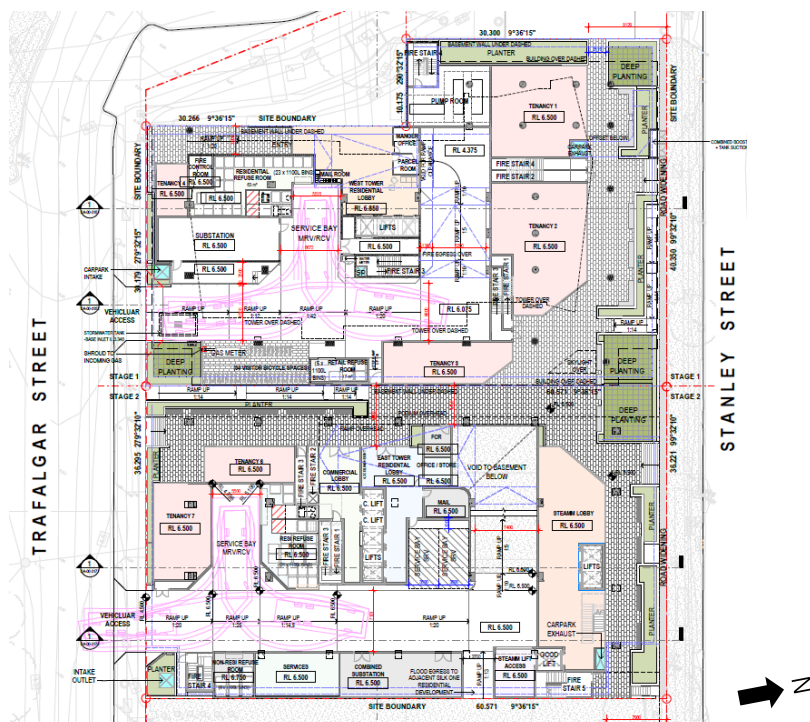

5.2 Community Facilities Code

Noise emissions from the gallery use are applicable for assessment under the Community facilities code. Performance Outcome PO1 and PO2 of the code are reproduced in Table 6.

Table 6: Community Facilities Code Performance Outcomes

Performance Outcomes	Acceptable Outcomes
<p>PO1</p> <p>Development ensures that the hours of operation are:</p> <ul style="list-style-type: none"> a) consistent with reasonable community expectations for the use and are consistent with the purpose of the zone or zone precinct; b) controlled so that the community facility does not impact on the amenity of: <ul style="list-style-type: none"> i. a residence within the building where the use is located; ii. nearby sensitive uses. 	<p>AO1.1</p> <p>Development for a non-residential use has hours of operation, including the use of indoor activity areas and private open space, which are limited to 7am to 6pm.</p>
	<p>AO1.2</p> <p>Development has hours of operation for delivery vehicles which are limited to 7am to 6pm Monday to Saturday, excluding public holidays</p>
<p>PO2</p> <p>Development ensures noise generated does not exceed the noise (planning) criteria in Table 9.3.5.3.B and night-time noise criteria in Table 9.3.5.3.C at a sensitive zone or sensitive use.</p> <p>Note—A noise impact assessment report prepared in accordance with the Noise impact assessment planning scheme policy can assist in demonstrating achievement of this performance outcome.</p>	<p>AO2.1</p> <p>Development:</p> <ul style="list-style-type: none"> a) does not involve amplified music entertainment; b) is conducted wholly within an enclosed building and does not involve external activity, dining or entertainment areas; c) provides a 2m high acoustic fence along any boundary with land in a residential zone; d) ensures mechanical plant or equipment is acoustically screened from adjoining sensitive uses.

Typical hours of operation of the gallery are 10am – 5pm (Wednesday – Sunday) in accordance with AO1.1. Possible operation between 7am – 10pm was also assessed. The gallery internal use is within an enclosed building and primarily for exhibitions, installations and curated experiences. Possible use of the garden gallery outdoor area on Level 6 was assessed in accordance with PO2 with required limitations recommended.

5.2.1 Noise (planning) criteria

The Community Facilities Code, *Table 9.3.5.3.B* outlines noise (planning) criteria for noise emissions from the development. This criteria, described by $L_{Aeq,adj,T}$, is reproduced in Table 7.

Table 7: Noise (Planning) Criteria (Table 9.3.5.3.B)

Criteria Location	Intrusive noise criteria, dB(A) Day, evening and night $L_{Aeq,adj,T}$ are not greater than the RBL plus the amount in 'Column 1' for the relevant criteria location				Acoustic amenity criteria, dB(A) Day, evening and night $L_{Aeq,adj,T}$ are not greater than the values in this column for the relevant criteria location		
	Column 1	Day 7am-6pm	Evening 6pm-10pm	Night 10pm-7am	Day	Evening	Night
At a sensitive use in the Mixed use zone	5	63	60	57	60	55	50
Project Specific Criteria*		60	55	50			

Day: 7am – 6pm. Evening: 6pm – 10pm. Night: 10pm – 7am.

*The project specific noise criterion is taken as the lowest value of the Intrusive and Amenity noise criteria.

6 Analysis – Onsite Noise

As outlined in Section 5, the relevant on-site activities for noise assessment are:


- Gallery/event: internal noise (Level 1-6) and possible use of outdoor area (Level 6)

6.1 Noise Sensitive Receivers

This assessment will focus on the nearest noise sensitive receivers as outlined below and shown in Figure 5. If compliance can be achieved at these receivers, then all remaining noise sensitive locations are expected to comply.

- Receiver 1: Onsite dwellings (west tower)
- Receiver 2: Dwellings to the east of the site (from Level 5 height)
- Receiver 3: Onsite dwellings (east tower, from Level 10)

Figure 5: Noise Sensitive Receiver Locations

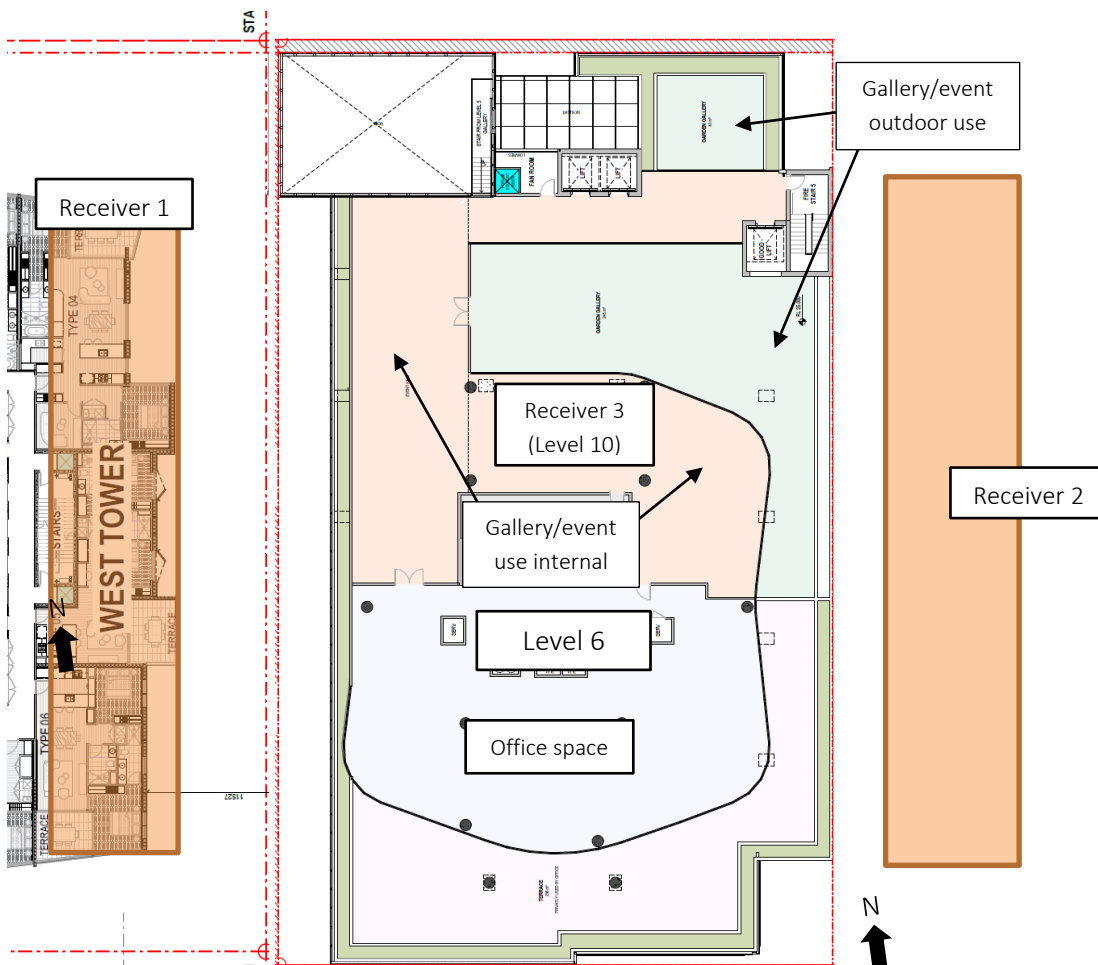

6.2 Noise Source Levels

Table 8 presents the typical noise sources associated with the development with the potential to impact the nearest sensitive receivers. The noise source levels were calculated to one metre and include corrections for tonality and impulsiveness as per AS1055. The number of events was estimated for a ‘peak’ one-hour time period providing a ‘worst case scenario’ applied to relevant time periods.

Table 8: Relevant Noise Sources

Noise Source	Time Period	Location (Figure 6)	Measured Duration (s)	$L_{eq,T}$ dB(A)	Duration
Crowd (42 people)	Day (7am – 6pm)	East area of outside area (Level 6)	60	80	Continuous
Crowd (42 people)		West area of outside area (Level 6)	60	80	Continuous
Crowd (19 people)	Evening (6pm – 10pm)	East area of outside area (Level 6)	60	75	Continuous
Crowd (19 people)		West area of outside area (Level 6)	60	75	Continuous

Internal noise was assessed in Section 6.5.

6.3 Calculation Assumptions

The following assumptions have been made for noise calculations:

- Crowd noise was based on data contained in paper ‘Prediction of Noise from Small to Medium Sized Crowds’ Hayne et al, 2011. Duration was assumed to occur continuously during the assessment period.
- An acoustic barrier is recommended along the east side of the outdoor area (Level 6) as detailed in Section 7. Noise attenuation from the acoustic barrier was not included in the noise calculations to represent the noise path from the outdoor area over the top of the barrier to higher floor levels of the receiver.
- Noise attenuation from balcony solid balustrades was included for the receiver 3 onsite apartments (from Level 10) adjacent and above the Level 6 outdoor area.
- Noise source locations are shown in Figure 6. Noise source predictions were calculated from a central location for each noise source location.

Table 9: Predicted Noise Planning Impacts

Receiver	Noise Source	Predicted External Noise Level L _{Aeq} dB(A)	Complies with Criteria?	
			Day 7am-6pm 60dB(A)	Evening 6pm-10pm 55dB(A)
1	Outdoor crowd (84 people) (day)	52	✓	n/a
	Outdoor crowd (38 people) (evening)	47	n/a	✓
2	Outdoor crowd (84 people) (day)	60	✓	n/a
	Outdoor crowd (38 people) (evening)	55	n/a	✓
3	Outdoor crowd (84 people) (day)	52	✓	n/a
	Outdoor crowd (38 people) (evening)	47	n/a	✓

Noise activities are predicted to comply with the noise criteria when the outside crowd patron number is limited for each relevant time period.

6.5 Internal Sound Levels

The main noise source within the gallery/event internal spaces are expected to be patron and/or amplified sound (voice or music). Noise level predictions to determine a maximum internal sound level were based on reverse calculations. The calculations are based on the following assumptions which are considered worst case:

- Nearest sensitive receiver: Receiver 1 and 2
- Distance attenuation between nearest façade and receiver: 10m (gallery/event internal spaces)
- Minimum attenuation of façade: Rw35
- Criteria: 60/55dB(A) L_{eq} (day/evening)

Based on the above assumptions, Table 10 presents the predicted maximum allowable internal patron and/or amplified sound levels. Calculations are included in Appendix C.

Table 10: Indicative Maximum Allowable Internal Sound Level Predictions

Space	Indicative Maximum Allowable Internal Reverberant Sound Level* L _{eq} dB(A)		
	Day 7am - 6pm	Evening 6pm - 10pm	Night 6am - 7am
Gallery (Level 2 – 5)	115	110	n/a
Gallery / event (Level 6)	107	102	97

*Measured at centre of room equidistant from any speakers

The predicted maximum allowable internal sound levels for patron and/or amplified sound are expected to be adequate for operation of each space with façades closed during operating hours:

- Gallery: between 7am – 10pm, 7 days
- Event use: between 6am - 10pm, 7 days (internal)

See Section 7 for recommended noise mitigation measures.

7 Recommendations

Recommended acoustic mitigation measures are presented in this section to achieve predicted compliance with the relevant assessment criteria.

7.1 Building Attenuation

7.1.1 Habitable Rooms

The development is located in a Mixed-use zone. To comply with *Performance Outcome PO21* of the *Multiple Dwelling Code*, we recommend the adoption of *Acceptable Outcome AO21* for residential habitable rooms (bedrooms and living areas) to attenuate any surrounding retail activity noise (including outdoor dining):

Development in a zone in the centre zones category or the Mixed use zone has a minimum acoustic performance of:

- a) R_w35 for glazing (windows and doors) where total area of glazing is greater than $1.8m^2$;
- b) R_w32 for glazing (windows and doors) where total area of glazing is less than or equal to $1.8m^2$.

7.1.2 Gallery and Event Spaces

The following building attenuation measures are recommended:

- Gallery and event use external façades on Levels 2 – 6 to achieve a minimum sound reduction rating of R_w35 (glazing, walls) and R_w40 (roof).


7.2 Acoustic Barrier

To improve noise attenuation of the Level 6 outdoor area, an acoustic barrier is recommended at the location and height as shown in Figure 7.

The acoustic barrier should:

- Be the minimum height relative to the adjacent floor level.
- Be of solid construction and have no gaps or holes for the extent shown.
- Be constructed of a material with a surface mass not less than $12.5kg/m^2$.
- The barrier can be constructed of a transparent material (eg. glazing, acrylic – min. $12.5kg/m^2$)

Figure 7: Recommended Acoustic Barrier

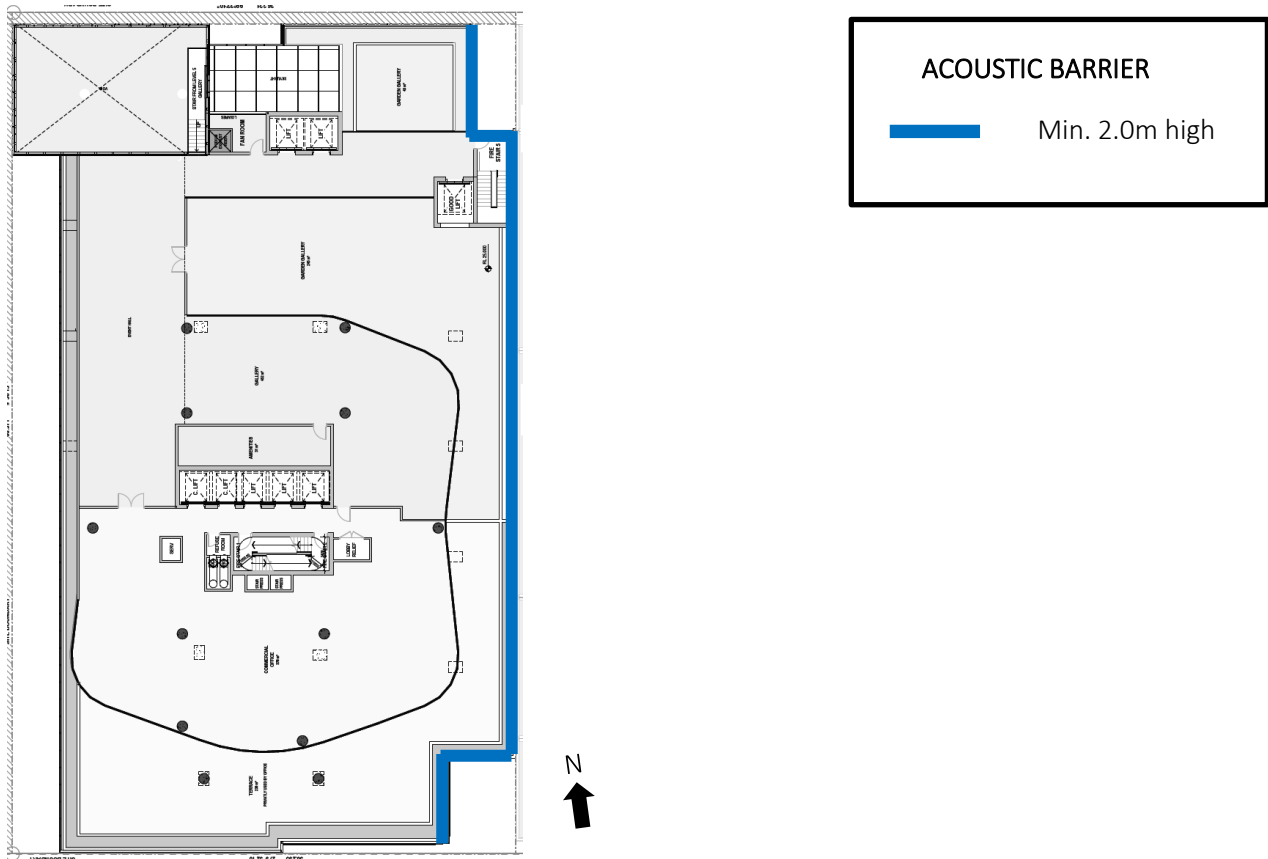

7.3 Management Strategies

The following management strategies are recommended to comply with the relevant noise criteria:

- a. Possible operating hours (internal use):
 - i. Gallery (Levels 1 – 6): between 7am – 10pm, 7 days
 - ii. Event use (Level 6): between 6am – 10pm, 7 days
- b. Gallery and event use of the outdoor area (Garden Gallery) on Level 6:
 - i. Day 7am – 6pm: maximum 84 people
 - ii. Evening 6pm – 10pm: maximum 38 people
 - iii. No outdoor use between 10pm – 7am
 - iv. No amplified music (no external speakers)

- v. The same limitations apply to the office outdoor area (Level 6, south end) if private event use occurs
- c. Gallery and event use external building facades to be closed (eg. no open windows or external doors) during noise generating use (crowd, amplified sound). Except for momentary external door open for patron enter/exit if required for outdoor area access (as per (b) above). Door to have automatic closing mechanism.

7.4 Mechanical Plant Noise

To comply with AO1.2 (*Centre or mixed use code*) and AO2.1(d) (*Community facilities code*) for mechanical plant, we recommend the following for plant with the potential to adversely impact nearby sensitive receivers:

Development ensures mechanical plant is acoustically screened from nearby sensitive uses.

The definition of 'acoustically screened' is provided in Table SC1.2.3.B of Brisbane City Plan 2014, Schedule 1 Definitions:

The source of noise is completely screened from view of habitable rooms (including balconies, patios, decks and verandas) of an adjoining sensitive use by solid, gap free material and construction e.g. acoustic fence, building, or enclosure.

Acoustic barrier: Solid, gap free barrier with minimum surface density of 12.5kg/m²

Furthermore, it is also recommended that a mechanical plant noise assessment is conducted once plant selections are finalised during design development stage to ensure noise emissions comply with criteria.

8 Conclusion

Colliers (previously TTM) was engaged by 825 Stanley Pty Ltd to undertake a revised environmental noise assessment of a proposed re-design of the mixed-use development located at 825 Stanley Street, Woolloongabba.

Compliance with the Brisbane City Council *City Plan 2014* planning scheme is predicted to be achieved based on the analysis and recommendations outlined in Section 7 of this report.

Appendix A Development Plans



PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT


PROJECT: 825 STANLEY STREET, WOOLLOONGABBA
CLIENT: COLLIERS
DESIGNER: COLLIERS
SCALE: 1:1000
STATUS: DRAFT

Appendix B Unattended Noise Monitoring Graphs

23BRA0006
21/02/2023




23BRA0006
22/02/2023

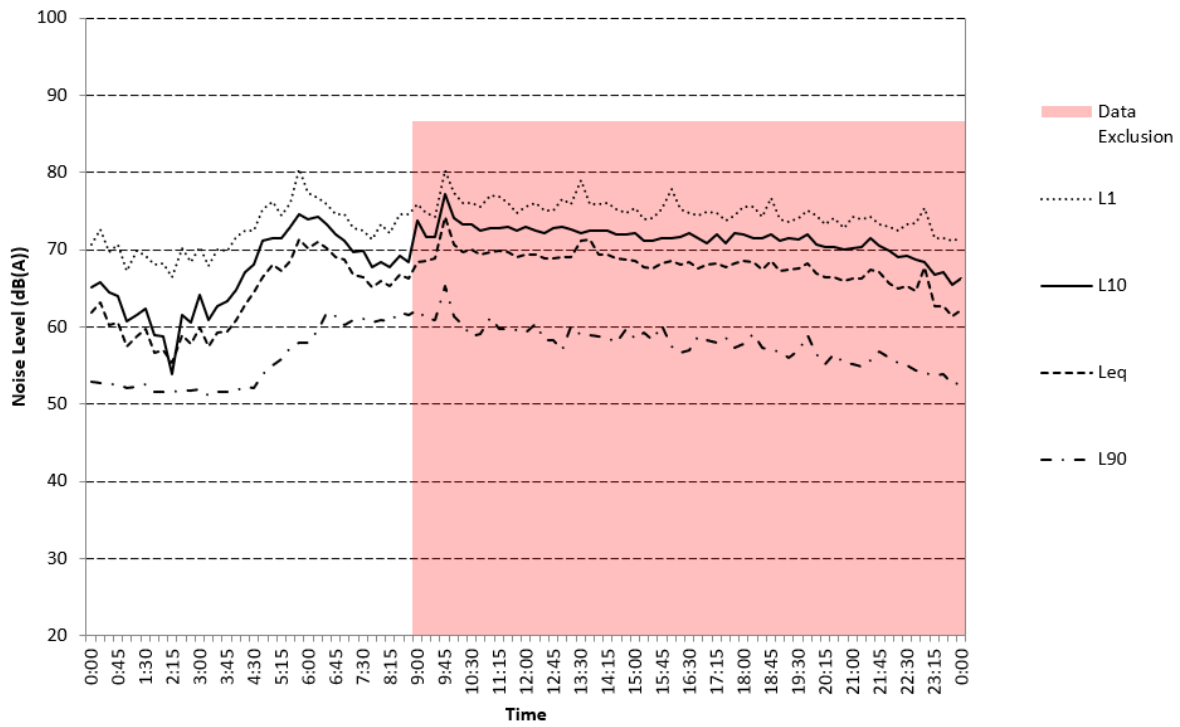

23BRA0006

23/02/2023

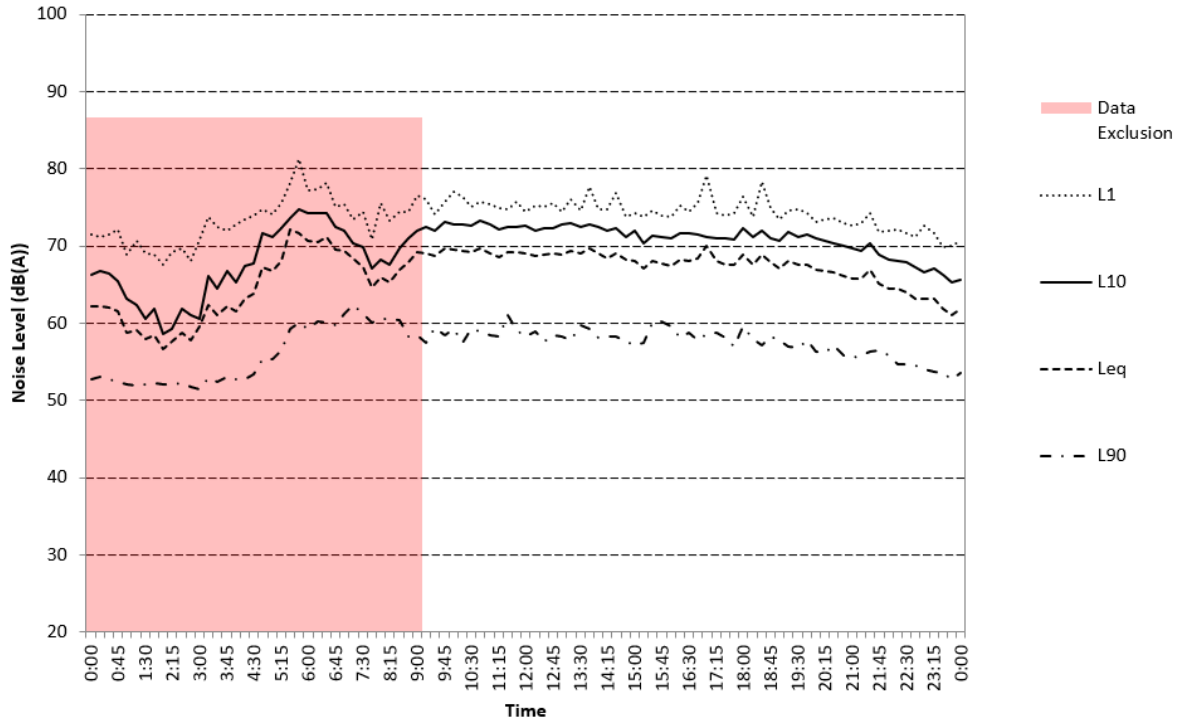

23BRA0006

24/02/2023



23BRA0006

25/02/2023



23BRA0006

26/02/2023



23BRA0006

27/02/2023




23BRA0006

28/02/2023



23BRA0006
01/03/2023

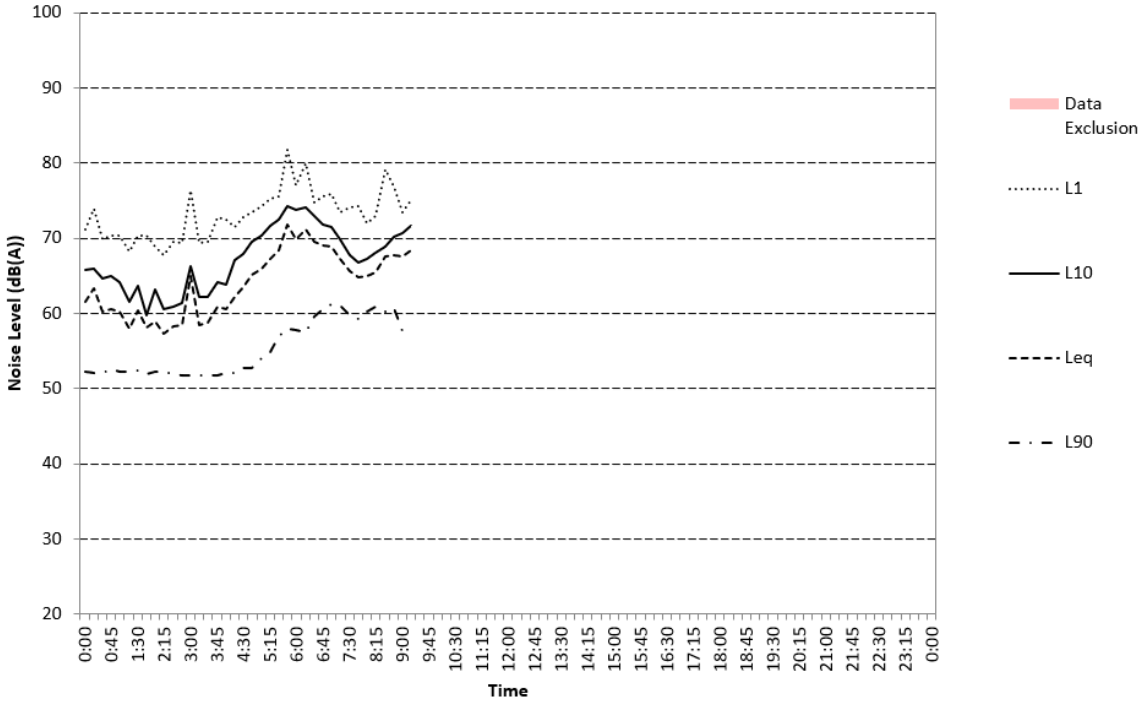

Appendix C Calculations

PROJECT #:	Activity Noise					Distance to Receivers (from centre of crowd areas)			
	Duration (sec)	Leq	1 Hour Period (sec)	Events	Leq Level	R1 (onsite)	R2 (east)	R3 (onsite)	
	Crowd (58 people) - East area (max Day)	60	80	3600	60	80	40	12	15
	Crowd (58 people) - West area (max Day)	60	80	3600	60	80	30	22	15
	Crowd (27 people) - East area (max Evening)	60	75	3600	60	75	40	12	15
	Crowd (27 people) - West area (max Evening)	60	75	3600	60	75	30	22	15

Noise level due to Distance loss									
	Crowd (58 people) - East area (max Day)						48	58	56
	Crowd (58 people) - West area (max Day)						50	53	56
	Crowd (27 people) - East area (max Evening)						43	53	51
	Crowd (27 people) - West area (max Evening)						45	48	51

Shielding (acoustic barrier, solid balustrades)						R1(onsite)	R2(east)	R3(onsite)	
	Crowd (58 people) - East area (max Day)	Noise path over internal gallery room to higher R1 floor levels					0	0	7
	Crowd (58 people) - West area (max Day)	Noise path over acoustic barrier to higher R2 floor levels					0	0	7
	Crowd (27 people) - East area (max Evening)	Solid balcony balustrade attenuation 7dB					0	0	7
	Crowd (27 people) - West area (max Evening)						0	0	7

Noise Level at Receiver						R1(onsite)	R2(east)	R3(onsite)
	Crowd (58 people) - East area (max Day)					48	58	49
	Crowd (58 people) - West area (max Day)					50	53	49
	Crowd (27 people) - East area (max Evening)					43	53	44
	Crowd (27 people) - West area (max Evening)					45	48	44

Cumulative - East and West									
	Day time						52	60	52
	Evening time						47	55	47

Internal noise emission - Patron/amplified sound (voice/music) - Façade Closed

Item / Description	Rating/Broadband/Input			Octave Band Centre Frequency, Hz								
	Rating	dB	dB(A)	31.5	63	125	250	500	1k	2k	4k	8k
Room	Gallery (Level 2-5)											
Façade Attenuation	Façade Closed											
Library - Type: Transmission Loss, Source: Local, ID: 24	Rw	30				-19.8	-21.8	-28.0	-33.2	-33.6	-27.0	
modify		4	Rw	35		-23.8	-25.8	-32.0	-37.2	-37.6	-31.0	
Noise Level at Receiver			Distance	Façade area								
Receiver 1/2			10 m	15 m ²	56 (A)	60.8	60.4	50.8	47.6	43.7	43.2	
No acoustic barrier/fence included												
Noise Criteria			Day	Evening	Night							
Criteria		Leq dB(A)	60	55	50							
Exceedance			-5	1	6							
Max allowable internal sound level		Leq dB(A)	115	110	105							



Job No.	23BRA0006				
Job Title					
Date Created	By	Date Revised	Rev	Sheet	
	SY			2	
Date Reviewed	By	Review Type	Review Status		

Internal noise emission - Patron/amplified sound (voice/music) - Façade Closed

Item / Description	Rating/Broadband/Input			Octave Band Centre Frequency, Hz								
	Rating	dB	dB(A)	31.5	63	125	250	500	1k	2k	4k	8k
Room	Gallery/Event Use (Level 6)											
Reverberant Sound Level		613 m ³	1 x	102 (A)		98.7	100.3	96.9	98.9	95.5	88.4	
Façade Attenuation	Façade Closed											
Library - Type: Transmission Loss, Source: Local, ID: 24		Rw 30				-19.8	-21.8	-28.0	-33.2	-33.6	-27.0	
modify	4	Rw 35				-23.8	-25.8	-32.0	-37.2	-37.6	-31.0	
Noise Level at Receiver		Distance	Façade area									
Receiver 1/2		10 m	88 m ²	55 (A)		60.3	60.0	50.3	47.1	43.3	42.8	
No acoustic barrier/fence included												
Noise Criteria												
Criteria		Leq dB(A)	Day	Evening	Night							
Exceedance			-5	0	5							
Max allowable internal sound level		Leq dB(A)	107	102	97							