


By: Justin Lee
Date: 17/06/2026



RIVERMONT TRUNK GRAVITY SEWER PACKAGE 2

KN DRAWING NO.	UW DRAWING TITLE	KN DRAWING TITLE
24-288-101	SGP-WTG-C-DR-8221	TRUNK GRAVITY SEWER LOCALITY PLAN, KEY PLAN AND DRAWING INDEX
24-288-102	SGP-WTG-C-DR-8222	TRUNK GRAVITY SEWER LAYOUT PLAN SHEET 1
24-288-103	SGP-WTG-C-DR-8223	TRUNK GRAVITY SEWER LAYOUT PLAN SHEET 2
24-288-104	SGP-WTG-C-DR-8224	TRUNK GRAVITY SEWER NOTES
24-288-105	SGP-WTG-C-DR-8225	TRUNK GRAVITY SEWER NOTES
24-288-106	SGP-WTG-C-DR-8226	TRUNK GRAVITY SEWER LONGITUDINAL SECTION SHEET 1
24-288-107	SGP-WTG-C-DR-8227	TRUNK GRAVITY SEWER LONGITUDINAL SECTION SHEET 2
24-288-108	SGP-WTG-C-DR-8228	TRUNK GRAVITY SEWER LONGITUDINAL SECTION SHEET 3

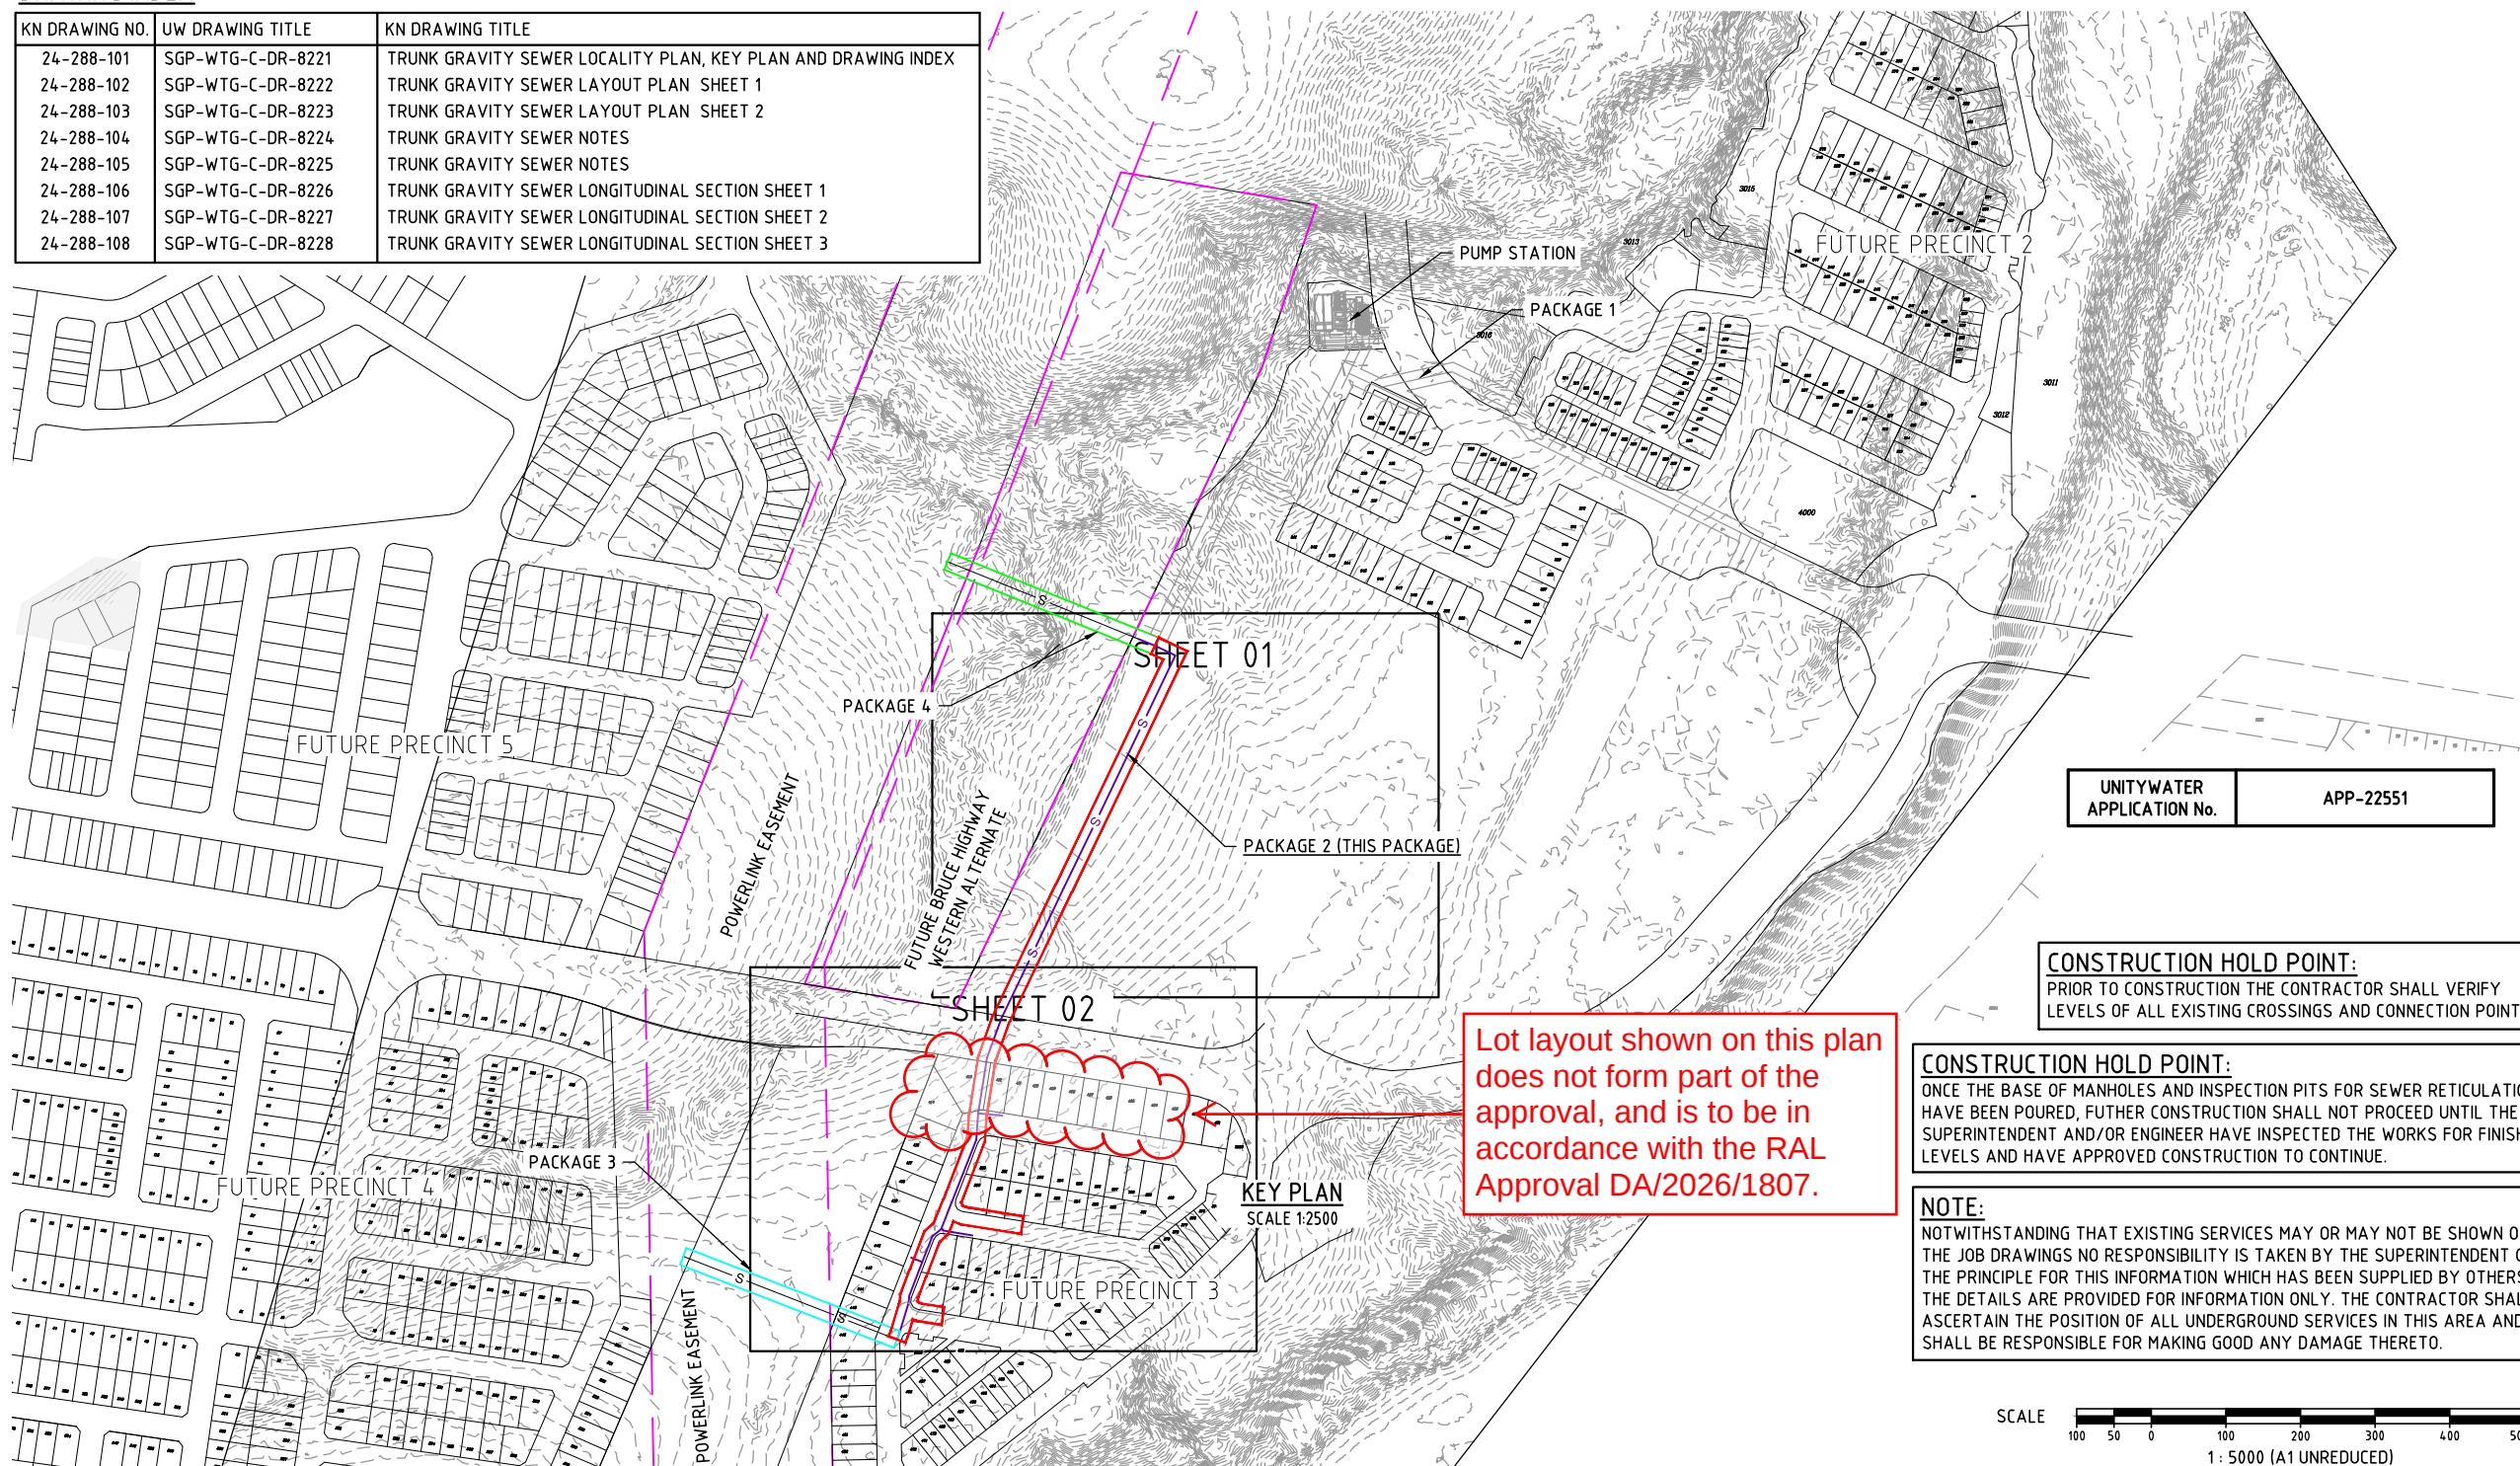


Lot layout shown on this plan does not form part of the approval, and is to be in accordance with the RAL Approval DA/2026/1807.

CONSTRUCTION HOLD POINT:
PRIOR TO CONSTRUCTION THE CONTRACTOR SHALL VERIFY
LEVELS OF ALL EXISTING CROSSINGS AND CONNECTION POINTS


CONSTRUCTION HOLD POINT:
ONCE THE BASE OF MANHOLES AND INSPECTION PITS FOR SEWER RETICULATION HAVE BEEN POURED, FUTHER CONSTRUCTION SHALL NOT PROCEED UNTIL THE SUPERINTENDENT AND/OR ENGINEER HAVE INSPECTED THE WORKS FOR FINISHED LEVELS AND HAVE APPROVED CONSTRUCTION TO CONTINUE.

NOTE:
NOTWITHSTANDING THAT EXISTING SERVICES MAY OR MAY NOT BE SHOWN ON THE JOB DRAWINGS NO RESPONSIBILITY IS TAKEN BY THE SUPERINTENDENT OR THE PRINCIPLE FOR THIS INFORMATION WHICH HAS BEEN SUPPLIED BY OTHERS. THE DETAILS ARE PROVIDED FOR INFORMATION ONLY. THE CONTRACTOR SHALL ASCERTAIN THE POSITION OF ALL UNDERGROUND SERVICES IN THIS AREA AND SHALL BE RESPONSIBLE FOR MAKING GOOD ANY DAMAGE THERETO.



Unitywater Application No. APP-22551	Unitywater Drawing No. SGP-WTG-C-DR-8221
--	--

DO NOT SCALE THIS DRAWING
IF IN DOUBT - ASK!

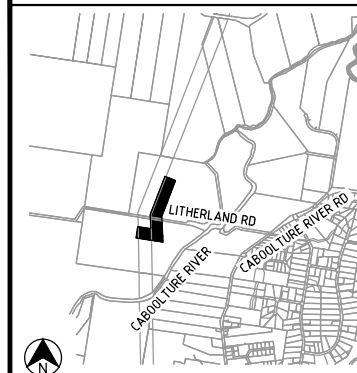

REVISIONS

[illegible]

Client



Project

RIVERMONT
TRUNK GRAVITY SEWER
PACKAGE 2



L1, 62 Astor Terrace, Spring Hill, QLD 4000
www.kngroup.com.au | 07 3017 1900

Approved Director - RPEQ 17544

Digitally signed by
Mark Shaw RPE
17544
Date: 2026.05.07
13:33:50+10'00'

Drawing Title

TRUNK GRAVITY SEWER
LOCALITY PLAN, KEY PLAN
AND DRAWING INDEX

Drawn VS	Designed VS	Checked MAS	Date MAY '2
Scale AS SHOWN			Sheet 1 of
1	A1	Drawing No 24-288-101	Revision C

NOTES

- ## ENVIRONMENTAL CONDITIONS

- ## VEGETATION PROTECTION

- SOIL

- ## CREEK CROSSINGS

- ## REHABILITATION

- ## SAFETY

- ## MAINTENANCE HOLES

DESIGN REQUIREMENTS

- | LOCATION | LIVE LOAD | ACCESS COVERS TO AS 3996 |
|---|-----------|--------------------------|
| RESERVES, RESIDENTIAL ALLOTMENTS, FOOTPATHS AND VERGES | 25 kN | CLASS RATING B |
| ROADWAYS AND DRIVEWAYS, COMMERCIAL, INDUSTRIAL AND NON-RESIDENTIAL ALLOTMENTS | 80 kN | CLASS RATING D |

- ### 3. DURABILITY CLASSIFICATION

STRUCTURE	COVER LOCATION	EXPOSURE CLASSIFICATION AS 3600, AS 3735	REINFORCEMENT COVER (mm)
SLABS	TOP	B2 TO AS 3600	40
	BOTTOM	B2 TO AS 3735	50 INCLUDING PE LINER THICKNESS

4. SEQ CODE SEWER MH STANDARD DRAWINGS THAT ARE APPLICABLE TO UU AND UNITYWATER HAVE ASSUMED THAT A MINIMUM SOIL BEARING PRESSURE OF 50 kPa CAN BE ACHIEVED.

GENERAL

1. THESE NOTES RELATE TO ALL TOP SLABS AND CAST-INSITU MAINTENANCE HOLES FOR QUU AND UNITYWATER.
2. MAINTENANCE HOLE TOP SLABS SHALL BE PRECAST ELEMENTS.
3. DIMENSIONS IN MILLIMETRES.
4. DIMENSIONS NOT TO BE SCALED FROM DRAWINGS.
5. VERIFY ALL DIMENSIONS ON SITE PRIOR TO COMMENCING WORK ON SITE.
6. MATERIALS AND WORKMANSHIP TO COMPLY WITH THE CURRENT STANDARDS AUSTRALIA CODES, BUILDING CODE OF AUSTRALIA, WSAA PRODUCT SPECIFICATIONS, BY-LAWS AND ORDINANCES OF RELEVANT BUILDING AUTHORITIES.
7. EXISTING STRUCTURES TO BE MAINTAINED IN A STABLE CONDITION AND NO PART TO BE OVER-STRESSED DURING CONSTRUCTION.

MAINTENANCE HOLES

1. MAINTENANCE HOLES SHALL BE LOCATED CENTRALLY OVER SEWERS UNLESS SPECIFIED OTHERWISE. REFER DRAWINGS SEQ-SEW-1304-1 AND SEQ-SEW-1305-1.
2. OBVERT LEVEL OF THE UPSTREAM SEWER PIPE SHALL ALWAYS BE ABOVE THE OBVERT LEVEL OF THE DOWNSTREAM SEWER PIPE UNLESS APPROVED OTHERWISE.
3. ALL CONSTRUCTION JOINTS SHALL INCLUDE HYDROPHILIC SEALS INSTALLED TO MANUFACTURER'S SPECIFICATIONS.
4. MAINTENANCE HOLE CONNECTORS, INCLUDING HYDROPHILIC SEALS AND PUDDLE FLANGES SHALL BE THE PRE-FABRICATED TYPE UNLESS APPROVED OTHERWISE.
5. ENDS OF SEWER PIPES SHALL FINISH FLUSH WITH THE INSIDE FACE OF MAINTENANCE HOLE WALL.
6. FINISHED BENCHING SHALL PROVIDE A SMOOTH NON-TURBULENT FLOW.
7. PROPERTY CONNECTION JUNCTIONS SHALL NOT BE CONSTRUCTED ON SHORT PIPES AT MAINTENANCE HOLES OR BULKHEADS.
8. FOR CONSTRUCTION OF MAINTENANCE HOLE AND OR MAINTENANCE SHAFT OVER EXISTING SEWER REFER TO SEQ-SEW-1502-1

MAINTENANCE HOLE CIRCULAR ACCESS COVERS

1. CIRCULAR ACCESS COVERS AND FRAMES SHALL BE RATED TO CLASS RATING B OR CLASS RATING TO AS 3996.
2. PRODUCT CERTIFICATION TO AS 3996 SHALL BE SUPPLIED FOR EACH COVER ASSEMBLY.
3. COVERS, FRAMES AND RISER RINGS, WHERE REQUIRED, SHALL BE SUPPLIED ASSEMBLED.
4. COVERS SHALL BE SOLID TOP.
5. COVERS SHALL HAVE IDENTIFICATION TAGS DETAILING, SEWER / VACUUM SEWER / CLASS RATING B, D / SEALED / COVER PATTERN DETAIL / SEQ.-SP NAME / WEIGHT.
6. BOLT DOWN COVERS SHALL BE PROVIDED IN FLOOD PRONE AREAS, STORM SURGE AREAS, SURCHARGING SEWERS AND WHERE SPECIFIED IN THE DESIGN.
7. BOLT DOWN COVER FRAMES TO BE FIXED TO THE TOP SLAB WITH 4 M16 STAINLESS STEEL CHEMICAL ANCHORS. EMBEDMENT LENGTH SHALL BE MINIMUM 110mm UNLESS APPROVED OTHERWISE.

SAFETY IN DESIGN

1. THE SAFETY IN DESIGN, DESIGN AND RISK MITIGATION MEASURES FOR THESE DRAWINGS DO NOT NECESSARILY ACCOUNT FOR ALL DESIGN, CONSTRUCTION, OPERATION, MAINTENANCE AND DEMOLITION ASSESSMENTS. IT DOES NOT REDUCE OR LIMIT THE OBLIGATIONS OF THE CONSTRUCTOR, USER, OPERATOR, MAINTAINER AND DEMOLISHER TO PERFORM THEIR OWN SAFETY IN DESIGN RISK ASSESSMENT.
2. DEVELOP CONSTRUCTION AND INSTALLATION SAFE WORK METHOD STATEMENTS TO ELIMINATE AND MINIMISE INSTALLATION RISKS.

CONCRETE

1. CONCRETE WORKMANSHIP AND MATERIALS TO COMPLY WITH AS 3600 AND AS 3610.
2. CONCRETE TO COMPLY WITH AS 1379, AS 1478.1, AS 1478.2, AS 3582.1 AS 3582.2, AS 3582.3 AND AS 3582.4.
3. SLUMP TO BE AS REQUIRED FOR PLACEMENT, COMPACTION AND FINISHING. A SAMPLE OF FRESH CONCRETE SHALL BE TESTED FOR SLUMP AND STRENGTH UPON ARRIVAL ON SITE.
4. WATER NOT TO BE ADDED TO CONCRETE AFTER TRUCK HAS LEFT BATCHING PLANT UNLESS APPROVED OTHERWISE.
5. TEST SLUMP OF EACH BATCH OF CONCRETE DELIVERED.
6. DESIGN, CERTIFICATION, CONSTRUCTION AND PERFORMANCE OF FORMWORK BY CONTRACTOR.
7. CONCRETE CONSTRUCTION TOLERANCES TO AS 3610.
8. CONCRETE SIZES DO NOT INCLUDE FINISHES. SIZES NOT TO BE REDUCED OR PENETRATIONS ADDED.
9. CONDUITS, PIPES, ETC. NOT TO BE PLACED IN CONCRETE COVER TO THE REINFORCEMENT.
10. EXPOSED EDGES AND RE-ENTRANT CORNERS TO HAVE 25mm CHAMFERS OR FILLETS UNLESS NOTED OTHERWISE.
11. CONSTRUCTION JOINTS AS DETAILED AND LOCATED ON DESIGN DRAWINGS.
12. CONCRETE SURFACE FINISHES TO AS 3610.
 - FORMED EXPOSED SURFACES CLASS 2
13. CONCRETE TEMPERATURE NOT TO EXCEED TEMPERATURES STATED BELOW.

CONCRETE STRUCTURE	CONCRETE STRENGTH f'c	TEMPERATURE LIMIT
CONCRETE SECTIONS LESS THAN 600mm THICK.	EQUAL TO OR MORE THAN 40MPa.	35°C
CONCRETE SECTIONS EQUAL TO OR GREATER THAN 600mm THICK.	EQUAL TO OR MORE THAN 40MPa.	27°C

14. CONCRETE CURING TO AS3600 AS SOON AS POSSIBLE AFTER PLACING AND FINISHING.
15. CONCRETE GRADE S40.

TYPE OF AGGREGATE	CALCAREOUS
COMPRESSIVE STRENGTH AT 28 DAYS	40 MPa
MINIMUM CEMENT CONTENT	380 kg/m ³
MAXIMUM CEMENTITIOUS MATERIAL	25%
MAXIMUM WATER/CEMENT RATIO	0.45
NOMINAL SLUMP	80mm±15
DRYING SHRINKAGE AT 56 DAYS	650 x 10 ⁻⁶ (+5% MAXIMUM)
MAXIMUM AGGREGATE SIZE	20mm
MINIMUM AGGREGATE SIZE	10mm

16. CONCRETE SHALL BE SPECIAL CLASS TO WSA-PS 358 WITH CALCAREOUS AGGREGATE.
17. BENCHING FINISH SHALL CONSIST OF EQUAL PARTS OF CEMENT AND SAND.

REINFORCEMENT

- REINFORCEMENT FOR THE TOP SLABS SHALL BE A PRE-FABRICATED ELEMENT.
REINFORCEMENT TO COMPLY WITH AS 4671.
- SYMBOLS ON DRAWINGS FOR GRADE AND TYPE OF REINFORCEMENT ARE:
- R - STRUCTURAL GRADE 250 PLAIN ROUND BARS
 - N - HOT ROLLED GRADE 500 DEFORMED BAR, DUCTILITY CLASS N
 - L - HOT ROLLED GRADE 500 DEFORMED BAR, DUCTILITY CLASS L
 - SL - HARD DRAWN WIRE GRADE 500 MESH, DUCTILITY CLASS L
 - RL - HARD DRAWN WIRE GRADE 500 MESH, DUCTILITY CLASS L
 - W - STEEL REINFORCING WIRE GRADE 500
- REINFORCEMENT DESIGNATION AS FOLLOWS (E.G. 14N16-250 EF)
- 14 - NUMBER OF BARS
 - N - BAR GRADE AND DUCTILITY CLASS
 - 16 - BAR DIAMETER IN mm
 - 250 - SPACING OF BARS IN mm
 - EF - LOCATION
- ABBREVIATIONS TO REINFORCEMENT LOCATION.
- EW - EACH WAY
 - EF - EACH FACE
 - B - BOTTOM
 - T - TOP
 - CP - CENTRALLY PLACED
- REINFORCEMENT IS SHOWN DIAGRAMMATICALLY ONLY AND NOT NECESSARILY IN TRUE PROJECTION.
- REINFORCEMENT TO BE FIXED SECURELY AND SUPPORTED ON PROPRIETY CONCRETE, METAL OR PLASTIC SUPPORTS.
- REINFORCEMENT TO BE SPLICED AS SHOWN ON PROJECT DRAWINGS. LAP LENGTHS TO COMPLY WITH AS 3600 AND TABLE BELOW U.N.O.

BAR SIZE	LAP LENGTH (mm)
N12	350
N16	500
N20	600
N24	700
N28	850
N32	950

9. REINFORCEMENT NOT TO BE WELDED UNLESS SHOWN ON PROJECT DRAWINGS OR APPROVED OTHERWISE.
10. REINFORCEMENT NOT TO BE BENT, CUT OR HEATED ON SITE UNLESS APPROVED OTHERWISE.
11. REINFORCEMENT TO BE CLEAN, FREE OF MILL SCALE, RUST, OIL, GREASE ETC.
12. DOWEL LOCATION TOLERANCE SHALL BE +/- HALF THE DIAMETER OF THE DOWEL. THE ALIGNMENT TOLERANCE SHALL BE 2mm IN 300mm.

[illegible]

Project

RIVERMONT
TRUNK GRAVITY SEWER
PACKAGE 2



L1, 62 Astor Terrace, Spring Hill, QLD 4000
www.kngroup.com.au | 07 3017 1900

Approved Director - RPEQ 17544

M. Shaw

Drawing Title
TRUNK GRAVITY SEWER
NOTES

Drawn VS	Designed VS	Checked MAS	Date MAY' 26
Scale AS SHOWN			Sheet 4 of 08
A1	Drawing No 24 -288 -104		Revision D

1. PRECAST CONCRETE MEMBERS TO COMPLY WITH AS 3850.1 AND AS 3850.2
2. PRECAST MEMBERS ARE DESIGNED FOR THE FINAL INSTALLED CONDITIONS ONLY. PRECAST MANUFACTURER TO DESIGN THE PRECAST MEMBERS INCLUDING CONNECTIONS, FIXING DETAILS, JOINTS, FIRE RESISTANCE, ETC. FOR STABILITY, SERVICEABILITY AND STRENGTH REQUIREMENTS REQUIRED DURING MANUFACTURE, TRANSPORT, LIFTING, ERECTION AND INSTALLATION.
3. PRECAST MANUFACTURER TO PROVIDE THEIR SHOP DRAWINGS AND RPEQ CERTIFICATION FOR CONSTRUCTION OF THE PRECAST SLAB TO THE DESIGNS PROVIDED IN MAINTENANCE HOLE DRAWINGS INCLUDING DESIGN AND CONSTRUCTION CERTIFICATION FOR CONNECTIONS AND FIXING REQUIRED FOR MANUFACTURE, TRANSPORT, ERECTION AND INSTALLATION. (FORM 15 AND 16)
4. PRECAST CONCRETE MEMBERS TO BE SUPPLIED AND CONSTRUCTED BY A PRECAST CONCRETE CONSTRUCTOR.
5. ADEQUATELY DESIGNED TEMPORARY BRACING, AS REQUIRED, TO BE PROVIDED DURING ERECTION AND INSTALLATION.
6. MINIMUM CHARACTERISTIC COMPRESSIVE STRENGTH OF CONCRETE AT REMOVAL FROM MOULDS SHALL BE 15MPa
7. ALL INSERTS IN PRECAST CONCRETE MEMBERS TO BE STAINLESS STEEL.
8. ALL STRUCTURAL STEELWORK CONNECTIONS TO PRECAST CONCRETE MEMBERS TO BE HOT DIP GALVANIZED TO AS 4680 SYSTEM DESIGNATION HDG600.
9. PROVIDE 15mm CHAMFERS OR FILLETS AT EDGES AND CORNERS OF PRECAST MEMBERS EXCEPT AT UNDERSIDE OF MH SLAB ACCESS OPENING UNLESS APPROVED OTHERWISE.
10. PRECAST CONCRETE MEMBERS NOT TO BE ERECTED ON REINFORCED CONCRETE STRUCTURES UNTIL THE REINFORCED CONCRETE STRUCTURES HAVE BEEN CURED TO ACHIEVE 28 DAYS STRENGTH.
11. WEIGHT OF TOP SLAB TO BE STAMPED ON THE SLAB.
12. CONCRETE TO BE SPECIAL CLASS S4.0 TO WSA P5-358 AND P-9903 WITH CALCAREOUS AGGREGATE.
13. APPROVED LIFTING PLAN IS TO BE AVAILABLE ON REQUEST.

1. STAINLESS STEEL TO COMPLY TO ASTM A240/A240M AND ASTM A480/ A480M.
2. FABRICATION BY MANUFACTURERS ASSDA ACCREDITED OR APPROVED EQUIVALENT.
3. STAINLESS STEEL TO BE GRADE 316 OR 316L U.N.O.
4. STORAGE, FABRICATION AND WELDING TO BE IN APPROVED DEDICATED AREAS.
5. WELDING, CLEANING, PICKLING AND PASSIVATION TO COMPLY TO AS 1554-6 AND WITIA TECHNICAL NOTE 16 WELDING OR STAINLESS STEEL.
6. SURFACE FINISH TO BE 2B OR BETTER TO ASTM A480.
7. MEMBERS TO BE ACID PASSIVATED AFTER FABRICATION.
8. ANTI GALLING COMPOUND REQUIRED FOR ALL SURFACES - SP APPROVED EQUIVALENT REQUIRED ON ALL FASTENERS UNLESS APPROVED OTHERWISE.

1. THE PE LINER SHALL FORM A COMPLETELY SEALED AND WELDED ROBUST CONTINUOUS MEMBRANE SYSTEM. THE PE LINER SHALL BE BUILT TO THE MH CONSTRUCTION TOLERANCES WITHOUT ANY DEFECTS SUCH AS BULGING, WARPING, PINCHING, OVERLAPPING.
2. THE PE SHEETS SHALL:
 - HAVE A MINIMUM THICKNESS OF 2.5 mm.
 - ACHIEVE A MECHANICAL BOND BETWEEN THE CONCRETE AND LINER.
 - BE INSTALLED BY AN ACCREDITED APPLICATOR APPROVED BY THE MANUFACTURER.
 - BE TENSIONED OVER THE FORMWORK WITHIN THE YIELD ELONGATION LIMIT PRIOR TO SECURING TO THE FORMWORK.
3. PREPARATION, APPLICATION AND INSTALLATION TO COMPLY WITH THE MANUFACTURER'S SPECIFICATION.
4. POURED CONCRETE TO BE AT A COOLER AMBIENT TEMPERATURE THAN THE TEMPERATURE WHEN THE PE SHEETS WERE ATTACHED TO THE FORMWORK.
5. EXTRUSION WELDING AND WELD TESTING AT SEAMS TO BE UNDERTAKEN BY THE APPROVED APPLICATOR TO THE MANUFACTURER'S SPECIFICATION.
6. ENCAPSULATION OF ANCHORS TO BE CHECKED BY TAPPING THE SURFACE TO DETECT HOLLOW SOUNDS THAT INDICATE VOIDS. VOIDS TO BE FILLED BY INJECTION GROUT AND PE SHEET REPAIRED BY EXTRUSION WELDING OVER THE INJECTION HOLE.

1. STRUCTURAL STEEL WORKMANSHIP AND MATERIALS TO COMPLY WITH AS 4100.
2. STEEL TO COMPLY WITH:
 - AS 1163 GRADE C350 FOR RECTANGULAR AND HOLLOW SECTIONS.
 - AS 3678 FOR PLATES AND FLOOR PLATES.
 - AS 3679.1 GRADE 300 OR BHP GRADE 300 PLUS FOR PARALLEL FLANGE CHANNELS.
 - AS 3679.2 GRADE 300 FOR WELDED BEAMS AND COLUMNS.
 - OTHER SECTIONS TO COMPLY WITH AS 3678 OR AS 3679 GRADE 250.
3. WELDS TO AS 1554.
 - WELD CATEGORY SP.
 - BUTT WELDS TO BE FULL PENETRATION WELDS.
 - WELDS TO BE 6mm CONTINUOUS FILLET WELDS ALL ROUND INTERFACES.
 - ELECTRODES TO AS 1554 CLASSIFICATION E48XX.
4. BOLTS TO AS 1275, COMMERCIAL GRADE 4.6/S TO AS 1111 AND AS 1112. HIGH STRENGTH STRUCTURAL BOLTS TO AS 1252.
 - BOLTS, NUTS AND WASHERS M16 AND LARGER TO GRADE 8.8/S. M12 TO BE GRADE 4.6/S.
 - STRUCTURAL CONNECTIONS TO BE 2 M16 8.8/S WITH 10mm THICK CLEAT PLATE UNLESS NOTED OTHERWISE.
 - INSTALL WASHERS UNDER BOLT HEAD AND NUT. INSTALL TAPERED WASHERS AS REQUIRED.
 - PROJECTION BEYOND NUT TO BE MINIMUM 2x THREADS AND MAXIMUM 10mm.
5. HOLD DOWN BOLTS TO GRADE 4.6/S UNLESS NOTED OTHERWISE. HOLD DOWN BOLTS GROUPS TO BE RIGIDLY TIED FOR CORRECT SET-OUT AND LOCATION.
6. SEAL WELD HOLLOW SECTIONS WITH 3mm THICK CAP PLATE UNLESS NOTED OTHERWISE.
7. GROUT BASE PLATES WITH HIGH STRENGTH NON-SHRINK PRE-MIXED GROUT BEFORE COLUMNS ARE LOADED.

1. STEELWORK TO BE HOT DIP GALVANISED TO AS 4680 SYSTEM DESIGNATION HDG600 AND THREADED FASTENERS TO AS 1214.
2. DAMAGED GALVANISED COATING REPAIR:
 - POWER CLEAN TO AS 1627.2
 - SOLVENT CLEAN/ DEGREASE TO AS 1627.1
 - APPLY TIN/ZINC TO PRE-HEATED STEEL OVERLAPPING THE GALVANISING COATING.

1. EXPOSED REINFORCEMENT AND CONCRETE REPAIRED AS FOLLOWS:
 - CORE HOLES ON EACH CORNER OF AREA TO BE CUT.
 - SAW CUT CONCRETE, PERPENDICULAR TO CONCRETE SURFACE, 15mm DEEP AROUND PERIMETER OF THE OPENING.
 - BREAKOUT REMAINING CONCRETE AROUND THE OPENING WITHOUT DAMAGING REINFORCEMENT.
 - CUT EXPOSED REINFORCEMENT SO THAT IS 30 mm CLEAR OF THE PIPE.
 - CLEAN CONCRETE SURFACE AND REMOVE ALL LOOSE MATERIAL.
 - ABRASIVE BLAST CLEAN EXPOSED REINFORCEMENT, IF IT IS CORRODED AND APPLY "NITOPRIME" ZINC RICH PRIMER UNLESS APPROVED OTHERWISE.
 - THOROUGHLY SOAK SUBSTRATE WITH CLEAN WATER FOR A MINIMUM OF TWO HOURS.
 - PLACE 1/2" CIRCULAR TRIMMER ON BOTH SIDES OF THE PIPE FLANGE.
 - INSTALL HYDROTITE CJ-07-25 SEAL ON PIPE 50mm FROM CONCRETE SURFACE UNLESS APPROVED OTHERWISE.
 - APPLY "NITOBOND HAR" PRIMER TO CONCRETE SURFACE UNLESS APPROVED OTHERWISE.
 - POUR CONCRETE/GROUT ("RENDEROC LASS" OR APPROVED EQUIVALENT) UNDER PRESSURE TO FILL OPENING.
 - FILL CONCRETE/GROUT ("RENDEROC LASS" OR APPROVED EQUIVALENT) TO SUPPLIER REQUIREMENTS.

1. ALL EXPOSED REINFORCEMENT AND MILD STEEL ANCHORED TO BE REPAIRED AS FOLLOWS:
 - SAW CUT OR CHISEL CUT CONCRETE, PERPENDICULAR TO CONCRETE SURFACE, 15 mm DEEP AROUND REINFORCEMENT/ANCHOR.
 - BREAKOUT CONCRETE AROUND REINFORCEMENT/ANCHOR TO A DEPTH OF 60mm
 - CUT EXPOSED REINFORCEMENT/ANCHOR AT A MINIMUM DEPTH OF 50mm FROM CONCRETE SURFACE
 - CLEAN CONCRETE SURFACE AND REMOVE ALL LOOSE MATERIAL.
 - ABRASIVE BLAST CLEAN EXPOSED REINFORCEMENT/ANCHOR. APPLY "NITRIPRIME" ZINC RICH PRIMER TO REINFORCEMENT/ ANCHOR UNLESS APPROVED OTHERWISE, THOROUGHLY SOAK SURFACET WITH WATER.
 - APPLY "NITOBOND H40" PRIMER TO CONCRETE UNLESS APPROVED OTHERWISE.
 - APPLY "RENDER H870" TO FILL OPENING UNLESS APPROVED OTHERWISE.

1. BENCHMARK LEVELS ARE AS SHOWN ON KN DWG No 24-278-52.
2. THE CONTRACTOR SHALL VERIFY FINISH SURFACE LEVELS ON SITE BEFORE CONSTRUCTION OF SEWERS AND PROPERTY CONNECTION BRANCHES.
3. F.S.L. SHOWN ON THE LONGITUDINAL SECTIONS ARE INDICATIVE ONLY. MANHOLE COVERS TO BE CONSTRUCTED AS PER STD DWG No SEQ-SEW-1308-1.
4. UNITYWATER HAS APPROVED THE USE OF 5mm GRAVEL SCREENING AROUND AND SUPPORTING THE BOTTOM AND SIDES OF PIPES. A NON-COHESIVE GRANULAR MATERIAL COMPLYING WITH THE GRADING, AS SETOUT IN UNITYWATER'S SPECIFICATIONS SHALL BE USED TO ENCLOSE THE HOUSE CONNECTION BRANCH.
5. VACUUM TESTING OF ALL SEWER MANHOLES AND PIPELINES ARE REQUIRED TO THE SEQ WS&S D&C CODE - UNITYWATER - SPECIFICATIONS REQUIREMENTS.
6. PRIOR TO COMMENCEMENT OF ANY CONSTRUCTIONS TO LIVE SEWERS KN IS TO BE NOTIFIED OF PROPOSED TIMING TO ALLOW NOTIFICATION TO UNITYWATER REPRESENTATIVES.
7. SEWER MAINTENANCE HOLES SHALL BE CONSTRUCTED WITHOUT STEP IRONS OR LADDERS.
8. DETECTABLE MARKER TAPE TO BE INSTALLED OVER ALL SEWER MAINS DIRECTLY ABOVE SCREENINGS.
9. PIPE EMBEDMENT SHALL BE CONSTRUCTED AS PER STD DWG No. SEQ-SEW-1201-1 TO SEQ-SEW-1205-1.
10. PROPERTY CONNECTION BRANCHES SHALL BE CONSTRUCTED AS PER STD DWG No SEQ-SEW-1106-1 TO SEQ-SEW-1106-6.
11. CCTV FOOTAGE TO UNITYWATER SPEC D&C CODE REQUIREMENTS TO BE PROVIDED. KN TO REVIEW/REPORT FOOTAGE FOR EACH SEWER LINE. CCTV NOT REQUIRED ON DN160 CROSS ROAD PROPERTY CONNECTIONS.
12. TANGENT POINT SET-OUT INFORMATION FOR HORIZONTAL BENDS IS TO BE INCLUDED ON AS-CONSTRUCTED DRAWINGS.
13. ALL PE-PE CONNECTIONS SHALL BE WELDED. WELDING REQUIREMENTS SHALL BE IN ACCORDANCE WITH WSA 02-2014-31 CLAUSE 4.7.1. CLASS PN10/SDR17 PE FITTINGS SHALL BE UTILISED THROUGHOUT.
14. ALL CONNECTIONS TO LIVE SEWER TO BE UNDERTAKEN BY CONTRACTOR UNDER SUPERVISION OF CONSTRUCTION CERTIFIER OR AS DIRECTED BY UNITYWATER, AND AT THE DEVELOPERS EXPENSE ALL LRB RADII SHALL BE 35 TIMES THE OUTSIDE DIAMETER OF AN SDR21 PE PIPE AND 25 TIMES THE OUTSIDE DIAMETER OF AN SDR17 PE10 PIPE. MOUNTED PVC FITTING ARE NOT PERMITTED.
15. LEVELS FOR EXISTING SEWER HAVE BEEN OBTAINED FROM AS-CONSTRUCTED INFORMATION. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO CONFIRM EXISTING LEVELS ON SITE.
16. WHERE PROPERTY CONNECTION INSPECTION TEES TERMINATE BENEATH DRIVEWAY SLAB, EXTEND AN I.O. RISER TO SURFACE LEVEL AND FINISH WITH TRAFFICABLE BRASS CAP

[illegible]

SOIL DESCRIPTION	APPROXIMATE NATIVE SOIL MODULUS (MPa)	SDR	PE 100 DN160 TRENCH WIDTH (mm)	MAX DEPTH (mm)
SOFT CLAY	5.0	21	600	6000
SOIL DESCRIPTION	APPROXIMATE NATIVE SOIL MODULUS (MPa)	SDR	PE 100 DN250 TRENCH WIDTH (mm)	MAX DEPTH (mm)
SOFT CLAY	5.0	21	600	8000
SOFT CLAY	5.0	17	600	10300
SOIL DESCRIPTION	APPROXIMATE NATIVE SOIL MODULUS (MPa)	SDR	PE 100 DN315 TRENCH WIDTH (mm)	MAX DEPTH (mm)
SOFT CLAY	5.0	17	900	10500
SOIL DESCRIPTION	APPROXIMATE NATIVE SOIL MODULUS (MPa)	SDR	PE 100 DN630 TRENCH WIDTH (mm)	MAX DEPTH (mm)
SOFT CLAY	5.0	17	1200	10900
SOFT CLAY	5.0	13.6	1200	10900

1. EMBEDMENT MATERIAL TO BE SINGLE SIZE CRUSHED ROCK NOMINAL 5 TO 7mm SIZE OR AS NOMINATED IN THE SEQ ACCEPTED PRODUCTS AND MATERIALS LIST.
2. THE CONTRACTOR MUST CONFIRM THE TRENCH SUBGRADE INSITU MATERIAL CHARACTERISTICS EQUAL OR EXCEED A MINIMUM NATIVE SOIL MODULUS OF 0.9 MPa AND SUBMIT TO THE SUPERINTENDENT FOR APPROVAL. PRIOR TO PROGRESSING WITH CONSTRUCTION.

NAME OF ESTATE		RIVERMONT- TRUNK GRAVITY SEWER
SUBDIVIDER		STOCKLAND
APPLICATION No.		
SP DELEGATE APPROVAL DATE		
DRAWING/PLAN No.		
No. OF ALLOTMENTS		-
AREA IN ha.		-
LENGTH OF SEWERS (m)	DN160 PE100	72.011
	DN250 PE100	525.746

[illegible]

M:\2024\24-288 Rivermont P2 EWW Trunk Gravity Sewer\Engineering\Acad\100 SERIES - Package 2\24-288-106-108-LS.dwg Plotted by: DF on 6/05/2026 3:12:19 PM

MAINTENANCE HOLE/SHAFT No.
MH/MS COVER TYPE
MH/MS TYPE
BRANCH LINE No.
BRANCH DROP TYPE
HC TYPE
HC DEPTH
HC CH. TO DS MH/MS
HC INVERT LEVEL
HC LOT No.

LEGEND:
G = CONCRETE 0.900Ø MH AS PER SEQ-SEW-1301-2 TO 1301-5 WITH MINIMUM 150mm WALL THICKNESS.
F = CONCRETE 1.200Ø MH AS PER SEQ-SEW-1301-8 TO 1301-11
X = CONCRETE 1.200Ø MH AS PER SEQ-SEW-1301-14 TO 1301-21 EXCLUDING SAFETY CHAINS AND LADDER AS PER UW Pr11051 REV 1
P = CONCRETE 1.500Ø MH AS PER SEQ-SEW-1307-1
C = CONCRETE IN-SITU CUSTOM Ø REFER DETAIL
@ = PE LINED SEQ-SPS-1407-1, 1407-2, AND SEQ-SEW-1301-26
ⓑ = CLASS B NON-TRAFFICABLE
ⓓ = CLASS D TRAFFICABLE
[NC01] = NONCONFORMANCE REFER NONCONFORMANCE TABLE ON 23-151-16

- NOTES:**
- PROPERTY CONNECTION TYPE/DETAILS REFER SEQ-SEW-1106 DWG SERIES.
 - CAST IN SITU MANHOLE TYPE/DETAILS REFER SEQ-SEW-1301-1 to 1301-21, 1301-26, 1302-1, 1301-1, 1304-1, 1305-1, 1306-1, 1307-1, 1308-1, 1308-5 to 1308-11, 1313-1.
 - MAINTENANCE SHAFTS TYPE/DETAILS REFER SEQ-SEW-1315-1 AND 1316-1 STD DWG.
 - WHERE CLASS "D" COVERS ARE SPECIFIED FOR MH OR MS, INCREASE TOP SLAB THICKNESS FROM 150mm TO 175mm.
 - COMPLETE ALL END OF LINE WITH A ELECTROFUSION STOP END OR BUTT WELDED CAP.

NOTE:
[F1512] REFER DOLAN ENGINEERING DRAWINGS FOR STRUCTURAL DESIGN OF DEEP MANHOLES.

LOCATION
PIPE DIAMETER
GRADE
LENGTH
EMBEDMENT TYPE
WELDING TYPE
JUNCTION
INVERT LEVEL
DEPTH OF INVERT BELOW FSL
INVERT LEVEL (IL)
FINISHED SURFACE LEVEL (FSL) *
EXISTING SURFACE LEVEL (ESL)
CHAINAGE (CH)

LINE

* FINISHED SURFACE LEVELS ARE INDICATIVE ONLY. CONTRACTOR TO VERIFY ALL FINISHED SURFACE LEVELS PRIOR TO CONSTRUCTION COMMENCEMENT.

SCALE A 1:1000 (Horiz.)

B 1:100 (Vert.)


Unitywater Application No. APP-22551

Unitywater Drawing No. SGP-WTG-C-DR-8226

A1

Drawing No. 24-288-106

Revision C

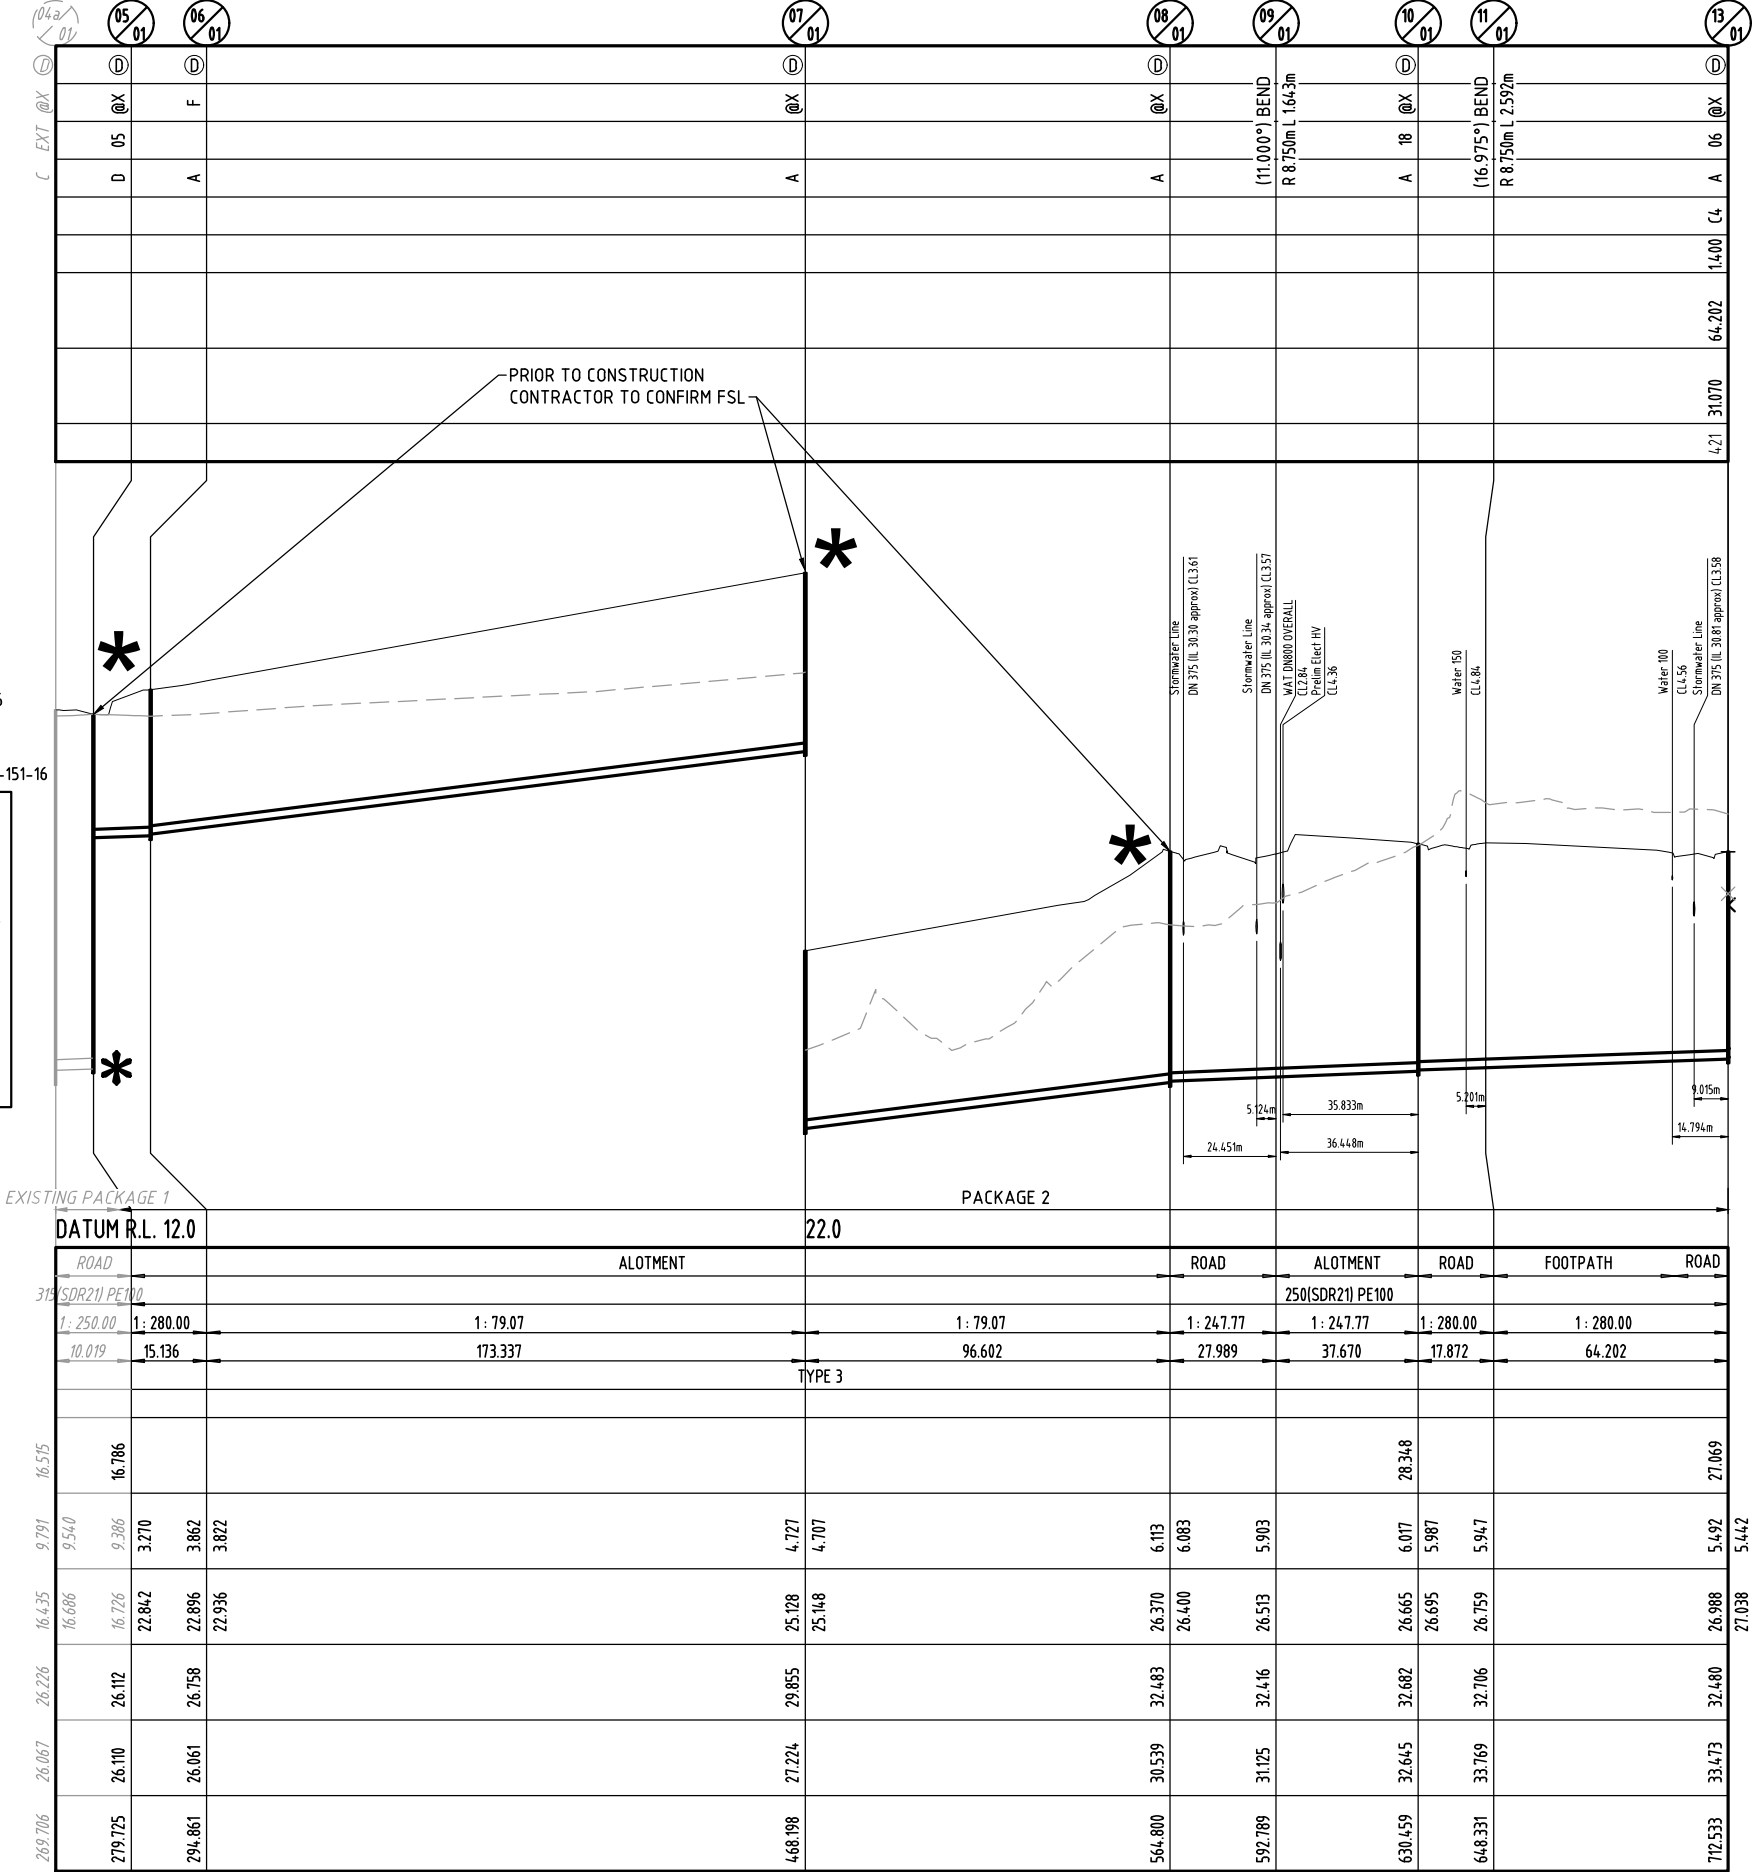

DO NOT SCALE THIS DRAWING IF IN DOUBT - ASK!



REVISIONS

No	Description	Date	By
A	FOR APPROVAL	2025.12.18	VS
B	FOR APPROVAL	2026.02.03	AL
C	LS UPDATED	2026.05.06	DF



RIVERMONT TRUNK GRAVITY SEWER PACKAGE 2



Approved Director - RPEQ 17544

Digitally signed by Mark Shaw RPEQ 17544 Date: 2026.05.07 13:33:52+10'00'

Drawing Title
TRUNK GRAVITY SEWER LONGITUDINAL SECTION SHEET 1

Drawn VS	Designed VS	Checked MAS	Date MAY '26
Scale AS SHOWN	Sheet 6 of 08	Revision C	

LEGEND:

G = CONCRETE 0.900Ø MH AS PER SEQ-SEW-1301-2 TO 1301-5
WITH MINIMUM 150mm WALL THICKNESS.

F = CONCRETE 1.200Ø MH AS PER SEQ-SEW-1301-8 TO 1301-11

X = CONCRETE 1.200Ø MH AS PER SEQ-SEW-1301-14 TO 1301-21
EXCLUDING SAFETY CHAINS AND LADDER AS PER UW
Pr11051 REV 1

P = CONCRETE 1.500Ø MH AS PER SEQ-SEW-1307-1

C = CONCRETE IN-SITU CUSTOM Ø REFER DETAIL

@ = PE LINED SEQ-SPS-1407-1, 1407-2, AND SEQ-SEW-1301-26

① = CLASS B NON-TRAFFICABLE

② = CLASS D TRAFFICABLE

NOTES:


1. PROPERTY CONNECTION TYPE/DETAILS REFER
SEQ-SEW-1106 DWG SERIES.
2. CAST IN SITU MANHOLE TYPE/DETAILS REFER
SEQ-SEW-1301-1 to 1301-21, 1301-26, 1302-1, 1301-1, 1304-1,
1305-1, 1306-1, 1307-1, 1308-1, 1308-5 to 1308-11, 1313-1.
3. MAINTENANCE SHAFTS TYPE/DETAILS REFER
SEQ-SEW-1315-1 AND 1316-1 STD DWG.
4. WHERE CLASS "D" COVERS ARE SPECIFIED FOR MH OR
MS, INCREASE TOP SLAB THICKNESS FROM 150mm to 175mm.
5. COMPLETE ALL END OF LINE WITH A
ELECTROFUSION STOP END OR BUTT WELDED CAP.

NOTE:
F1512 REFER DOLAN ENGINEERING
 DRAWINGS FOR STRUCTURAL DESIGN OF
 DEEP MANHOLES.

LOCATION	
PIPE DIAMETER	
GRADE	
LENGTH	
EMBEDMENT TYPE	
WELDING TYPE	
JUNCTION	
INVERT LEVEL	
DEPTH OF INVERT BELOW FSL	
INVERT LEVEL (IL)	
FINISHED SURFACE LEVEL (FSL)	*
EXISTING SURFACE LEVEL (ESL)	
CHAINAGE (CH)	

LINE


*** FINISHED SURFACE LEVELS ARE INDICATIVE ONLY.
CONTRACTOR TO VERIFY ALL FINISHED SURFACE LEVELS PRIOR TO CONSTRUCTION COMMENCEMENT.**

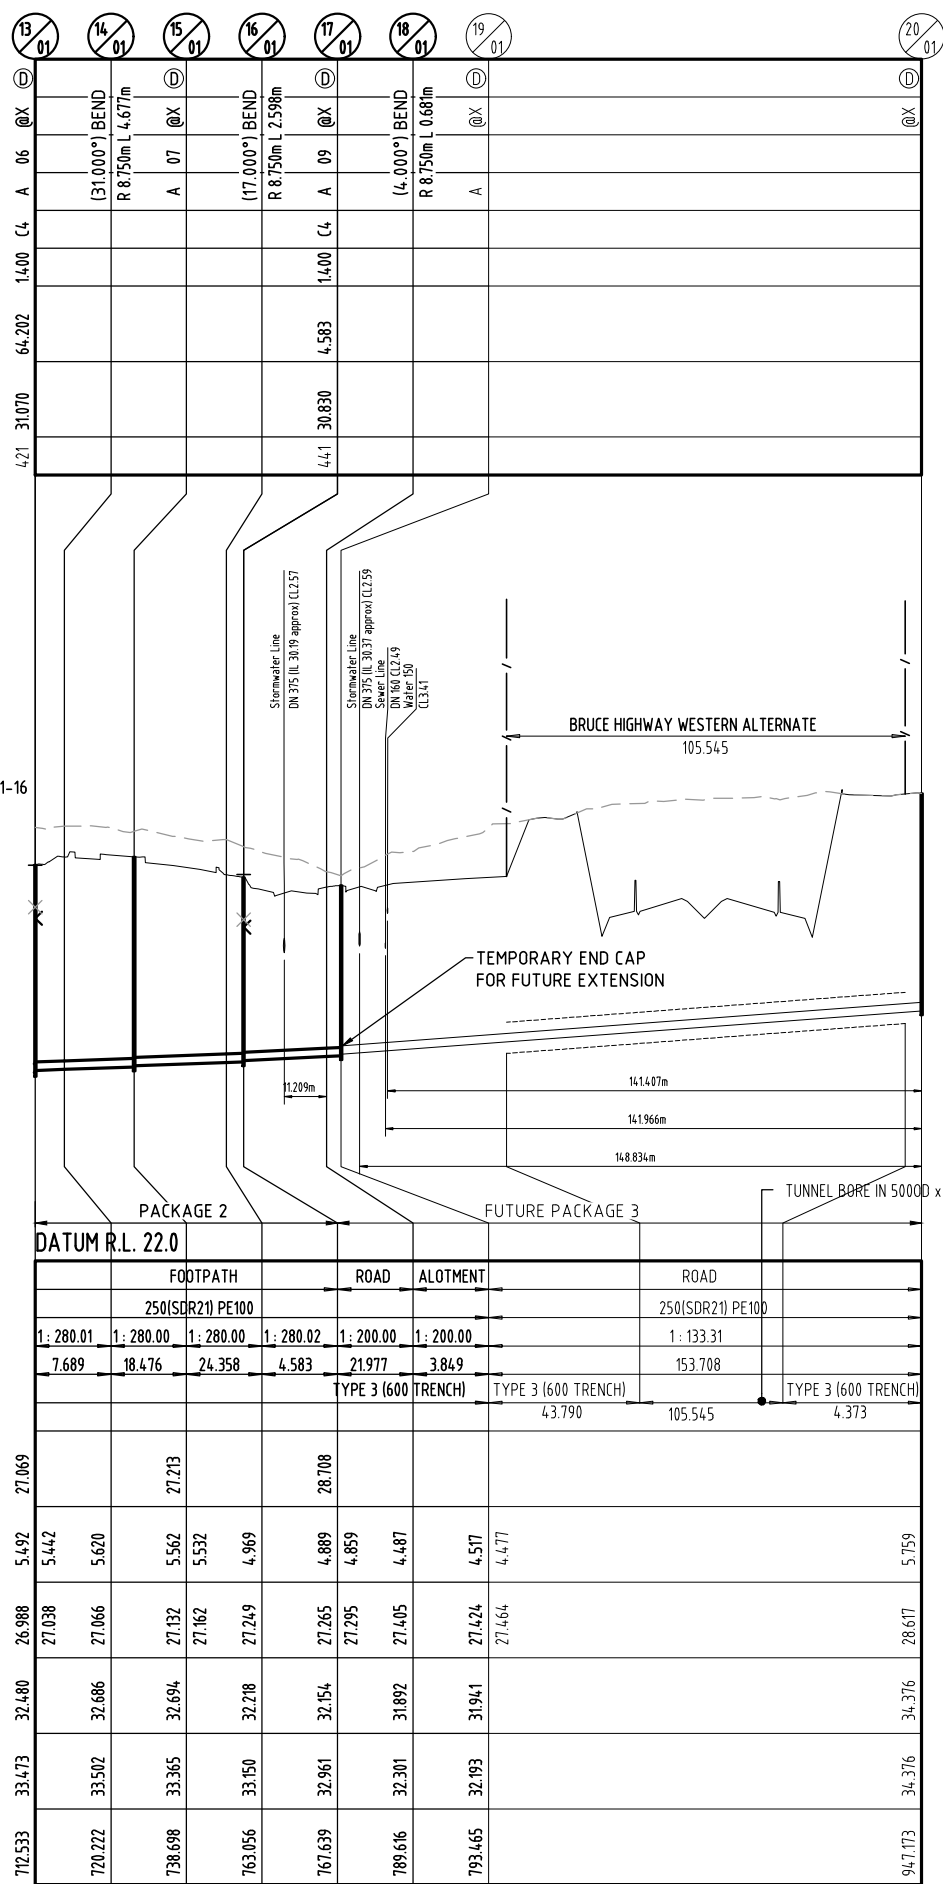

01

SCALE A 1:1000
(Horiz.)

10 5 0 10 20 30 40 50 60 70 80 90 100m

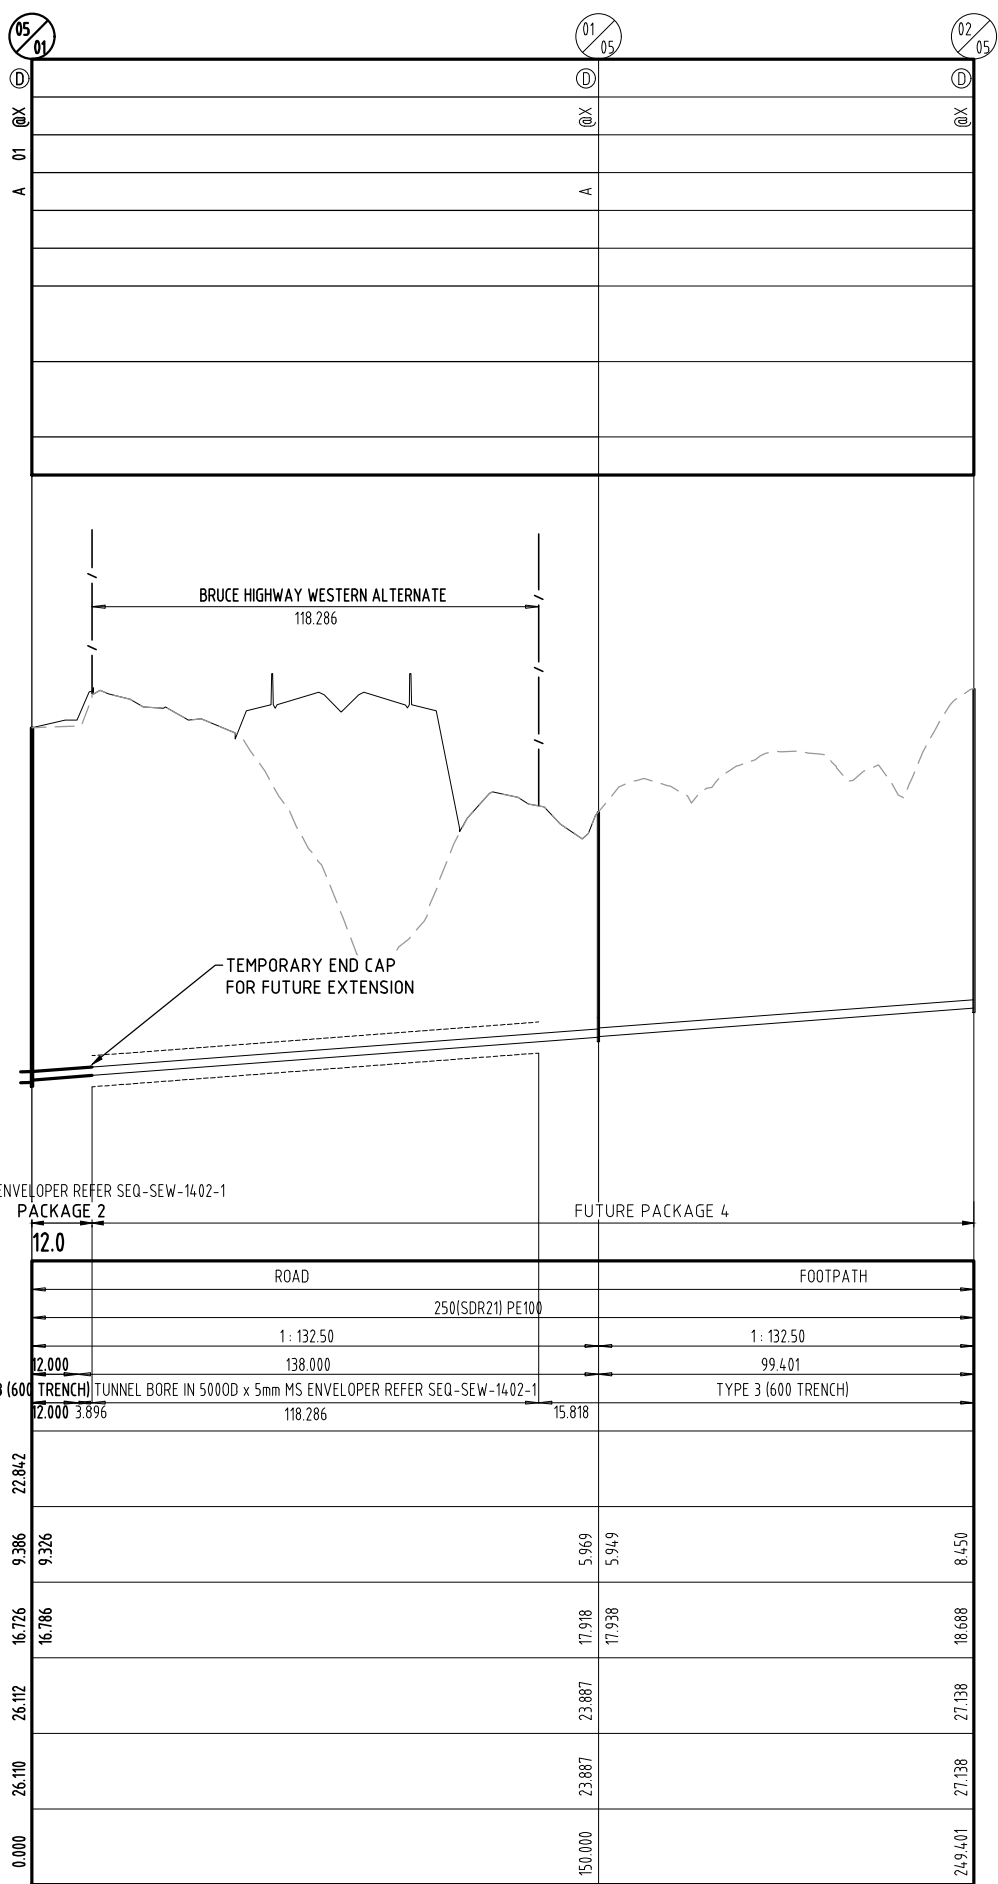

05

B 1:100 (Vert.)




(A1 UNREDUCED)

Unitywater Application No.
APP-22551

Unitywater Drawing No.
SGP-WTG-C-DR-8227

DO NOT SCALE THIS DRAWING
IF IN DOUBT - ASK!

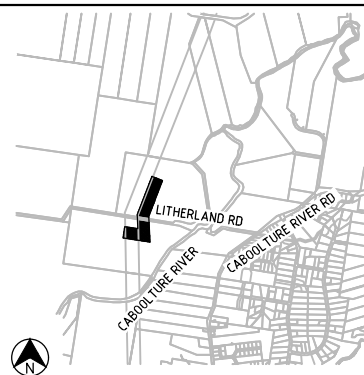

REVISIONS

[illegible]

Client



Projec

RIVERMONT
TRUNK GRAVITY SEWER
PACKAGE 2



L1, 62 Astor Terrace, Spring Hill, QLD 4000
www.kngroup.com.au | 07 3017 1900

Approved Director - RPEQ 17544

M. Shaw

Drawing Title

TRUNK GRAVITY SEWER
LONGITUDINAL SECTION
SHEET 2

Drawn VS	Designed VS	Checked MAS	Date MAY' 26
Scale AS SHOWN			Sheet 7 of 08
A1	Drawing No 24 -288 -107		Revision C

LEGEND:

G = CONCRETE 0.900 ϕ MH AS PER SEQ-SEW-1301-2 TO 1301-5
WITH MINIMUM 150mm WALL THICKNESS.

F = CONCRETE 1.200 ϕ MH AS PER SEQ-SEW-1301-8 TO 1301-11

X = CONCRETE 1.200 ϕ MH AS PER SEQ-SEW-1301-14 TO 1301-21
EXCLUDING SAFETY CHAINS AND LADDER AS PER UW
Pr11051 REV 1

P = CONCRETE 1.500 ϕ MH AS PER SEQ-SEW-1307-1

C = CONCRETE IN-SITU CUSTOM ϕ REFER DETAIL

@ = PE LINED SEQ-SPS-1407-1, 1407-2, AND SEQ-SEW-1301-26

① = CLASS B NON-TRAFFICABLE

② = CLASS D TRAFFICABLE


NC 01 = NONCONFORMANCE REFER NONCONFORMANCE TABLE ON 23-151-16

1. PROPERTY CONNECTION TYPE/DETAILS REFER
SEQ-SEW-1106 DWG SERIES.
2. CAST IN SITU MANHOLE TYPE/DETAILS REFER
SEQ-SEW-1301-1 to 1301-21, 1301-26, 1302-1, 1301-1, 1304-1,
1305-1, 1306-1, 1307-1, 1308-1, 1308-5 to 1308-11, 1313-1.
3. MAINTENANCE SHAFTS TYPE/DETAILS REFER
SEQ-SEW-1315-1 AND 1316-1 STD DWG.
4. WHERE CLASS "D" COVERS ARE SPECIFIED FOR MH OR
MS, INCREASE TOP SLAB THICKNESS FROM 150mm TO 175mm.
5. COMPLETE ALL END OF LINE WITH A
ELECTROFUSION STOP END OR BUTT WELDED CAP.

F1512 REFER DOLAN ENGINEERING
DRAWINGS FOR STRUCTURAL DESIGN OF
DEEP MANHOLES.

LINE 06

*** FINISHED SURFACE LEVELS ARE INDICATIVE ONLY.**
CONTRACTOR TO VERIFY ALL FINISHED SURFACE LEVELS PRIOR TO CONSTRUCTION COMMENCEMENT.

[illegible]

Client



Projec

RIVERMONT
TRUNK GRAVITY SEWER
PACKAGE 2



Approved Director - RPEQ 17544

M. Shaw

Drawing Title
TRUNK GRAVITY SEWER
LONGITUDINAL SECTION
SHEET 3

Drawn VS	Designed VS	Checked MAS	Date MAY' 26
Scale AS SHOWN			Sheet 8 of 08
A1	Drawing No 24-288-108		Revision C