


~~PLANS AND DOCUMENTS~~
~~referred to in the ULDA~~
~~APPROVAL dated 21/11/11~~

Cardno
BOWLER
Shaping the Future

~~PLANS AND DOCUMENTS~~
~~referred to in the ULDA~~
~~APPROVAL dated 16/5/12~~

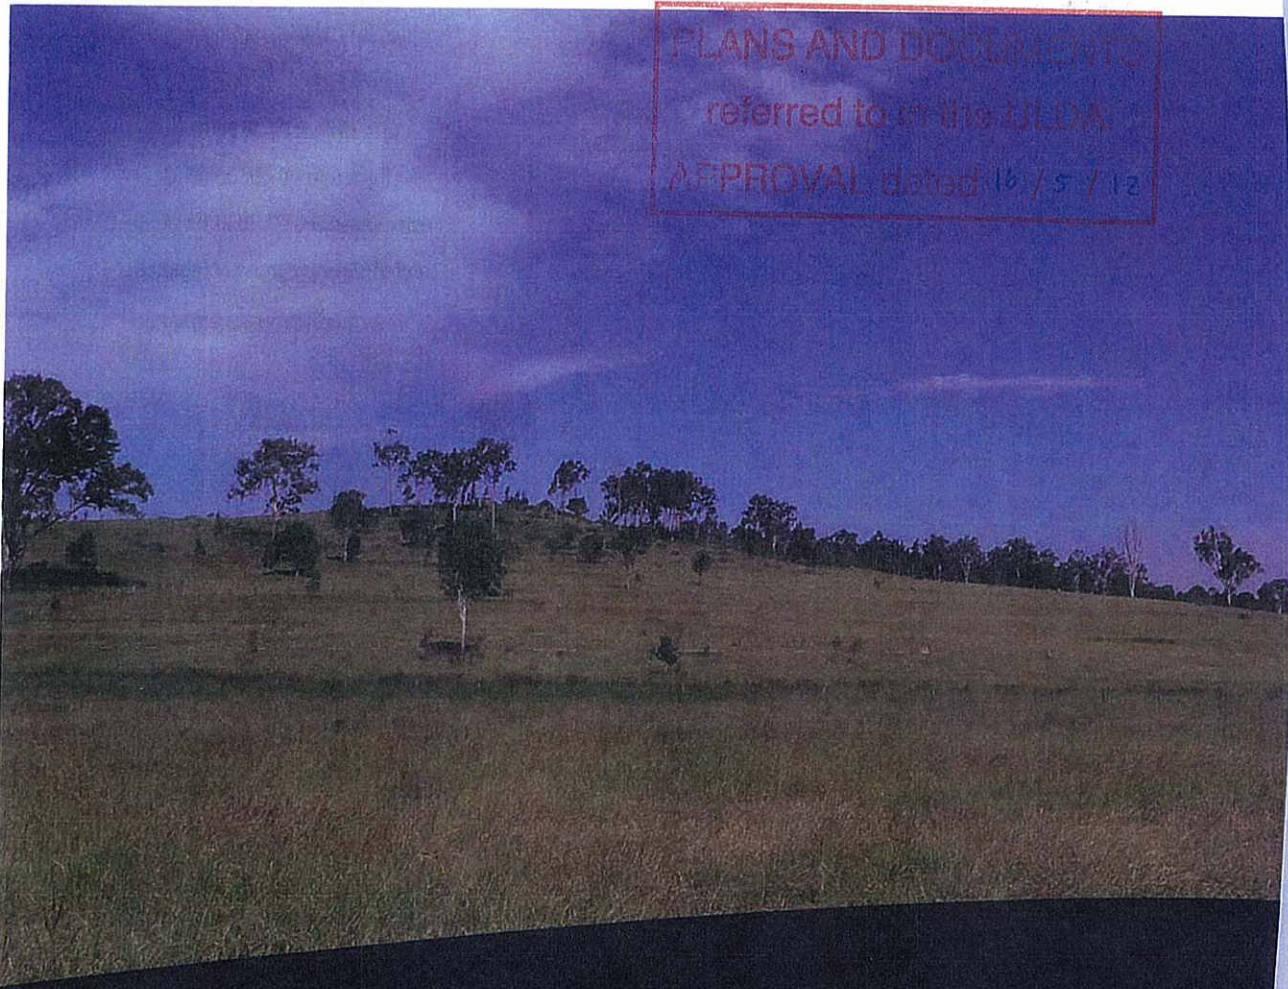

Preliminary Geotechnical Assessment Ripley Valley – Secondary Urban Centre East

Job Number 9268gs.10
Prepared for Amex Corporation
Date of Report 5 February 2010



ABN 74 128 806 735

7/98 Anzac Avenue Hillcrest

Queensland 4118 Australia

Telephone: 07 3800 6446



Facsimile: 07 3800 0816

International: +61 7 3800 6446

cardnobowler@cardno.com.au

www.cardnobowler.com.au

Document Control

Version	Date	Author		Reviewer	
Draft	5 February 2010	Gary Samuels		David Stirling	
1	10 February 2010	Gary Samuels		David Stirling	

"© 2010 Cardno Bowler Pty Ltd All Rights Reserved. Copyright in the whole and every part of this document belongs to Cardno Bowler Pty Ltd and may not be used, sold, transferred, copied or reproduced in whole or in part in any manner or form or in or on any media to any person without the prior written consent of Cardno Bowler Pty Ltd."

Table of Contents

1	INTRODUCTION.....	1
2	SITE DESCRIPTION.....	2
3	INVESTIGATION WORK.....	4
3.1	Laboratory Testing.....	4
4	SUBSURFACE CONDITIONS.....	5
4.1	Subsurface Strata.....	5
4.2	Laboratory Test Results.....	6
5	GEOTECHNICAL ASSESSMENT	7
5.1	Earthworks.....	7
5.2	Batter Slopes for Benching.....	9
5.3	Pump Station Footings	9
6	CONSTRUCTION INSPECTIONS.....	11
7	CONCLUSIONS AND RECOMMENDATIONS	12

List of Tables

Table 1: Summary of Subsurface Strata.....	5
Table 2: Maximum Unprotected Batter Slopes	9
Table 3: Geotechnical Parameters for Bored Piles.....	9

List of Figures

Figure 1 Site Investigation Location Plan

Information Sheets

General Notes

General Guidelines for Hillside Construction

Important Information About Your Geotechnical Engineering Report

List of Annexes

Annex A Fieldwork Results and Photographs of Rock Core

Annex B Laboratory Test Results

1 INTRODUCTION

A geotechnical investigation was carried out for a proposed township development at Bayliss Road, Ripley, as requested by Cardno (Qld) Pty Ltd on behalf of Amex Corporation.

We understand the project involves development of a township including residential dwellings, shopping centre, school etc. At this stage of the assessment some preliminary geotechnical information is required for planning purposes. This will involve the investigation of cut material at 3 proposed borrow areas; the assessment of subsurface conditions at 2 sub storage lagoon sites; the investigation at a proposed pump station and assessment of subsurface conditions at 4 sites that are likely to require some benching.

At the borrow pit areas, cuts of up to 8.5m may occur but in all likelihood are expected to be in the order of 6m.

The cuts in the areas that may require some benching are not expected to exceed 4 metres.

The subsurface storage lagoons are expected to be in the order of 3 to 4 metres deep.

Details on the proposed earthworks at the pump station location nor the building load were not known at the time of the preparation of this report.

The objectives of the investigation, as per our estimate E6544-A:10 dated 25 January 2010, were as follows:

- Determine the nature and certain engineering parameters of subsurface strata.
- Assess the allowable bearing capacity and moisture reactivity of the subsurface strata to allow the selection and design of a suitable footing system for the proposed pump station.
- Consider the excavatability of material to be cut from the higher areas of the site and its suitability for use as fill.
- Provide stable unprotected batter angles for predominate soil types encountered during the investigation.

This report must be read in conjunction with our attached 'General Notes', the ASFE publication 'Important Information About Your Geotechnical Engineering Report' and 'Guidelines for Hillside Construction', Australian Geomechanics Society Journal, Volume 37, No. 2, May 2002.

2 SITE DESCRIPTION

The site was irregular in shape and comprised of well grassed undulating pastoral land with small to tall trees scattered throughout.

Two residential dwellings with ancillary sheds were noted on site. Numerous timber fences and a stockyard were also observed as well as several areas of rock outcrop.

The site was bound by rural land to the north, south and east, and by Ripley Road to the west. Barrams Road bisected the site in a west-east direction, with the proposed Abrahams Road to bisect the site in a north-south direction whilst Bayliss Road was located in the southern quarter of the site. The extension to the Centenary Highway is proposed to be constructed along the northern boundary of the site.

Refer to Plates 1 to 3 for typical site conditions encountered during our investigation.

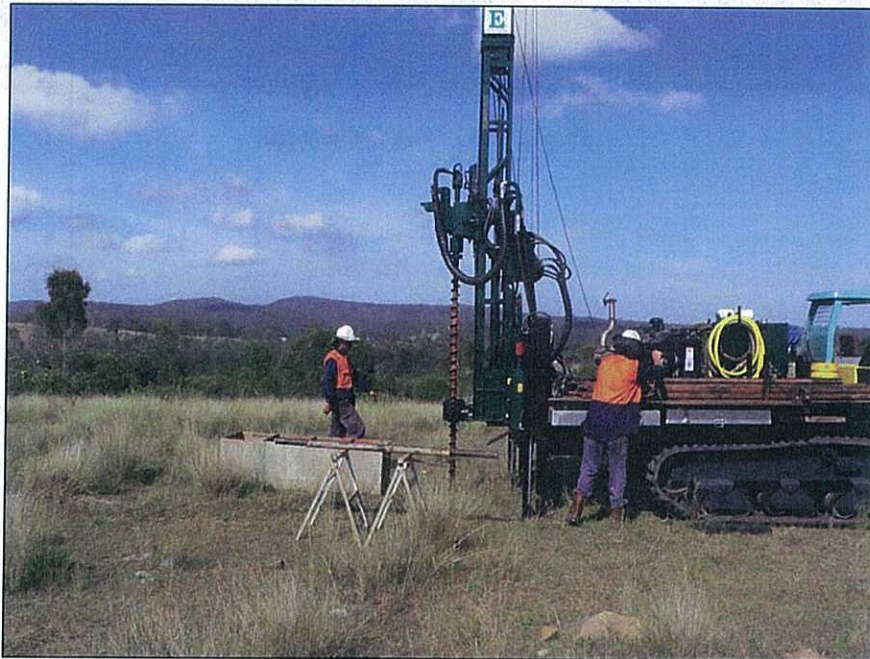


PLATE 1: TYPICAL SITE VIEW SHOWING DRILL RIG IN OPERATION



PLATE 2: TYPICAL SITE VIEW



PLATE 3: TYPICAL SITE VIEW

3 INVESTIGATION WORK

Fieldwork

Fieldwork for the investigation was carried out between the 27 and 28 January 2010 and included the drilling of the following:

Borrow Area

- 3 boreholes (1 at each proposed borrow area) were drilled to a depth of 7.5m or 3m into competent weathered rock.
- Rock coring was undertaken in each borehole for use in our rippability assessment.

Subsurface Storage Lagoons

- 2 boreholes (1 at each tank site) were drilled to 6m.

Benched Area

- 4 boreholes (1 at each bench area) were drilled to refusal.

Pump Station

- 1 borehole was drilled to a depth of 6m.

Borehole locations are shown on the attached site plan, Figure 1. The material encountered at each location is described on borehole log sheets included in Annex A.

Fieldwork was carried out in accordance with Australian Standard, AS1726-1993 '*Site Investigation Code*'.

3.1 Laboratory Testing

Samples of representative strata were recovered and returned to our NATA accredited soils laboratory. The following tests were carried out on a selected sample;

- Moisture Content
- Particle Size Distribution
- Atterberg Limits
- Linear Shrinkage

The laboratory test results are included in Annex B. Laboratory testing was carried out in accordance with Australian Standard AS1289 '*Laboratory Testing For Engineering Purposes*'.

4 SUBSURFACE CONDITIONS

4.1 Subsurface Strata

The logs in Annex A should be referred to for the detailed description of material encountered at each investigation location. A summary of conditions encountered at each investigation location is detailed in Table 1 below.

Table 1: Summary of Subsurface Strata

Soil Descriptions/Depth (m)					
BH No	Topsoil	Residual Clay Stiff to better	Residual Clayey/ Silty Sand Medium dense or better	Weathered Rock	TD
Benching					
1	0.0-0.1	-	0.1-0.4	0.4-TD	0.8 ^(c)
3	0.0-0.1	-	0.1-1.5	1.5-TD	1.8 ^(c)
4	0.0-0.1	-	0.1-1.3	1.3-TD	1.9 ^(c)
7	0.0-0.1	0.5-1.0	0.1-0.5	1.0-TD	1.5 ^(c)
Lagoon					
2	0.0-0.2	1.0-2.7 4.2-TD	0.2-1.0 2.7-4.2	-	6.0
5	-	0.0-1.2 ^(d) 1.2-TD	-	-	6.0
Pump Station					
6	0.0-0.2	0.2-3.2	3.2-5.7 5.7-TD	-	6.0
Borrow					
8	0.0-0.2	0.2-1.0	-	1.0-TD	6.0 ^(e)
9	0.0-0.1	1.5-3.0	0.1-1.5	3.0-TD	5.2
10	0.0-0.2	1.7-2.3	0.2-1.7	2.3-TD	5.7 ^(e)

NOTES:

- All depths measured in metres below ground level at the time of the investigation between the 27 and 28 January 2010.
- TD = Termination Depth.
- The above termination depths represent 'TC' (tungsten carbide) bit refusal for the drill rig.
- Firm to stiff clay between 0.0-1.2m.
- TC bit refusal at 2.5m. Rock coring carried out to TD.

Groundwater was first encountered at the following locations and depths as shown:

Borehole Location	Depth to Groundwater (m)
BH2	2.7
BH5	1.9
BH6	4.9

4.2 Laboratory Test Results

Laboratory test results are included in Annex B. A summary of laboratory test results is provided in Table 2 below.

Table 2: Classification Test Results

Particle Size Distribution, Atterberg Limits and Linear Shrinkage						
Bore No	Depth (m)	% Sand & Gravel	% Clay & Silt	Liquid Limit (%)	Plasticity Index (%)	Linear Shrinkage (%)
3	1.0-1.1	63	37	34	20	4.5
6 (Pump Station)	0.5-0.6	31	69	41	25	10.5
10	1.0-1.45	58	42	38	21	7.5

5 GEOTECHNICAL ASSESSMENT

5.1 Earthworks

Details on proposed earthwork levels were not known at the time of the preparation of this report.

Site Preparation

All site preparation work should be carried out in accordance with AS3798-2007 *'Guidelines on Earthworks for Commercial and Residential Developments'*.

All soil containing grass and root material should be stripped from the building sites and access areas prior to construction. This material is not considered suitable for use as structural fill but may be stockpiled for possible future landscaping purposes, if required. Stripping depths will generally be in the order of around 0.1m to 0.2m. However, isolated areas may require a deeper stripping depth.

Prior to the placement of any structural fill the site should be proof rolled using a minimum 10 tonne vibrating padfoot roller. Should isolated soft/loose areas be encountered during this process, this material should be removed and replaced with select fill.

Depressions formed by the removal of vegetation should have all disturbed soil cleaned out and be backfilled with compacted select fill material.

Cardno Bowler should be engaged to confirm the suitability of the stripping depth and confirm the adequacy of the newly exposed soil for fill placement.

Borrow Materials

Based on the results of our investigation to date across the proposed borrow areas, 3 major material types are available for use as structural fill, these being, residual light orange pale brown, medium plasticity clay; brown, yellow brown silty/clayey sand and weathered rock.

With the exception of the topsoil stratum, all materials encountered during the investigation are considered acceptable for use as structural fill provided that any pre-treatment (moisture conditioning, removal of oversize), is carried out prior to fill placement.

The residual clay, when used as fill, is likely to react to moisture content variations when placed high in a fill platform, and as such more surface movement is likely. Given this, we would recommend that the clay not be used within the top 1.0m of any fill platform.

The silty/clayey sands and the weathered rock are considered the better source materials for use as structural fill and should be considered for use within the top 1.0m of any structural fill platform.

Structural Fill Placement

To minimise the potential for post compaction volume change due to moisture content variations, any structural clay bearing fill should be placed in loose layers not greater than 200mm thick at a moisture content in the range -2% to +3% of the standard optimum moisture content, and be compacted to a minimum dry density ratio of 95% and 98% standard compaction as per AS1289 5.1.1 for residential and commercial construction respectively.

Measures should be adopted to ensure that this clay fill material is not allowed to dry out prior to the placement of succeeding layers of fill and final covering with building slabs and road pavements.

It is recommended that the placement of all structural fill be inspected, tested and certified by Cardno Bowler to Level 1 requirements, during the earthworks operations to ensure that all fill is placed in a 'controlled manner', in accordance with AS3798-2007.

Where filling is to be carried out over sloping land (slope > 8H:1V), the surface of the natural material should be benched so that the fill can be 'keyed' into the slope, allowing for a good bonding interface between structural fill and the natural. The maximum height of the step must not exceed 0.5m, and the benching must be sloped to ensure free drainage.

Excavatability (Rippability)

No problems should be encountered in excavating the near surface material on site above 'TC' bit limit of the drill rig. Most soils encountered on site should be within the excavation limits of a small dozer (e.g. Cat D6 or similar) in bulk excavations or medium size backhoe (e.g. Case 580 or similar) in trench excavations.

'TC' bit refusal was achieved in BH1, 3, 4 and 7. Refer to Table 1 for depth at which 'TC' bit refusal was achieved. While there is no direct reliable relationship between drilling resistance and excavatability, as a rule of thumb the limit of the 'TC' bit may be taken as indicative of the limit of excavation of a medium sized dozer in bulk excavation (Cat D7E, D8) or a large excavator in trench excavation (Kato or Hymac).

Generally below the 'TC' bit limit, larger excavation equipment, explosives, compressor driven pneumatic tools, or hydraulic rock breakers would be required for excavation.

In the proposed borrow areas, rock coring was undertaken to allow for a more detailed assessment of the rippability of the underlying bedrock.

Based on the analysis of the rock core and the parameters set out as per the 'Weaver Rippability Assessment', we have concluded that the rippability of the bedrock is considered to vary from easy ripping to extremely hard ripping and blasting.

As a guide, easy ripping could be expected in the weathered rock at BH8 (D7) to 5.7m, hard to very hard ripping (D9/D10) in the weathered rock at BH9 to a depth of 5.2m and extremely hard ripping and blasting at BH10 (D10 with shanks and blasting) to a depth of 5.7m.

It should be noted that rippability will also be a function of the orientation of the plant to rock mass discontinuities. Given the site is a large greenfield site, this will allow for greater flexibility of the plant with regards to ripping direction. As such increased rippability could be expected where the plant is ripping along and parallel with joint planes.

Settlement

Based on the results of the investigation undertaken in the lower lying areas of the site, no compressible soils were encountered within any of the boreholes that would indicate significant settlement issues under minimal fill or conventional building loads.

5.2 Batter Slopes for Benching

For initial design purposes, the following maximum unprotected batter slopes may be adopted for the cut and fill batters on the site based on the predominant material types encountered during the investigation.

Table 3: Maximum Unprotected Batter Slopes

Material Type	Short Term (Maximum)	Long Term (Maximum)
Residual Clays (cut)	1V:1H	1V:2H
Residual Sands (cut)	1V:2H	1V:2.5H
Fill Batters ⁽¹⁾	1V:2H	1V:2H
Weathered Rock	1V:1H	*

Notes:

- ⁽¹⁾ All fill batters should be overfilled, compacted and cut back at the maximum angles recommended above and with some form of erosion protection to minimise any potential unnecessary scour effects due to weathering.
- * Denotes requirement for detailed stability assessment.

5.3 Pump Station Footings

Excavation depths and building loads were not known at the time of preparation of this report.

Based on the classification test results, the estimated surface movement of the existing soil profile due to seasonal variations in moisture content is of the order of 20mm to 40mm. This indicates that the site may be classified Class 'M' in accordance with AS2870-1996 'Residential Slabs and Footings' on the basis of shrink/swell potential.

Depending upon structural loads, both high and deep level footings may be appropriate for the structure.

For high level footings, the residual soils on site would provide an allowable bearing capacity of 100kPa.

Should deep level footings be required, alternative deep level footing options would include bored piles, push piles, driven piles and screw in steel piles.

For preliminary design purposes the following parameters may be used.

Table 4: Geotechnical Parameters for Bored Piles

Material Type	Design Equivalent Skin Friction $\phi_g f_s$ (kPa)	Design Equivalent Base Bearing Capacity $\phi_g f_b$ (kPa)
Residual Clay	6	180
Residual Sand at 3.0m	4	200
Residual Sand at 4.0m	5	270
Residual Sand at 5.0m	6	340

Notes:

- a) NR = Not Recommended
- b) Ignore top 1.5m of profile in pile capacity calculations.
- c) The above values were compiled assuming that the pile depth will be at least 5 times that of its pile diameter.
- d) A geotechnical strength reduction factor (ϕ_g) of 0.4 has been applied to the ultimate parameters in the calculation of the above design equivalent capacities.
- e) The geotechnical strength reduction factor could be increased should dynamic or static pile testing be carried out. If this is the case, then Cardno Bowler should be contacted.
- f) Above depths are from site level at the time of the investigation.

6 CONSTRUCTION INSPECTIONS

It is recommended that placement of all structural fill and cut/fill batters be inspected, tested and certified where necessary, by Cardno Bowler Pty Ltd to ensure recommendations made in this report have been adhered to.

Should subsurface conditions other than those described in this report be encountered, Cardno Bowler Pty Ltd should be consulted immediately and appropriate modifications developed and implemented if necessary.

7 CONCLUSIONS AND RECOMMENDATIONS

The following is a summary of the conclusions and recommendations in regard to the preliminary geotechnical investigation for the proposed development of the Secondary Urban Centre East, Ripley Valley. However, the preceding sections of this report should be read for a full description of the conclusions and recommendations.

1. The subsurface conditions, at the investigation locations generally consisted of a veneer of topsoil overlying natural clays which in turn overlaid shallow weathered rock in the high relief areas and topsoil overlying natural clays/sands to depth on the low lying areas of the site.
2. Earthworks should be carried out in accordance with AS3798.2007 '*Guidelines on Earthworks for Commercial and Residential Developments*'. Refer to Section 5.1 for details on recommendations for earthwork operations.
3. In accordance with AS2798-1996, based on existing site conditions at the pump station, this area may be classified as Class 'M'.
4. Refer to Section 5.1 for details on the suitability of materials for use as structural fill and rippability.
5. Refer to section 5.2 for recommendations on maximum unprotected cut/fill batter angles for the site.

Yours faithfully



GARY SAMUELS
PRINCIPAL



DAVID STIRLING
SENIOR GEOTECHNICAL ENGINEER



KEY



APPROX. BOREHOLE LOCATION

NOT TO SCALE

SITE INVESTIGATION LOCATIONS

PROPOSED TOWNSHIP DEVELOPMENT

BARRAMS & BAYLISS ROADS, SOUTH RIPLEY

**Cardno
Bowler**
E-mail: cardnobowler@cardno.com.au
Also at : Gold Coast, Ipswich, Geelong, Sunshine Coast, Bundaberg, Rockhampton, Mackay,
Moranbah, Townsville, Cairns, Sydney, Melbourne, Geelong and Bendigo (Vic).
Associated Offices in Perth, Vietnam and Papua New Guinea.

7/98 Anzac Avenue
HILLCREST QLD 4118
Telephone 3800 6446
Facsimile 3800 0816

JOB NO.:

9268

FIGURE 1

GENERAL NOTES



**Cardno
Bowler**

Shaping the Future

April 2005

GENERAL

This report comprises the results of an investigation carried out for a specific purpose and client as defined in the introduction section(s) of the document. The report should not be used by other parties or for other purposes as it may not contain adequate or appropriate information.

Cardno Bowler Pty Ltd
ABN 74 128 806 735

7/98 Anzac Avenue
Hillcrest Queensland 4118
Australia

Telephone: 07 3800 6446

Facsimile: 07 3800 0816

International: +61 7 3800 6446

cardnobowler@cardno.com.au

www.cardno.com.au

TEST HOLE LOGGING

The information on the Test Hole Logs (Boreholes, Backhoe Pits, Exposures etc.) has been based on a visual and tactile assessment except at the discrete locations where test information is available (field and/or laboratory results).

Reference should be made to our standard sheets for the definition of our logging procedures (Soil and Rock Descriptions).

GROUNDWATER

Unless otherwise indicated the water levels given on the test hole logs are the levels of free water or seepage in the test hole recorded at the given time of measuring. The actual groundwater level may differ from this recorded level depending on material permeabilities. Further variations of this level could occur with time due to such effects as seasonal and tidal fluctuations or construction activities. Final confirmation of levels can only be made by appropriate instrumentation techniques and programmes.

INTERPRETATION OF RESULTS

The discussion and recommendations contained within this report are normally based on a site evaluation from discrete test hole data. Generalised or idealised subsurface conditions (including any cross-sections contained in the report) have been assumed or prepared by interpolation/extrapolation of these data. As such these conditions are an interpretation and must be considered as a guide only.

CHANGE IN CONDITIONS

Local variations or anomalies in the generalised ground conditions used for this report can occur, particularly between discrete test hole locations. Furthermore, certain design or construction procedures may have been assumed in assessing the soil structure interaction behaviour of the site.

Any change in design, in construction methods, or in ground conditions as noted during construction, from those assumed in this report should be referred to this firm for appropriate assessment and comment.

FOUNDATION DEPTH

Where referred to in the report, the recommended depth of any foundation (piles, caissons, footings, etc.) is an engineering estimate of the depth to which they should be constructed. The estimate is influenced and perhaps limited by the fieldwork method and testing carried out in connection with the site investigation, and other pertinent information as has been made available. The depth remains, however, an estimate and therefore liable to variation. Footing drawings, designs and specifications based upon this report should provide for variations in the final depth depending upon the ground conditions at each point of support.

REPRODUCTION OF REPORTS

Where it is desired to reproduce the information contained in this report for the inclusion in the contract documents or engineering specification of the subject development, such reproduction should include at least all the relevant test hole and test data, together with the appropriate standard description sheets and remarks made in the written report of a factual or descriptive nature.

This report is the subject of copyright and shall not be reproduced either totally or in part without the express permission of this firm.

Cardno Bowler Offices

Queensland

Brisbane
Cairns
Townsville
Mackay
Moranbah
Rockhampton
Bundaberg
Sunshine Coast
Geebung
Ipswich
Gold Coast

New South Wales

Sydney

Victoria

Melbourne
Bendigo
Dandenong
Geelong



WORLD RECOGNISED
ACCREDITATION



ASSOCIATION OF CONSULTING
ENGINEERS AUSTRALIA
MEMBER



CARDNO GROUP

Brisbane Sydney Canberra Melbourne Perth Darwin Regional

Belgium Brussels Indonesia Jakarta Kenya Nairobi New Zealand Auckland Christchurch Wellington

Papua New Guinea Port Moresby Sri Lanka Colombo United Arab Emirates Abu Dhabi United Kingdom London

United States of America Portland Washington Phoenix Sacramento Boise Las Vegas Charlotte

SOME GUIDELINES FOR HILLSIDE CONSTRUCTION

GOOD ENGINEERING PRACTICE

POOR ENGINEERING PRACTICE

ADVICE

GEOTECHNICAL ASSESSMENT	Obtain advice from a qualified, experienced geotechnical consultant at early stage of planning and before site works.	Prepare detailed plan and start site works before geotechnical advice.
--------------------------------	---	--

PLANNING

SITE PLANNING	Having obtained geotechnical advice, plan the development with the risk arising from the identified hazards and consequences in mind.	Plan development without regard for the Risk.
----------------------	---	---

DESIGN AND CONSTRUCTION

HOUSE DESIGN	Use flexible structures which incorporate properly designed brickwork, timber or steel frames, timber or panel cladding. Consider use of split levels. Use decks for recreational areas where appropriate.	Floor plans which require extensive cutting and filling. Movement intolerant structures.
SITE CLEARING	Retain natural vegetation wherever practicable.	Indiscriminately clear the site.
ACCESS & DRIVEWAYS	Satisfy requirements below for cuts, fills, retaining walls and drainage. Council specifications for grades may need to be modified. Driveways and parking areas may need to be fully supported on piers.	Excavate and fill for site access before geotechnical advice.
EARTHWORKS	Retain natural contours wherever possible.	Indiscriminate bulk earthworks.
CUTS	Minimise depth. Support with engineered retaining walls or batter to appropriate slope. Provide drainage measures and erosion control.	Large scale cuts and benching. Unsupported cuts. Ignore drainage requirements
FILLS	Minimise height. Strip vegetation and topsoil and key into natural slopes prior to filling. Use clean fill materials and compact to engineering standards. Batter to appropriate slope or support with engineered retaining wall. Provide surface drainage and appropriate subsurface drainage.	Loose or poorly compacted fill, which if it fails, may flow a considerable distance including onto property below. Block natural drainage lines. Fill over existing vegetation and topsoil. Include stumps, trees, vegetation, topsoil, boulders, building rubble etc in fill.
ROCK OUTCROPS & BOULDERS	Remove or stabilise boulders which may have unacceptable risk. Support rock faces where necessary.	Disturb or undercut detached blocks or boulders.
RETAINING WALLS	Engineer design to resist applied soil and water forces. Found on rock where practicable. Provide subsurface drainage within wall backfill and surface drainage on slope above. Construct wall as soon as possible after cut/fill operation.	Construct a structurally inadequate wall such as sandstone flagging, brick or unreinforced blockwork. Lack of subsurface drains and weepholes.
FOOTINGS	Found within rock where practicable. Use rows of piers or strip footings oriented up and down slope. Design for lateral creep pressures if necessary. Backfill footing excavations to exclude ingress of surface water.	Found on topsoil, loose fill, detached boulders or undercut cliffs.
SWIMMING POOLS	Engineer designed. Support on piers to rock where practicable. Provide with under-drainage and gravity drain outlet where practicable. Design for high soil pressures which may develop on uphill side whilst there may be little or no lateral support on downhill side.	
DRAINAGE SURFACE	Provide at tops of cut and fill slopes. Discharge to street drainage or natural water courses. Provide general falls to prevent blockage by siltation and incorporate silt traps. Line to minimise infiltration and make flexible where possible. Special structures to dissipate energy at changes of slope and/or direction.	Discharge at top of fills and cuts. Allow water to pond on bench areas.
SUBSURFACE	Provide filter around subsurface drain. Provide drain behind retaining walls. Use flexible pipelines with access for maintenance. Prevent inflow of surface water.	Discharge roof runoff into absorption trenches.
SEPTIC & SULLAGE	Usually requires pump-out or mains sewer systems; absorption trenches may be possible in some areas if risk is acceptable. Storage tanks should be water-tight and adequately founded.	Discharge sullage directly onto and into slopes. Use absorption trenches without consideration of landslide risk.
EROSION CONTROL & LANDSCAPING	Control erosion as this may lead to instability. Revegetate cleared area.	Failure to observe earthworks and drainage recommendations when landscaping.

DRAWINGS AND SITE VISITS DURING CONSTRUCTION

DRAWINGS	Building Application drawings should be viewed by geotechnical consultant	
SITE VISITS	Site Visits by consultant may be appropriate during construction/	

INSPECTION AND MAINTENANCE BY OWNER

OWNER'S RESPONSIBILITY	Clean drainage systems; repair broken joints in drains and leaks in supply pipes. Where structural distress is evident see advice. If seepage observed, determine causes or seek advice on consequences.	
-------------------------------	--	--

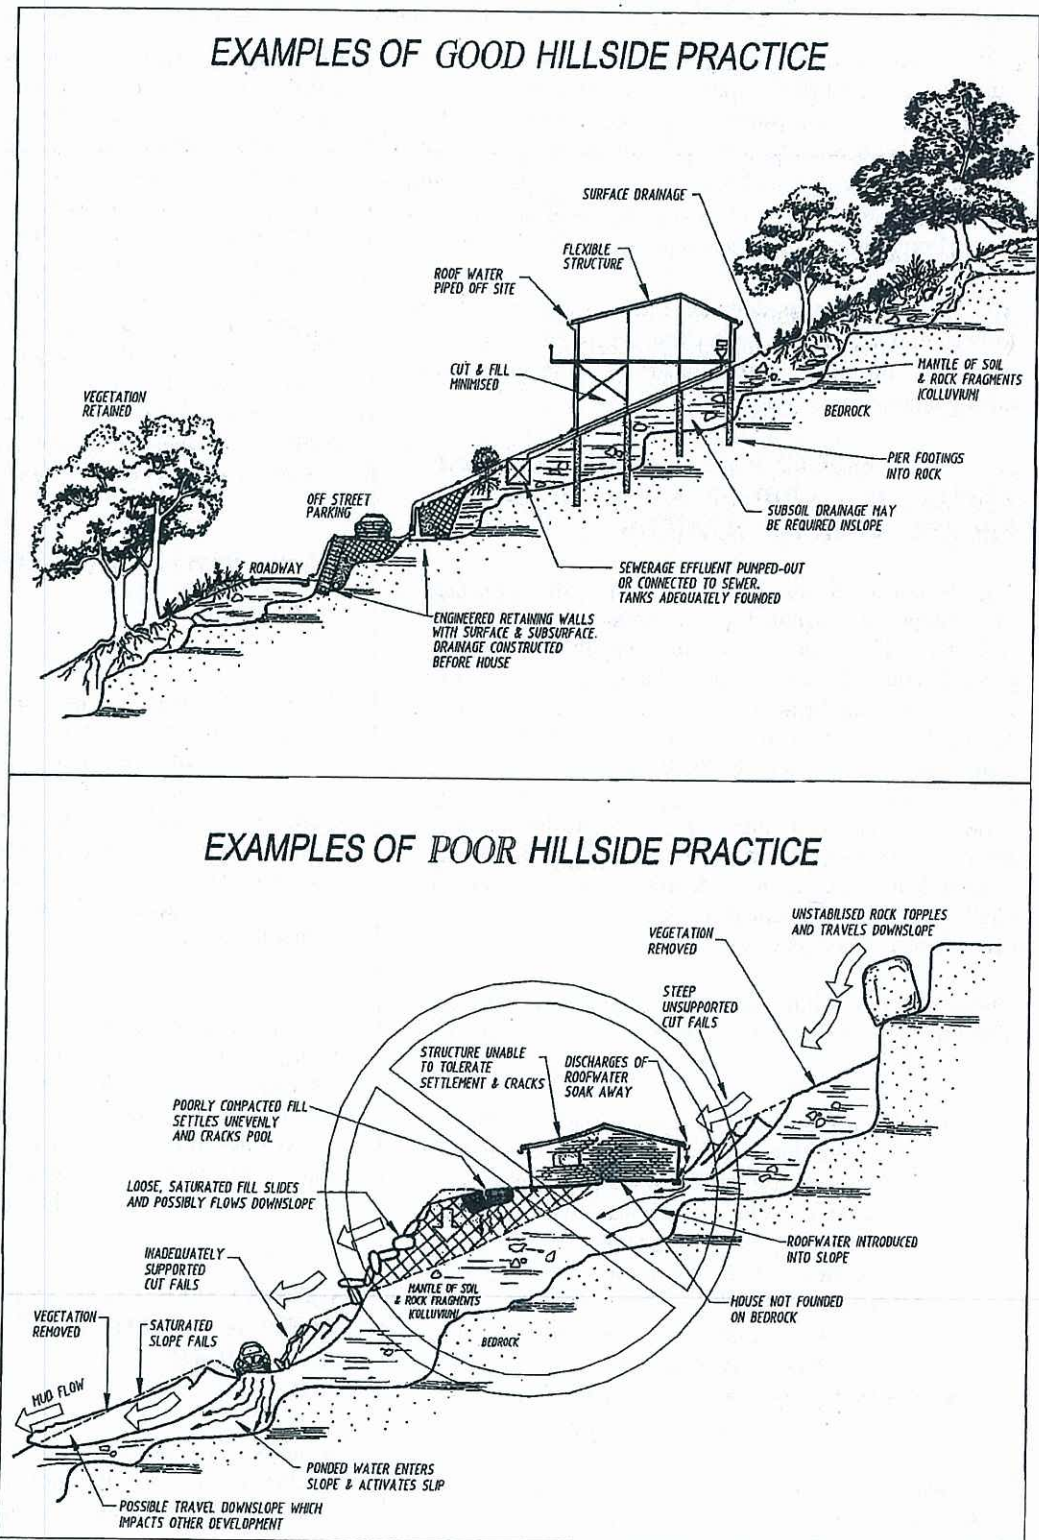


FIGURE J1: Illustrations of Good and Poor Hillside Practice

IMPORTANT INFORMATION ABOUT YOUR GEOTECHNICAL ENGINEERING REPORT

More construction problems are caused by site subsurface conditions than any other factor. As troublesome as subsurface problems can be, their frequency and extent have been lessened considerably in recent years, due in large measure to programs and publications of ASFE / The Association of Engineering Firms Practicing in the Geosciences.

The following suggestions and observations are offered to help you reduce the geotechnical-related delays cost-overruns and other costly headaches that can occur during a construction project.

A GEOTECHNICAL ENGINEERING REPORT IS BASED ON A UNIQUE SET OF PROJECT-SPECIFIC FACTORS

A geotechnical engineering report is based on subsurface exploration plan designed to incorporate a unique set of project-specific factors. These typically include the general nature of the structure involved, its size and configuration; the location of the structure on the site and its orientation; physical concomitants such as access roads, parking lots and underground utilities, and the level of additional risk which the client assumed by virtue of limitations imposed upon the exploratory program. To help avoid costly problems, consult the geotechnical engineer to determine how any factors which change subsequent to the date of the report may affect its recommendations.

Unless your consulting geotechnical engineer indicates otherwise, *your geotechnical engineering report should not be used:*

- When the nature of the proposed structure is changed, for example, if an office building will be erected instead of a parking garage, or if a refrigerated warehouse will be built instead of an unrefrigerated one;
- when the size or configuration of the proposed structure is altered;
- when the location or orientation of the proposed structure is modified;
- when there is a change of ownership, or
- for application to an adjacent site.

Geotechnical engineers cannot accept responsibility for problems which may develop if they are not consulted after factors considered in their report's development have changed.

MOST GEOTECHNICAL "FINDINGS" ARE PROFESSIONAL ESTIMATES

Site exploration identifies actual subsurface conditions only at those points where samples are taken, when they are taken. Data derived through sampling and subsequent testing are extrapolated by geotechnical engineers who then render an opinion about overall subsurface conditions, their likely reaction to proposed construction activity and appropriate foundation design.

Even under optimal circumstances actual conditions may differ from those inferred to exist, because no geotechnical engineer, no matter how qualified, and no subsurface exploration program, no matter how comprehensive, can reveal what is hidden by earth, rock and time. The actual interface between materials may be far more gradual or abrupt than a report indicates. Actual conditions in areas not sampled may differ from predications. *Nothing can be done to prevent the unanticipated, but steps can be taken to help minimise their impact.* For this reason, *most experienced owners retain their geotechnical consultants through the construction stage, to identify variances, conduct additional tests which may be needed, and to recommend solutions to problems encountered on site.*

SUBSURFACE CONDITIONS

CAN CHANGE

Subsurface conditions may be modified by constantly changing natural forces. Because a geotechnical engineering report is based on conditions which existed at the time of subsurface exploration, *construction decisions should not be based on a geotechnical engineering report whose adequacy may have been affected by time.* Speak with the geotechnical consultant to learn if additional tests are advisable before construction starts.

Construction operations at or adjacent to the site and natural events such as floods, earthquakes or groundwater fluctuations may also affect subsurface conditions and thus, the continuing adequacy of a geotechnical report. The geotechnical engineer should be kept apprised of any such events, and should be consulted to determine if additional test are necessary.

GEOTECHNICAL SERVICES ARE PERFORMED FOR SPECIFIC PURPOSES AND PERSONS

Geotechnical engineers' reports are prepared to meet the specific needs of specific individuals. A report prepared for a consulting civil engineer may not be adequate for a construction contractor, or even some other consulting civil engineer. Unless indicated otherwise, this report was prepared expressly for the client involved and expressly for purposes indicated by the client. Use by any other persons for any purpose, or by the client for a different purpose, may result in problems. *No individual other than the client should apply this report for its intended purpose without first conferring with the geotechnical engineer. No person should apply this report for any purpose other than that originally contemplated without first conferring with the geotechnical engineer.*

A GEOTECHNICAL ENGINEERING REPORT IS SUBJECT TO MISINTERPRETATION

Costly problems can occur when other design professionals develop their plans based on misinterpretations of a geotechnical engineering report. To help avoid these problems, the geotechnical engineer should be retained to work with other appropriate design professionals to explain relevant geotechnical findings and to review the adequacy of their plans and specifications relative to geotechnical issues.

BORING LOGS SHOULD NOT BE SEPARATED FROM THE ENGINEERING REPORT

Final boring logs are developed by geotechnical engineers based upon their interpretation of field logs (assembled by site personnel) and laboratory evaluation of field samples. Only final boring logs customarily are included in geotechnical engineering reports. *These logs should not under any circumstances be redrawn* for inclusion in architectural or other design drawings, because drafters may commit errors or omissions in the transfer process. Although photographic reproduction eliminates this problem, it does nothing to minimize the possibility of contractors misinterpreting the logs during bid preparation. When this occurs, delays, disputes and unanticipated costs are the all-too-frequent result.

To minimize the likelihood of boring log misinterpretation, *give contractors ready access to the complete geotechnical engineering report* prepared or authorized for their use*. Those who do not provide such access may proceed under the *mistaken* impression that simply disclaiming

* For further information on this aspect reference should be made to "Guidelines for the Provision of Geotechnical Information in Construction Contracts" published by The Institution of Engineers Australia, National Headquarters, Canberra, 1987.

responsibility for the accuracy of subsurface information always insulates them from attendant liability. Providing the best available information to contractors helps prevent costly construction problems and the adversarial attitudes which aggravate them to disproportionate scale.

READ RESPONSIBILITY CLAUSES CLOSELY

Because geotechnical engineering is based extensively on judgment and opinion, it is far less exact than other design disciplines. This situation has resulted in wholly unwarranted claims being lodged against geotechnical consultants. To help prevent this problem, geotechnical engineers have developed model clauses for use in written transmittals. These are *not* exculpatory clauses designed to foist geotechnical engineers' liabilities onto someone else. Rather, they are definitive clauses which identify where geotechnical engineers' responsibilities begin and end. Their use helps all parties involved recognize their individual responsibilities and take appropriate action. Some of these definitive clauses are likely to appear in your geotechnical engineering report, and you are encouraged to read them closely. Your geotechnical engineer will be pleased to give full and frank answers to your questions.

OTHER STEPS YOU CAN TAKE TO REDUCE RISK

Your consulting geotechnical engineer will be pleased to discuss other techniques which can be employed to mitigate risk. In addition, ASFE has developed a variety of materials which may be beneficial. Contact ASFE for a complimentary copy of its publications directory.

Published by

ASFE

**THE ASSOCIATION
OF ENGINEERING FIRMS
PRACTICING IN THE GEOSCIENCES**

8811 Colesville Road / Suite G106 / Silver Spring Maryland 20910/(301) 565-2733

Annex A

Fieldwork Results and Photographs of Rock Core

September, 2001

SOIL DESCRIPTION

This procedure involves the description of a soil in terms of its visual and tactile properties, and relates to both laboratory samples and field exposures as applicable. A detailed soil profile description, in association with local geology and experience, will facilitate the initial (and often complete) site assessment for engineering purposes.

The method involves an evaluation of each of the items listed below and is in general agreement with the Site Investigation Code AS1726-1993.

SOIL TYPE

The soil is described on the basis of the grain size composition of the constituent particles, and the plasticity of the fraction of material passing the 425µm sieve.

Furthermore, as most natural soils are part combinations of various constituents, the primary soil is described and modified by minor components. In brief, the system is as follows;

SILT OR CLAY AS MINOR COMPONENT		GRAVEL OR SAND AS MINOR COMPONENT	
% Fines	Modifier	% Coarse	Modifier
≤5	omit, or use "trace"	≤15	omit, or use "trace"
>5 ≤12	describe as "with clay/silt" as applicable	>15 ≤30	describe as "with sand/gravel" as applicable
>12	prefix soil as "silty/clayey" as applicable	>30	prefix soil as "sandy/gravelly" as applicable

Note: For soils containing both sand and gravel the minor coarse fraction is omitted if less than 15%, or described as "with sand/gravel" as applicable when greater than 15%.

The appropriate classification group symbol for soil classification is also given before the soil type description in accordance with AS1726-1993, Table A1.

For granular soils, an assessment of grading (well, uniform, gap or poor), particle size (fine, medium etc), angularity, shape and particle composition may also be given.

COLOUR

Colour is important for correlation of data between test holes and for subsequent excavation operations. The prominent colour is noted, followed by (spotted, mottled, streaked etc.) secondary colours as applicable. Colour should be described in the "moist" condition, though both wet and dry colours may also be appropriate.

MOISTURE

The moisture condition of the soil is described by the appearance and feel of the soil using one of the following terms:

Dry cohesive soils - hard, friable or powdery; granular soils - cohesionless, free funning.
 Moist soil cool, darkened colour: cohesive soils - can be moulded; granular soils - tend to cohere.
 Wet soil cool, darkened colour: cohesive soils - usually weakened, free water on hands when handling; granular soils - tend to cohere.

In addition, the presence of any seepage or free water is noted on all test hole logs.

CONSISTENCY/RELATIVE DENSITY

Granular soils are generally described in terms of relative density (density index) as listed in Table A5 AS1726. These soils are inherently difficult to assess and normally a penetration test procedure (SPT, DCP or CPT) is used in conjunction with published correlation tables. Alternatively, insitu density tests can be conducted in association with minimum and maximum densities performed in the laboratory.

Cohesive soils can be assessed by direct measurement (shear vane), or estimated approximately by tactile means and/or the aid of a geological pick as given on the following table. It is emphasised that a "design shear strength" must take cognisance of the insitu moisture content and the possible variations of moisture with time.

Term	Tactile Properties	Undrained Shear Strength (kPa)
Very Soft	Exudes between the fingers when squeezed in the hand.	≤12
Soft	Easily penetrated by thumb about 30-40mm. Pick head can be pushed in up to shaft. Moulded by light finger pressure.	>12 ≤25
Firm	Penetrated by thumb 20-30mm with moderate effort. Sharp end of pick pushed in some 30-40mm. Moulded by strong finger pressure.	>25 ≤50
Stiff	Indented by thumb about 4mm with moderate effort. Pick pushed in up to 10mm. Cannot be moulded in fingers.	>50 ≤100
Very Stiff	Readily indented by thumb nail. Slight indentation produced by pushing pick into soil.	>100 ≤200
Hard	Difficult to indent with thumb nail. Requires power tools for excavation.	>200

STRUCTURE/OTHER FEATURES

The structure of the soil may be described with reference to: zoning, where soils consist of separate zones differing in colour, grain size or other properties; defects, including fissures, cracks, root-holes and the like; cementing, with the strength (weakly to strongly), and nature of the cementing agent; additional observations including geological origin, odour and the like. In addition, the presence of other features (ferrirete nodules, organic inclusions) should also be noted as applicable.

September, 2001

ROCK DESCRIPTION

This method is based on AS1726 (1993) Appendix A. The procedure involves a visual and tactile assessment of the rock mass and the nature of defects in order to facilitate a prediction of engineering behaviour.

DESCRIPTION: Rock Type is described on the basis of bedded (mostly sedimentary), foliated (mostly metamorphic) and rocks with massive structure and crystalline texture (mostly igneous), with the common types listed below. Rocks are generally in order of decreasing grain size down the table.

	Bedded		Foliated	Massive
	≥50% carbonate grains	≥50% fine grained volcanic rock grains		
conglomerate sandstone siltstone mudstone shale claystone	limestone dolomite chalk	agglomerate volcanic breccia tuff	gneiss schist slate phyllite	granite gabbro basalt rhyolite andesite

GRAIN SIZE: refers to the average dimension of the material or rock fragments comprising the rock.

TEXTURE & FABRIC: refer to the individual grains and the arrangement of grains respectively. Textural terms frequently used include porphyritic, crystalline, cryptocrystalline, granular, amorphous and glassy.

COLOUR: is given to assist in rock identification and the interpretation of field data. Colour should be described in the moist condition, though both wet and dry colours may also be appropriate.

ESTIMATED STRENGTH: This refers to the strength of the rock substance and not that of the rock mass. The strength of the rock substance is estimated by the Point Load Strength Index I_p (50) and refers to the strength measured in the direction normal to the bedding for sedimentary rocks. A field guide is given below:

Term	Symbol	I_p (50) MPa	Field Guide (The Core refers to a 150mm x 50mm diameter sample)
Extremely Low	EL	≤0.03	Remoulded by hand to a material with soil properties.
Very Low	VL	>0.3 ≤0.1	Material crumbles under firm blows with sharp end of pick. Can be peeled with knife.
Low	L	>0.1 ≤0.3	The core may be broken by hand and easily scored with a knife. Sharp edges or core may be friable and break during handling.
Medium	M	>0.3 ≤1.0	The core may be broken by hand with considerable difficulty. Readily scored with knife.
High	H	>1.0 ≤3.0	Core can be broken by pick with a single firm blow, but not by hand. Rock rings under hammer.
Very High	VH	>3.0 ≤10.0	Hand specimen breaks with pick after more than one blow. Rock rings under hammer.
Extremely High	EH	>10.0	The core is difficult to break with geological pick. Rings when struck with hammer.

WEATHERING: The assignment of weathering is somewhat subjective. Weathering assists identification but does not imply engineering behaviour. No distinction is drawn between chemical weathering and alteration for most engineering purposes. These procedures are collectively described as "weathering" using the following terms which do not describe the related strength change. Carbonate rocks generally do not conform to this classification.

Term	Symbol	Definition
Residual Soil	RS	Soil developed on XW rock; mass structure and substance fabric no longer evident.
Extremely Weathered Rock	XW	The rock exhibits soil-like properties though the texture of the original rock is still evident.
Distinctly Weathered Rock	DW	Rock strength usually changed by weathering. Rock may be highly discoloured.
Slightly Weathered Rock	SW	Rock is slightly discoloured but shows little or no change of strength from fresh rock.
Fresh Rock	F	Rock shows no sign of decomposition or staining.

STRUCTURE: is concerned with the larger scale inter-relationship of textural features. Common terms include: - Sedimentary rocks - bedded, laminated; Metamorphic rocks - foliated, banded, cleaved; Igneous rocks - massive, flow banded.

DEFECTS: This important feature can control the overall engineering behaviour of a rock mass. All types of natural fractures across which the core is discontinuous are noted. These fractures include bedding plane partings, joints and other defects but exclude artificial fractures such as drilling breaks. The nature of the defects (joints, partings, seams, zones and veins) is also noted with description, orientation, infilling or coating, shape, roughness, thickness, etc. given generally in accordance with AS1726 Table A10. The spacing of natural fractures excludes bedding partings unless there is evidence that they were separated prior to drilling. This notwithstanding, bedding partings may be considered as points of weakness in an engineering assessment.

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd Project: Proposed Township Development Location: Bayliss Road, South Ripley					Hole No: BH1 Sheet: 1 of 1	
Position: Refer Site Sketch Figure 1 Rig Type: Q Drill 3000 Casing Diameter:			Job No: 9268 Bit: Contractor: Cardno (Qld) Pty Ltd		Angle from Horizontal: 90° Surface Elevation: Driller: DL	
Date Started : 27/1/10		Date Completed: 27/1/10		Logged By: DL		
Date Logged: 27/1/10						

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5								8 14 12 14 >20			SM SC-SM XW	SILTY SAND, fine to coarse grained sand, grey, dry, medium dense, some grass roots, TOPSOIL SILTY SAND/CLAYEY SAND, fine to coarse grained sand, small lumps of clay, pale brown cream, grey, dry, very stiff, NATURAL SANDSTONE
1.0												TC BIT REFUSAL BOREHOLE TERMINATED AT 0.80 m
1.5												
2.0												
2.5												
3.0												
3.5												

See Standard Sheets for details of abbreviations & basis of descriptions		Cardno Bowler 7/98 Anzac Ave HILLCREST QLD 4118 PH: (07) 3800 6446 FAX: (07) 3800 0816
--	--	--

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH2

Job No: 9268

Sheet: 1 of 2

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Q Drill 3000

Bit:

Driller: DL

Casing Diameter:

Contractor: Cardno (Qld) Pty Ltd

Date Started : 27/1/10

Date Completed: 27/1/10

Logged By: DL

Date Logged: 27/1/10

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5											SM	SILTY SAND, fine to medium grained, gye, medium plasticity fines, some clay, dry, loose, TOPSOIL
						D 0.10 - 0.20 m		7				
								7				
								5				
								8				
								11				
								10				
								15				
								13				
								11				
								8				
1.0						D 1.00 - 1.10 m		10			CI	SILTY SANDY CLAY, medium plasticity, grey, mottled pale brown, fine to coarse grained sand, moist, very stiff, NATURAL
								7				
								9				
								10				
								12				
								13				
								11				
								8				
								8				
2.0						D 1.90 - 2.00 m		7			CI-CH	SILTY SANDY CLAY, high plasticity, dark grey mottled brown, fine to coarse grained sand, moist, stiff to very stiff, NATURAL
								6				
								7				
								7				
								9				
								9				Becoming light brown mottled grey, moist to wet
								12				
								14				
2.5						D 2.70 - 2.80 m		12			SP	SAND, poorly graded, fine to coarse grained, very pale brown grey, sub angular grains, some silt, wet, dense, NATURAL
								13				
								11				
								12				
								14				
								18				
3.0												
3.5												

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

Client: Cardno (Qld) Pty Ltd Project: Proposed Township Development Location: Bayliss Road, South Ripley		Hole No: BH2 Sheet: 2 of 2	
Position: Refer Site Sketch Figure 1 Rig Type: Q Drill 3000 Casing Diameter:		Job No: 9268 Angle from Horizontal: 90° Bit: Contractor: Cardno (Qld) Pty Ltd Date Started : 27/1/10 Date Completed: 27/1/10 Logged By: DL Date Logged: 27/1/10	
Date Started : 27/1/10 Date Completed: 27/1/10 Logged By: DL Date Logged: 27/1/10			
Depth (m) Auger "V" Bit Auger "C" Bit Washbore Casing Coring Groundwater (m)		Sample or Field Test Recovered DCP RL (m AHD) Graphic Log USCS Symbol Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)	
-4.5 -5.0 -5.5 -6.0 -6.5 -7.0 -7.5		SAND, poorly graded, fine to coarse grained, very pale brown grey, sub angular grains, some silt, wet, dense, NATURAL SILTY CLAY, high-plasticity, dark brown grey, some fine grained sand, moist, very stiff, NATURAL Dark grey mottled orange brown and white BOREHOLE TERMINATED AT 6.00 m	
See Standard Sheets for details of abbreviations & basis of descriptions		Cardno Bowler 7/98 Anzac Ave HILLCREST QLD 4118 PH: (07) 3800 6446 FAX: (07) 3800 0816	

8G_LIB_03.GLB Log BG SOIL LOG 9268 - SOIL LOGS.GPJ <<DrawingFile>> 11/02/2010 10:13

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH3

Job No: 9268

Sheet: 1 of 1

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Q Drill 3000

Bit:

Driller: DL

Casing Diameter:

Contractor: Cardno (Qld) Pty Ltd

Date Started : 27/1/10

Date Completed: 27/1/10

Logged By: DL

Date Logged: 27/1/10

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5								5			SM	SILTY SAND, fine to coarse grained, grey, dry, loose, some grass roots, TOPSOIL
								5				SILTY SAND, fine to coarse grained, grey, dry, medium dense, NATURAL
								16				Becoming dense
1.0						D 1.00 - 1.10 m					SM	
1.5											SC	CLAYEY SAND, fine to medium grained, pale orange, fines of medium plasticity, moisture, medium dense, NATURAL
											CI-XW	DECOMPOSED SANDSTONE/GRANITE, brown, fine to coarse grained, some silt, dry
2.0												TC BIT REFUSAL BOREHOLE TERMINATED AT 1.80 m
2.5												
3.0												
3.5												

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH4

Job No: 9268

Sheet: 1 of 1

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Q Drill 3000

Bit:

Driller: DL

Casing Diameter:

Contractor: Cardno (Qld) Pty Ltd

Date Started : 27/1/10

Date Completed: 27/1/10

Logged By: DL

Date Logged: 27/1/10

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5								8			SM	SILTY SAND, fine to coarse grained, grey, some grass roots, dry, loose, TOPSOIL
								12				SILTY SAND, fine to coarse grained, grey, dry, dense, NATURAL
								15				
								13				
								15				
								15				
								18				
								>20			SM	
1.0												
1.5												
											XW	SANDSTONE/GRANITE, fine to coarse grained, brown
2.0												TC BIT REFUSAL BOREHOLE TERMINATED AT 1.90 m
2.5												
3.0												
3.5												

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH5

Job No: 9268

Sheet: 1 of 2

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Q Drill 3000

Bit:

Driller: DL

Casing Diameter:

Contractor: Cardno (Qld) Pty Ltd

Date Started : 27/1/10

Date Completed: 27/1/10

Logged By: DL

Date Logged: 27/1/10

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5								3				SILTY CLAY, high plasticity, dark grey black with red brown mottle, some fine to coarse grained sand and grass roots, moist, firm to stiff, NATURAL
						D 0.10 - 0.20 m		4				
								5				
								5				
						D 0.40 - 0.50 m		5				
								3				
								2				
								2				
								2				
1.0								3				
								6				Without roots
								7				
						D 1.30 - 1.80 m U50, PP=350-450kPa		9				
								11				
1.5								16				
											CH	
2.0												
												Becoming very stiff to hard
2.5						D 2.40 - 2.50 m						
												Pale grey brown mottled orange brown and dark grey
3.0												
												SILTY SANDY CLAY, high plasticity, pale brown, fine to coarse grained sand, moist to wet, very stiff, NATURAL
3.5												
											CH	

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd		Hole No: BH5	
Project: Proposed Township Development		Sheet: 2 of 2	
Location: Bayliss Road, South Ripley		Job No: 9268	
Position: Refer Site Sketch Figure 1		Angle from Horizontal: 90°	
Rig Type: Q Drill 3000		Surface Elevation:	
Casing Diameter:		Bit:	
Date Started : 27/1/10		Contractor: Cardno (Qld) Pty Ltd	
Date Completed: 27/1/10		Driller: DL	
Logged By: DL		Date Logged: 27/1/10	

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
4.5												
5.0											CH	Trace of fine rock fragments
5.5												
6.0												
6.5												
7.0												
7.5												

D 5.80 - 5.90 m

BOREHOLE TERMINATED AT 6.00 m

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd	Hole No: BH6	
Project: Proposed Township Development	Job No: 9268	Sheet: 2 of 2
Location: Bayliss Road, South Ripley	Angle from Horizontal: 90°	Surface Elevation:
Position: Refer Site Sketch Figure 1	Bit:	Driller: DL
Rig Type: Q Drill 3000	Contractor: Cardno (Qld) Pty Ltd	
Casing Diameter:	Logged By: DL	Date Logged: 27/1/10
Date Started : 27/1/10	Date Completed: 27/1/10	

Depth (m)	Drilling					Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing	Coring							
						D 4.10 - 4.20 m						
4.5												
5.0											SP	Becoming wet
5.5												Trace of shell grit
						D 5.70 - 5.90 m					CI	SILTY CLAY, medium plasticity, pale orange mottled pale grey, trace fine to medium grained sand, moist, very stiff, RESIDUAL
6.0												BOREHOLE TERMINATED AT 6.00 m
6.5												
7.0												
7.5												

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

BOREHOLE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH7

Job No: 9268

Sheet: 1 of 1

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Q Drill 3000

Bit:

Driller: DL

Casing Diameter:

Contractor: Cardno (Qld) Pty Ltd

Date Started : 27/1/10

Date Completed: 27/1/10

Logged By: DL

Date Logged: 27/1/10

Depth (m)	Drilling				Groundwater (m)	Sample or Field Test	Recovered	DCP	RL (m AHD)	Graphic Log	USCS Symbol	Description (SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, structure, ORIGIN)
	Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing								
0.5						D 0.00 - 0.10 m		4			SM	SILTY SAND, fine to coarse grained sand, grey, dry, medium dense, some grass roots, TOPSOIL
								8				
								10				
								10			SC-SM	SILTY SAND/CLAYEY SAND, fine to coarse grained sand, small lumps of clay, pale brown cream, grey, dry, very stiff, NATURAL
						D 0.40 - 0.50 m		10				
								7				
								7				
								7				
						D 0.80 - 0.90 m		6			CI	SANDY SILTY CLAY, medium plasticity, pale orange, fine to coarse grained sand, dry to moist, RESIDUAL
								18				
1.0								>20				
						D 1.30 - 1.40 m					XW	SANDSTONE
1.5												TC BIT REFUSAL BOREHOLE TERMINATED AT 1.50 m
2.0												
2.5												
3.0												
3.5												

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
 7/98 Anzac Ave
 HILLCREST QLD 4118
 PH: (07) 3800 6446
 FAX: (07) 3800 0816

CORE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH8

Job No: 9268

Sheet: 1 of 2

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Hydropower Scout

Bit: V/TC/NMLC

Driller: MATT

Casing Diameter: 80mm

Contractor: Drillsure

Date Started : 28/1/10

Date Completed: 28/1/10

Logged By: DA

Date Logged: 28/1/10

Drilling				Core Recovery (%)	Samples & Field Tests	Depth (m)	Groundwater (m)	Graphic Log	Description SOIL TYPE: SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, ORIGIN ROCK TYPE: Grain size, texture, colour, strength, weathering, fracturing, joint spacing	Weathering	Inferred Strength Is(50) MPa	NATURAL FRACTURES			
Auger V Bit	Auger TC Bit	Washbore	Casing									Defect Spacing (mm)	RQD (%)	Additional Data (Joints, partings, seams, zones, etc.) fracture type, orientation, shape, roughness, separation, infilling or coating	
									SM, SILTY SAND, grey						
						0.5			CI, SANDY CLAY, medium plasticity, light orange mottled pale brown, fine to coarse grained sand, some silt, moist, stiff, RESIDUAL						
						1.0			Becoming brown orange						
						1.5			Tending to XW SANDSTONE						
						2.0			Occasional thin bands of CL SANDY CLAY						
						2.5			XW, SANDSTONE, fine to coarse grained, granular, orange brown, extremely to very low strength						
						3.0			TC BIT REFUSAL AT 2.5m. COMMENCE NMLC CORING						
						3.5			SANDSTONE, fine to coarse grained, granular, orange brown, low to medium strength, highly fractured, extremely weathered						
				100%											
				100%											
													45%		
													23%	2.58 - 4.85 m: FZ	

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

NOTES:

- 1) Visual strength classification
- 2) Discontinuities recorded from the horizontal

CORE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH8

Job No: 9268

Sheet: 2 of 2

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Hydropower Scout

Bit: V/TC/NMLC

Driller: MATT

Casing Diameter: 80mm

Contractor: Drillsure

Date Started : 28/1/10

Date Completed: 28/1/10

Logged By: DA

Date Logged: 28/1/10

Drilling				Core Recovery (%)	Samples & Field Tests	Depth (m)	Groundwater (m)	Graphic Log	Description SOIL TYPE: SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, ORIGIN ROCK TYPE: Grain size, texture, colour, strength, weathering, fracturing, joint spacing	Weathering	Inferred Strength Is(50) MPa	NATURAL FRACTURES			
Auger 'V' Bit	Auger 'TC' Bit	Washbore	Casing									Defect Spacing (mm)	RQD (%)	Additional Data (Joints, partings, seams, zones, etc.) fracture type, orientation, shape, roughness, separation, infilling or coating	
				100%		4.5			SANDSTONE, fine to coarse grained, granular, orange brown, low to medium strength, highly fractured, extremely weathered Becoming light grey	XW/DW	EL 0.03 VL 0.1 L 0.3 M 1 H 3 VH 10 EH	20 40 100 300 1000	23%		
				100%		5.0							88%	5.00 m: J, 0°, P, R, C, CN	
						5.13								5.13 m: J, 30°, U, R, C, CN	
						5.39								5.39 m: J, 8°, P, R, C, CN	
						5.51								5.51 m: J, 30°, P, R, C, CN	
						6.0			BOREHOLE TERMINATED AT 5.70 m						
						6.5									
						7.0									
						7.5									

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

NOTES:

- 1) Visual strength classification
- 2) Discontinuities recorded from the horizontal

CORE LOG SHEET

Client: Cardno (Qld) Pty Ltd
Project: Proposed Township Development
Location: Bayliss Road, South Ripley

Hole No: BH9

Job No: 9268

Sheet: 1 of 2

Position: Refer Site Sketch Figure 1

Angle from Horizontal: 90°

Surface Elevation:

Rig Type: Hydropower Scout

Bit: V/TC/NMLC

Driller: MATT

Casing Diameter: 80mm

Contractor: Drillsure

Date Started : 28/1/10

Date Completed: 28/1/10

Logged By: DA

Date Logged: 28/1/10

Drilling				Core Recovery (%)	Samples & Field Tests	Depth (m)	Groundwater (m)	Graphic Log	Description SOIL TYPE: SYMBOL, SOIL NAME, plasticity/particle characteristics, colour, minor components, moisture, consistency, ORIGIN ROCK TYPE: Grain size, texture, colour, strength, weathering, fracturing, joint spacing	Weathering	Inferred Strength Is(50) MPa	NATURAL FRACTURES			
Auger VV Bit	Auger TC Bit	Washbore	Casing									Defect Spacing (mm)	RQD (%)	Additional Data (Joints, partings, seams, zones, etc.) fracture type, orientation, shape, roughness, separation, infilling or coating	
									SM, SILTY SAND, fine to medium grained, brown grey, some fine roots, dry, loose, TOPSOIL	RS					
						0.5			SM/SC, CLAYEY SAND, fine to medium grained, brown, low to medium plasticity fines, trace of fine roots, dry, medium dense, RESIDUAL						
						1.0									
						1.5			COMMENCE NMLC CORING AT 1.5m	XW / RS					
						2.0			INTERBEDDED SANDSTONE/CLAYEY SAND, medium to coarse grained, granular, orange brown, dense to very dense, RESIDUAL						
				45%		2.5									
						3.0			CL, SANDY CLAY, low plasticity, yellow brown, fine to coarse grained sand, moist, very stiff to hard, RESIDUAL	RS					2.70 - 3.00 m: CS
						3.5			SANDSTONE, medium to coarse grained, granular, orange brown	XW					3.00 - 3.23 m: FZ
				95%					SANDSTONE, coarse grained, granular, brown	XW / DW					3.35 - 3.40 m: FZ
										DW					3.50 m: J, 50°, P, R, O, CN
									With some very coarse quartz grains (white)						3.70 m: J, 20°, P, R, ?, CN
				100%									88%		3.87 m: V, 50°, U, R, O, Q 3.93 m: J, 40°, P, R, O, CN

See Standard Sheets for details of abbreviations & basis of descriptions



Cardno Bowler
7/98 Anzac Ave
HILLCREST QLD 4118
PH: (07) 3800 6446
FAX: (07) 3800 0816

NOTES:

- Visual strength classification
- Discontinuities recorded from the horizontal